


VICINITY MAP
NOT TO SCALE

COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS

PROJECT PLANS FOR CONSTRUCTION OF REDWAY TRANSFER STATION IMPROVEMENTS

PROJECT No. 438005

TO BE SUPPLEMENTED BY STATE OF CALIFORNIA DEPARTMENT OF TRANSPORTATION
STANDARD PLANS, STANDARD SPECIFICATIONS, LATEST REVISED 2023 STANDARD SPECIFICATIONS
AND LATEST 2022 CALIFORNIA BUILDING CODE; BUILDING, ELECTRICAL, PLUMBING, MECHANICAL, FIRE, ENERGY,
AND CALIFORNIA GREEN BUILDING CODE

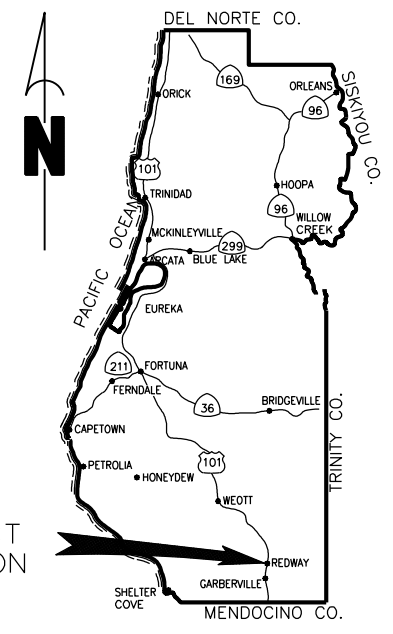

PROJECT LOCATION

LOCATION MAP
NOT TO SCALE



STANDARD ABBREVIATIONS			
AB	AGGREGATE BASE	FOC	FACE OF CURB
ADA	AMERICANS WITH DISABILITIES ACT	FOW	FACE OF WALK
AP	ANGLE POINT	FT	FOOT (FEET)
BEG	BEGIN	G	GAS
BFP	BACK FLOW PREVENTOR	GB	GRADE BREAK
BOC	BACK OF CURB	GFL	GUTTER FLOWLINE
BOW	BACK OF WALK	GR	INLET GRATE
BW	BARBED WIRE	GV	GATE VALVE
CONC	CONCRETE	HCS	HUMBOLDT COUNTY SERVICES DISTRICT
C&G	CURB AND GUTTER	HMA	HOT MIX ASPHALT
CL	CENTERLINE OR CLASS OR CHAINLINK	HP	HIGH POINT
CLR	CLEAR	IRR	IRRIGATION
CG	CURB, GUTTER & CLEANOUT	LF	LINEAR FEET
CO	CURB RAMP	LIP	LIP OF GUTTER
CR	DRAIN INLET	LP	LOW POINT
DI	DRAWING	Lt	LEFT
DWG	DRIVEWAY	MAX	MAXIMUM
DWY	EXISTING GRADE	MH	MANHOLE
EG	ELEVATION	MIN	MINIMUM
EL/ELEV	ELBOW (PIPE)	MOD	MODIFIED
ELL	EDGE OF PAVEMENT	NTS	NOT TO SCALE
EP	EXISTING	OG	ORIGINAL GROUND
EXIST	FINISHED FLOOR	OH	OVERHEAD
FF	FINISHED GRADE	PB	PULL BOX
FG	FLOWLINE	PCC	PLAIN CEMENT CONCRETE
FL	FORCE MAIN (SS)	P/L	PROPERTY LINE
FM		PP	POWER POLE
		PVMT	PAVEMENT
RPT	RADIAL POINT		
Rt	RIGHT		
R/W	RIGHT OF WAY		
S	SLOPE		
SAW	SAWCUT LINE		
SD	STORM DRAIN		
SDMH	STORM DRAIN MANHOLE		
SF	SQUARE FOOT, OR FEET		
SHT	SHEET		
SS	SANITARY SEWER		
SSCO	SANITARY SEWER CLEANOUT		
SSMH	SANITARY SEWER MANHOLE		
STD	STANDARD		
SW	SIDEWALK		
TBC	TOP BACK OF CURB		
TBW	TOP BACK OF WALK		
TC	TOP OF CURB		
TEL	TELECOMMUNICATION-TELEPHONE		
TEMP	TEMPORARY		
TFC	TOP FACE OF CURB		
TS	TRAFFIC SIGNAL		
TYP	TYPICAL		
UG	UNDERGROUND		
VAR	VARIES		
VG	VEE GUTTER/VALLEY GUTTER		
VOL	VOLUME		
W	WATER		
WM	WATER METER		
WV	WATER VALVE		
XING	CROSSING		

NOTES

1. THE CONTRACTOR SHALL HAVE A CLASS "B" LICENSE FOR CONSTRUCTION ON THIS PROJECT.
2. STANDARD PLANS LIST APPLICABLE TO THIS CONTRACT IS INCLUDED IN THE SPECIAL PROVISIONS.

GEOTECH REPORT

PREPARED BY: CRAWFORD & ASSOCIATES, INC.
REPORT DATED: JUNE. 28 2023

SURVEY INFORMATION

PREPARED BY: HUMBOLDT COUNTY PUBLIC WORKS
FIELD SURVEY COMPLETED: FEBRUARY 2025
PROJECT #438005


INDEX OF SHEETS

1	TITLE SHEET	45	UTILITY PLAN
2	TRAFFIC CONTROL PLAN	46	WATER POLLUTION AND EROSION CONTROL PLAN
3	DEMOLITION PLAN	47-52	ELECTRICAL PLANS (E0.1-E4)
4	SITE PLAN	53-58	TITLE 24 - ENERGY COMPLIANCE
5-10	GRADING PLAN		
11	"C" LINE - ROAD SECTION		
12-15	"T" LINE - TRANSFER SECTION		
16	"J" LINE AND JOINT TRENCH SECTION		
17-19	STRIPING AND SIGN PLANS		
20-21	ADA PARKING DETAILS		
22-23	MANUFACTURE WEIGH SCALE FOUNDATION PLAN		
24-27	TYPICAL CONSTRUCTION DETAILS		
28-35	PROPOSED WEIGH STATION BUILDING PLANS		
36-41	WEIGH STATION BUILDING STRUCTURAL PLANS (S0-S4)		
42-43	EXISTING TRANSFER BUILDING REPAIRS AND INTERIOR DEMOLISH		
44	PROPOSED RECYCLING BUILDING		

Avoid cutting underground utility lines. It's costly.

**Call
before you
Dig**

811 OR 800-642-2444
UNDERGROUND SERVICE (USA)

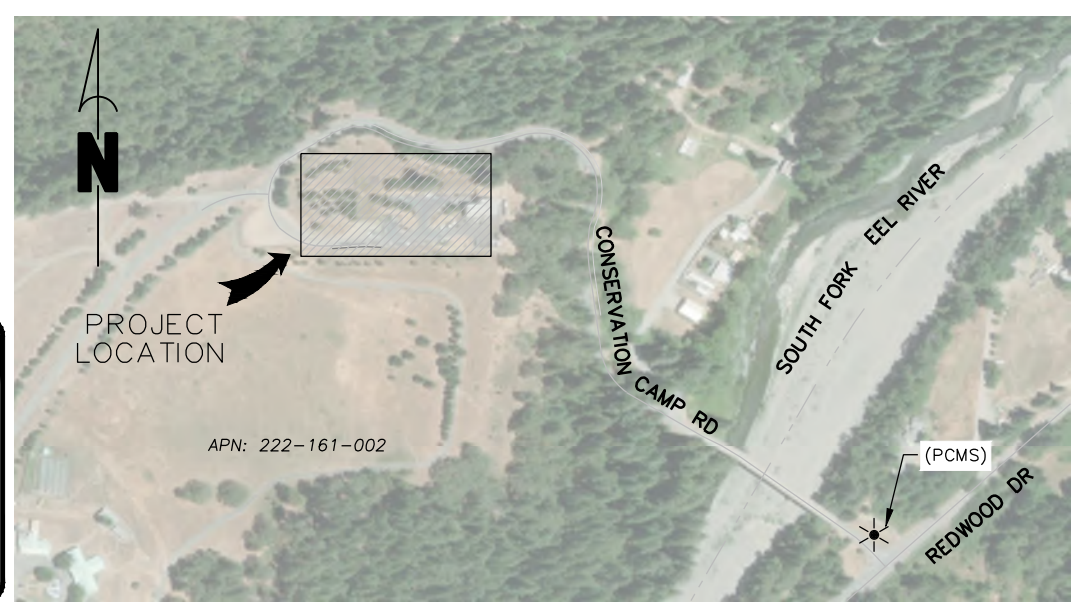

Tony Seghetti
TONY SEGHETTI
RCE 63714, EXP. 9/30/2026

8/20/25
DATE




Jason Hickey
JASON HICKEY
RSE S5783, EXP. 05/29/2026

8/19/25
DATE



NOTES

- SIGNS SHALL BE PLACED AS SHOWN ON PLAN OR AS DIRECTED BY THE ENGINEER.
- FINAL PLACEMENT OF SIGNS SHALL BE APPROVED BY RESIDENT ENGINEER.
- ADDITIONAL PORTABLE SIGNS SHALL BE USED AS REQUIRED FOR OTHER ROADSIDE WORK.
- SEE STANDARD PLAN T13 FOR TRAFFIC CONTROL SYSTEM.
- IN ADDITION TO CONSTRUCTION AREA SIGNS AND WHEN DIRECTED BY THE RESIDENT ENGINEER, THE CONTRACTOR SHALL UTILIZE FLAGMEN AS NECESSARY TO DIRECT TRAFFIC.
- PLACE SIGNS APPROXIMATELY 100 FEET APART
- DISTANCE TO W20-1 AND G20-2 MAY BE EXTENDED TO ENCOMPASS SITES WITHIN ONE MILE OF EACH OTHER.
- WHEN THROUGH TRAFFIC IS ALLOWED, KEEP A MINIMUM OF 1 TRAFFIC LANE AT LEAST 10 FEET WIDE OPEN FOR TRAFFIC, EXCEPT THE FULL WIDTH OF THE TRAVELED WAY (18' MINIMUM) MUST BE OPEN WHEN CONSTRUCTION OPERATIONS ARE NOT ACTIVE OR AN APPROVED TRAFFIC CONTROL PLAN IS IN PLACE.
- CONTRACTOR MUST PROVIDE A MINIMUM OF 14 DAYS NOTICE OF COMPLETE ROAD CLOSURE TO ENGINEER.

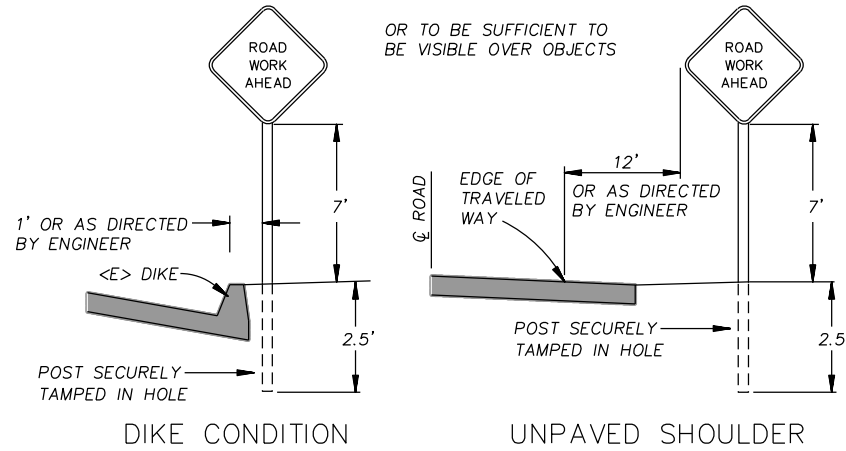

RURAL CONSTRUCTION AREA SIGN

- NOT TO SCALE -




ROAD NAME: CONSERVATION CAMP RD		HUMCO		COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS		SHEET 2 OF 58
ROAD NO:	MILE POST:	DESIGNED BY: ENGR	REDWAY TRANSFER STATION			
PROJECT NO: 438005		DRAWN BY: PBS	TRAFFIC CONTROL PLAN			
DRAWING FILE NAME: RTS_SITE PLAN		REVIEWED BY: JAB				
PLOT DATE: 08/19/25		APPROVED BY: TRS				

QUANTITY SUMMARY


ITEM No.	ITEM CODE	ITEM DESCRIPTION	UNIT	QUANTITY
1	120100	TRAFFIC CONTROL SYSTEM	LS	1
2	130100	JOB SITE MANAGEMENT	LS	1
3	130201	WATER POLLUTION CONTROL PROGRAM	LS	1
4	130620	TEMPORARY DRAINAGE INLET PROTECTION	EA	3
5	130640	TEMPORARY FIBER ROLL	LF	50
6	130680	TEMPORARY SILT FENCE	LF	320
7	130900	TEMPORARY CONCRETE WASHOUT	LS	1
8	153250	REMOVE GUARD SHELTER, SCALE, AND SCALE FOUNDATION	LS	1
9	170103	CLEARING AND GRUBBING	LS	1
10	190101	ROADWAY EXCAVATION	CY	1,227
11	210212	DRY SEED	SQFT	3,150
12	210420	STRAW	SQFT	3,150
13	260203	CLASS 2 AGGREGATE BASE	CY	1,517
14	390132	HOT MIX ASPHALT (TYPE A)	TON	608
15	394073	PLACE HOT MIX ASPHALT DIKE (TYPE A)	LF	688
16	398100	REMOVE ASPHALT CONCRETE DIKE	LF	742
17	568064	4" SCH 80 STEEL PROTECTIVE BOLLARD	EA	20
18	723095	ROCK SLOPE PROTECTION (20 LB, CLASS I, METHOD B) (CY)	CY	1
19	731512	MINOR CONCRETE (PARKING, SIDEWALK, LANDING)	CY	36
20	731513	MINOR CONCRETE (VALLEY GUTTER)	CY	5
21	770100	WATERLINE SYSTEM	LS	1
22	770200	WASTE WATER SYSTEM	LS	1
23	780500	PARKING BUMPER (PRECAST CONCRETE)	EA	9
24	800001	FENCE (TYPE BW, METAL POST)	LF	215
25	800363	CHAIN LINK FENCE (TYPE CL-6 W/BW, EXTENSION ARM)	LF	684
26	802675	36' SECURITY METAL SLIDING GATE	EA	1
27	803030	REMOVE FENCE (TYPE CL W/BW)	LF	438
28	803035	REMOVE FENCE (TYPE BW WOOD POST AND METAL T-POST)	LF	755
29	820001	INSTALL SIGNS (STANDARD AND CUSTOM)	LS	1
30	840501	THERMOPLASTIC TRAFFIC STRIPE	LF	1836
31	840515	THERMOPLASTIC PAVEMENT MARKING	SF	260
32	840651	PAINTED ADA PAVEMENT MARKINGS (ADA PARKING)	SF	93
33	840665	PAINT ADA PARKING LINES (1-COAT) (ADA PARKING)(RED CAUTION LINE)	SF	161
34	870100	ELECTRICAL AND LIGHTING SYSTEM	LS	1
35	990100	FURNISH AND INSTALL 2400 SF METAL BUILDING (RECYCLING)	LS	1
36	990200	FURNISH AND INSTALL 218 SF STICK FRAME BUILDING (WEIGH STATION)	LS	1
37	990300	WEIGH SCALE (RICE LAKE - SURVIVOR OTR)	LS	1
38	990400	REMOVE SCALE FACILITIES AND DEMOLITION, REPAIR, REPLACE DOORS EXISTING BUILDING (TRANSFER)	LS	1
39	991000	FURNISH AND INSTALL PLUMBING FOR BUILDINGS	LS	1
40	999990	MOBILIZATION	LS	1

XX XXXX
 ITEM NO. CODE DESCRIPTION
 SPECIFICATION SECTION NUMBER WITHIN STATE OF CALIFORNIA DEPARTMENT OF TRANSPORTATION (CALTRANS) 2024 STANDARD SPECIFICATION

THE STATE OF CALIFORNIA DEPARTMENT OF TRANSPORTATION 2024 STANDARD SPECIFICATIONS AND 2024 STANDARD PLANS CAN BE FOUND AT [HTTPS://DOT.CA.GOV/PROGRAMS/DESIGN/OCTOBER-2024-CCS-STANDARD-PLANS-AND-STANDARD-SPECIFICATIONS](https://dot.ca.gov/programs/design/october-2024-ccs-standard-plans-and-standard-specifications).

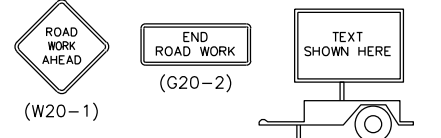





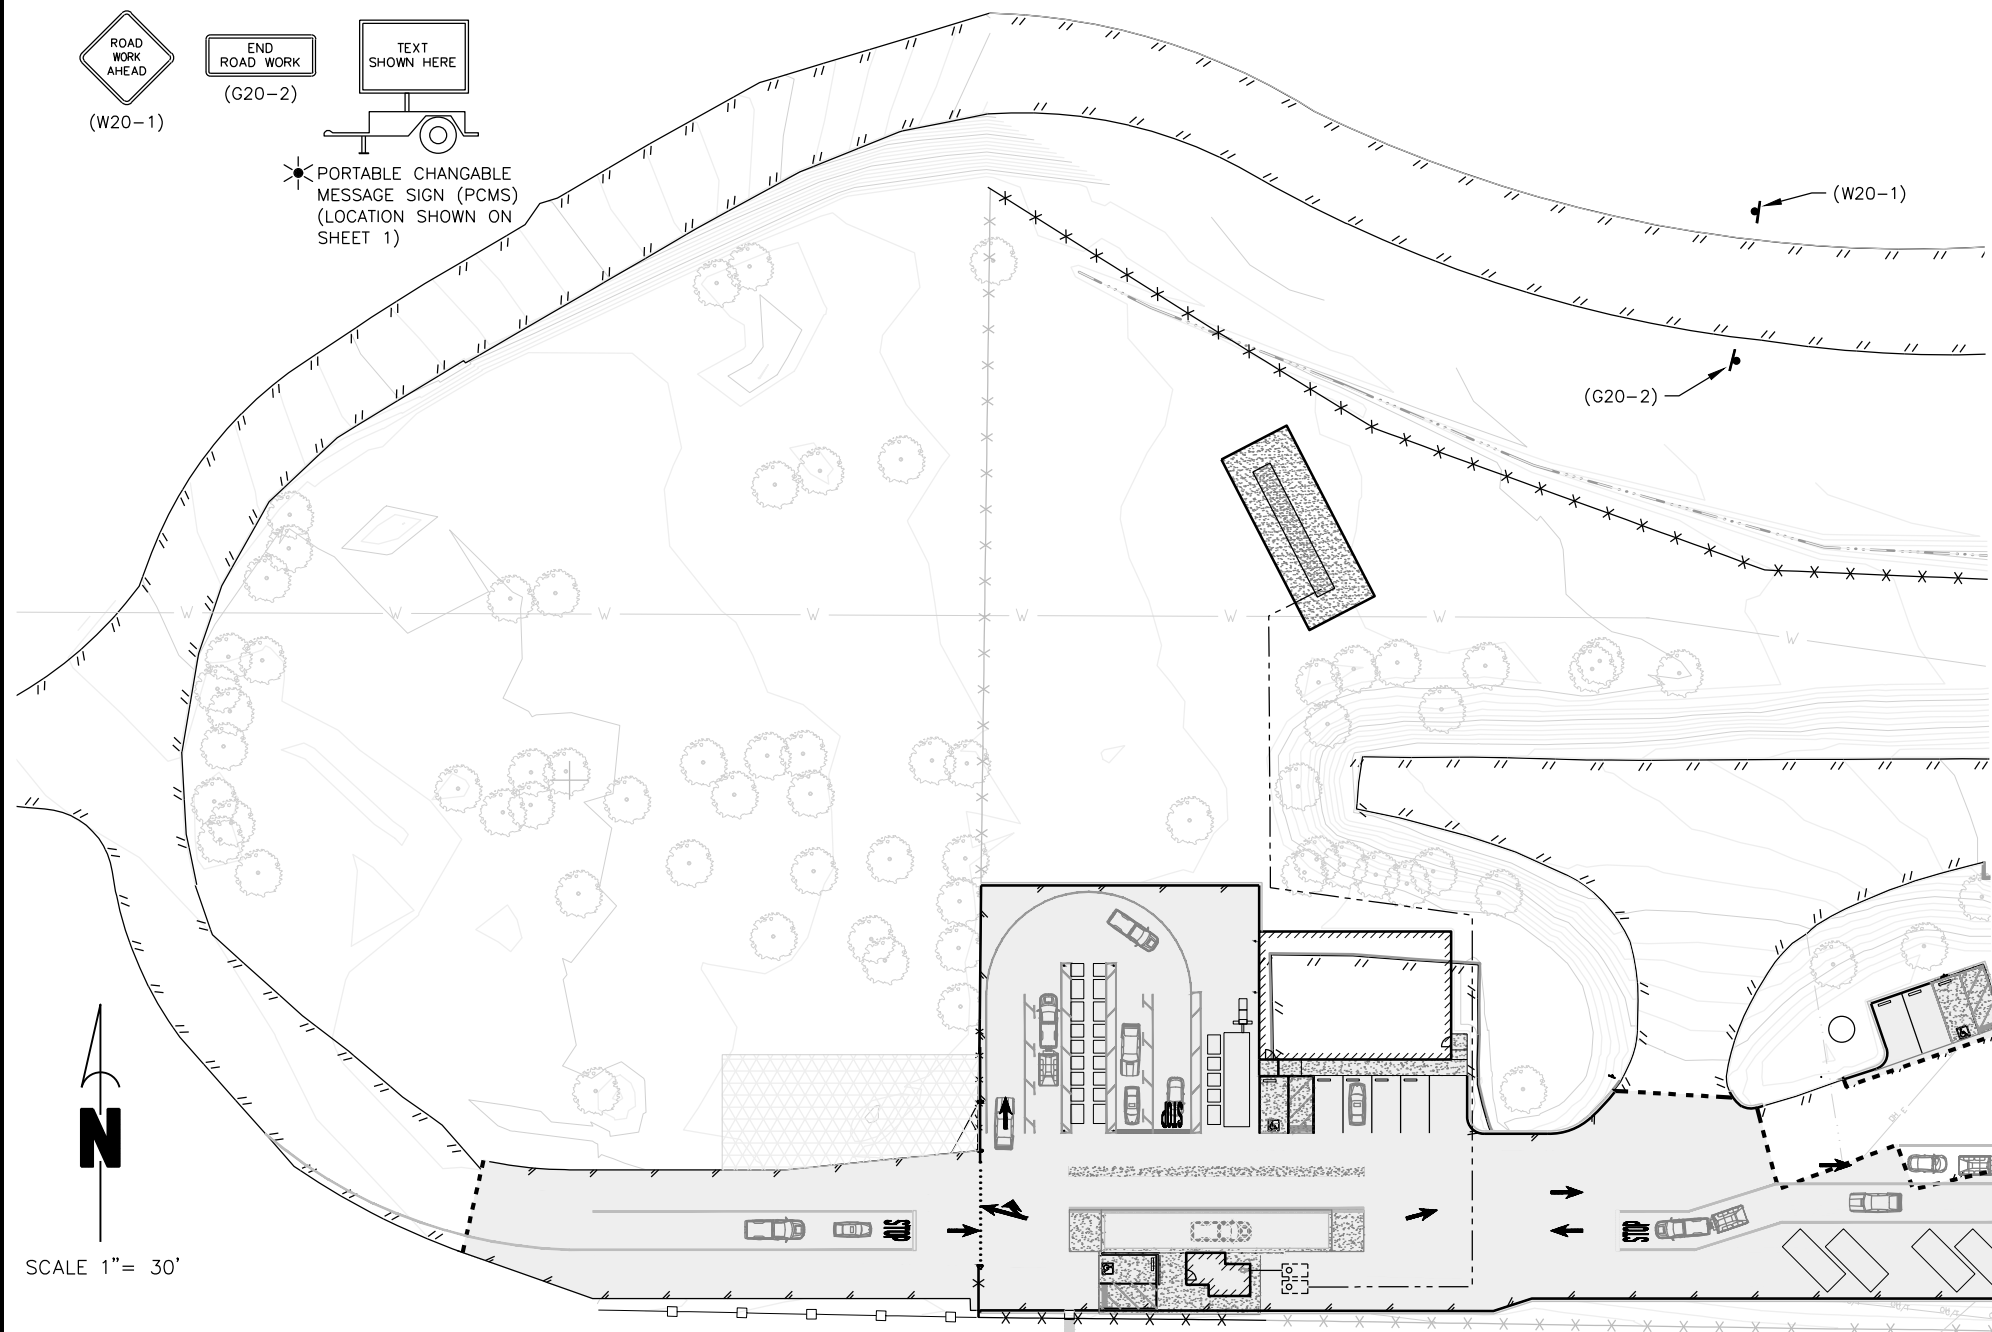



PORTABLE CHANGABLE MESSAGE SIGN (PCMS) (LOCATION SHOWN ON SHEET 1)



SCALE 1" = 30'

LEGEND:

-  HMA SECTION LIMITS  } SEE SECTIONS TO RIGHT
-  PCC SECTION LIMITS  } SEE SECTIONS TO RIGHT
-  LIMITS OF SLURRY SEAL (SAWCUT)
-  SURVEY CONTROL POINT LOCATION
-  LIMITS OF 5'x5' (MIN) ADA LEVEL LANDING AT DOORWAY THRESHOLD. SET TO 1.50% CROSS SLOPE (2.0% MAX) IN ALL DIRECTIONS, TYP
-  BOLLARD





NOTES:

1. THESE NOTES SHALL APPLY TO ALL DRAWINGS UNLESS NOTIFIED OTHERWISE OR SHOWN.
2. ALL WORK SHALL BE DONE IN ACCORDANCE WITH THE 2022 CALIFORNIA BUILDING CODE (CBC), AND THE LATEST CORRESPONDING EDITIONS OF THE FOLLOWING CALIFORNIA CODES: MECHANICAL (CMC), ELECTRICAL (CEC), PLUMBING (CPC), FIRE (CFC), ENERGY (CEC), AND THE CALIFORNIA GREEN BUILDING STANDARDS CODE (CALGREEN).
3. FOR ACCURATE RIGHT OF WAY DATA, CONTACT HUMBOLDT COUNTY DEPARTMENT OF PUBLIC WORKS.
4. FOR SPECIFIC LAYOUT INFORMATION AND DETAILS NOT SHOWN HERE, SEE CONSTRUCTION DETAILS (UNLESS OTHERWISE NOTED).
5. SEE SUPPLEMENTAL DOCUMENT: GEOTECHNICAL REPORT WRITTEN BY CRAWFORD & ASSOCIATES DATED JUNE 23, 2023. FOLLOW ALL RECOMMENDATIONS.
6. INSTALL ALL APPLICABLE REQUIREMENTS PER HUMBOLDT COUNTY COMMUNITY WILDFIRE PROTECTION PLAN, 2019.




PAVEMENT SECTION DESIGN DESIGNATION:

R-VALUE = 11
T.I. = 6.0

PROPOSED SECTIONS:

-  0.25' HMA
-  1.00' CLASS 2 AB
-  0.50' PCC
-  0.50' CLASS 2 AB

PARKING:

-  (1) ADA VAN ACCESSIBLE PARKING
-  (1) ADA VAN ACCESSIBLE PARKING AND (4) 9'x18' TYP. STALLS
-  (1) ADA VAN ACCESSIBLE PARKING AND (2) 10'x20' STALLS



BASIS OF BEARING:

GPS CALIFORNIA COORDINATE SYSTEM, ZONE 1, NAD 83, COMBINATION FACTOR 0.99994964, GAMMA ANGLE -1'11"20", EPOCH 2010.00. ROTATE GRID BEARINGS SHOWN HEREON COUNTER-CLOCKWISE BY 1'11"20" TO OBTAIN GEODETIC (TRUE) BEARINGS.

BASIS OF ELEVATION:


470.659 AT CP1 PER OPUS, NAVD 88

DATE OF SURVEY:

FEBRUARY 5, 2025


ROAD NAME: CONSERVATION CAMP RD		HUMCO		COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS	
ROAD NO:	MILE POST:	DESIGNED BY: ENGR	REDWAY TRANSFER STATION		
PROJECT NO: 438005		DRAWN BY: PBS	SITE PLAN		
DRAWING FILE NAME: RTS_SITE PLAN		REVIEWED BY: JAB			
PLOT DATE: 08/19/25		APPROVED BY: TRS	SHEET 4 OF 58		

POINT TABLE					
POINT NUMBER	NORTHING	EASTING	ELEVATION	DESCRIPTION	
1	1940130.33	6053340.11	CPSET80DSPIKE	CPSET80DSPIKE	
2	1940031.92	6053620.11	CPSET80DSPIKE	CPSET80DSPIKE	
3	1940230.77	6053443.08	CPSET80DSPIKE	CPSET80DSPIKE	
4	1940221.24	6053597.54	CPSET80DSPIKE	CPSET80DSPIKE	
5	1940062.68	6052951.81	CPSET80DSPIKE	CPSET80DSPIKE (SEE SHEET 4)	
6	1940307.22	6053240.67	CPSET80D&SHINER	CPSET80D&SHINER	
7	1940311.06	6052919.40	SETCP80DNAILSHINER	SETCP80DNAILSHINER (SEE SHEET 4)	
101	1940041.61	6053032.47	CP/MAG&TAG HUMCO DPW CONTROL	CP/MAG&TAG HUMCO DPW CONTROL	
102	1940068.73	6053495.87	CP/80&TAG HUMCO SURVEY	CP/80&TAG HUMCO SURVEY	
103	1940194.06	6053369.83	CP/MAG&TAG HUMCO DPW CONTROL	CP/MAG&TAG HUMCO DPW CONTROL	
104	1940119.38	6053591.72	CP/PKS	CP/PKS	
105	1940143.31	6053659.98	CP/80D&SHINER	CP/80D&SHINER (SEE SHEET 4)	

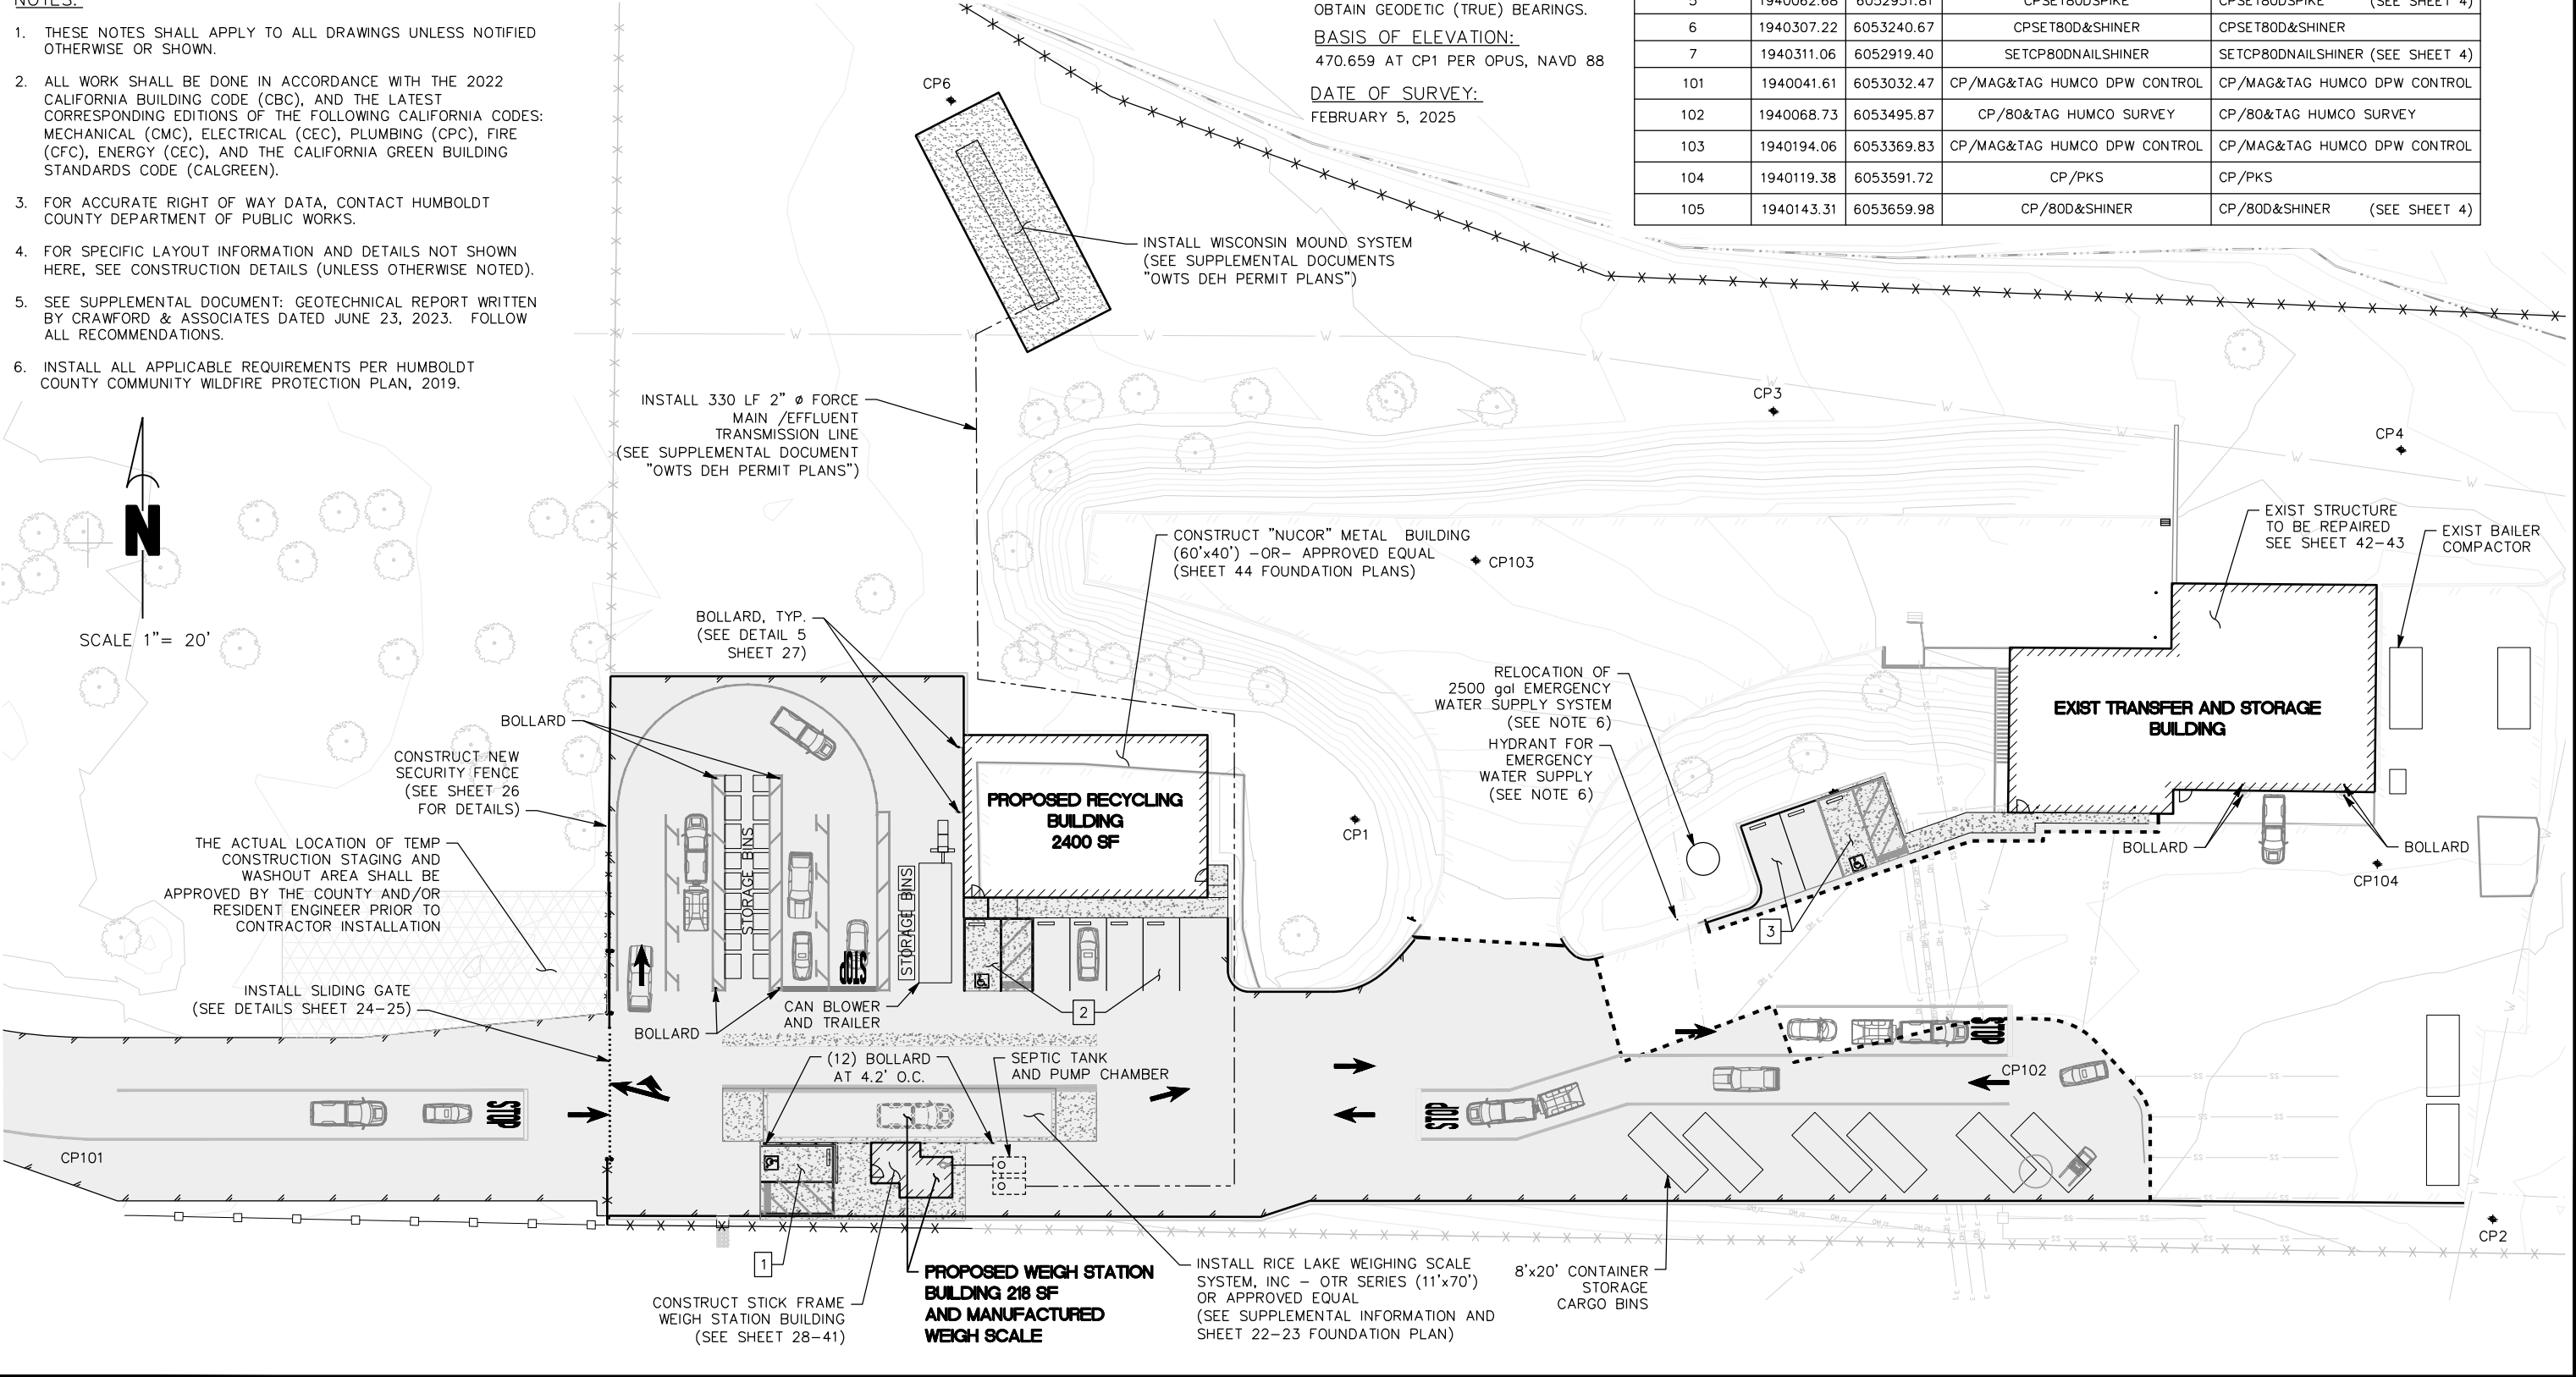

SCALE 1" = 20'





ROADWAY QUANTITIES										
ALIGNMENT	TYPE	ROADWAY QUANTITIES								
		ROADWAY EXCAVATION	STRUCTURE EXCAVATION	CLASS 2 AGGREGATE BASE (CY)	HOT MIX ASPHALT (HMA) TYPE A	HMA DIKE (TYPE A)	MINOR CONCRETE (SIDEWALK, LANDING)	MINOR CONCRETE (PARKING)	MINOR CONCRETE (VALLEY GUTTER)	STRUCTURE CONCRETE
C		325	233	58						
T		903	1285	236	17	18	17	7		1
	RECYCLING		*152							*79
	WEIGH STATION		23							8
	WEIGH SCALE		*345							*74

* Structure Excavation, Backfill, and Structure Concrete per manufacture specifications.



- NOTES:**
- CONTRACTOR MUST FOLLOW GENERAL GRADING NOTES AS OUTLINED IN COUNTY LAND USE AND DEVELOPMENT, DIVISION 3, BUILDING REGULATIONS SECTION 331-14: GRADING, EXCAVATION, EROSION, AND SEDIMENTATION CONTROL.
 - EP POINTS ARE CALLED OUT AND DESCRIBED FOR FG ELEVATION REFERENCE. MOST EP CALLOUTS ARE LOCATED ALONG FACE OF HMA DIKE.

- STOCKPILE NOTES:**
- MANAGE MATERIAL PER SECTION 13-4.03C OF THE 2024 CALTRANS SPECIFICATIONS.
 - IF STOCKPILE AREA IS IN A TURNOUT, THE TURNOUT SHALL BE REESTABLISHED TO PRE-CONSTRUCTION CONDITIONS.
 - STOCKPILE LOCATIONS SHALL BE APPROVED BY THE COUNTY AND/OR RESIDENT ENGINEER PRIOR TO CONTRACTOR INSTALLATION



- LEGEND:**
- HMA SECTION LIMITS
 - PCC SECTION LIMITS
 - LIMIT OF SLURRY SEAL (SAWCUT)
 - SWALE FL/SURFACE FLOW DIRECTION
 - EXIST OVERLAND RELEASE LOCATION
 - BOLLARD
 - EDGE OF PAVEMENT
 - OVERLAND RELEASE LOCATION

ALIGNMENT CURVE TABLE				
CURVE	RADIUS	DELTA	TANGENT	LENGTH
C1	133.74'	53°51'52"	67.94'	125.73'

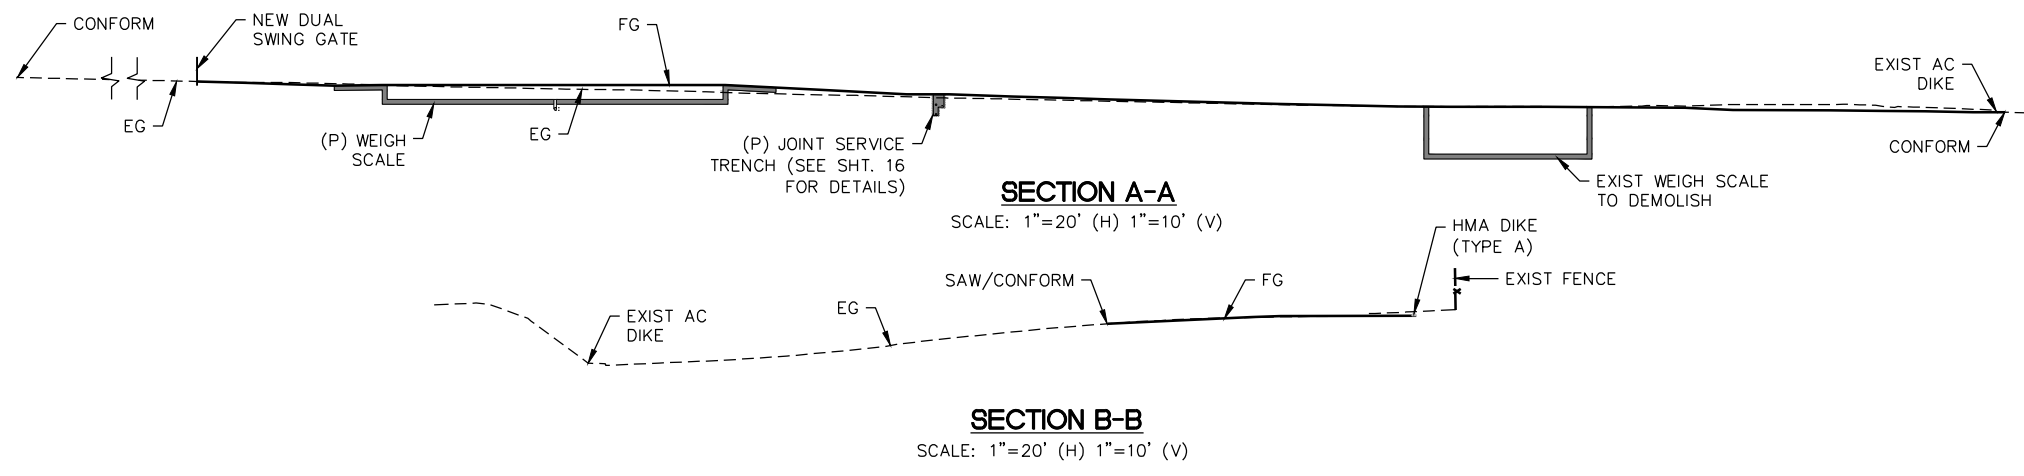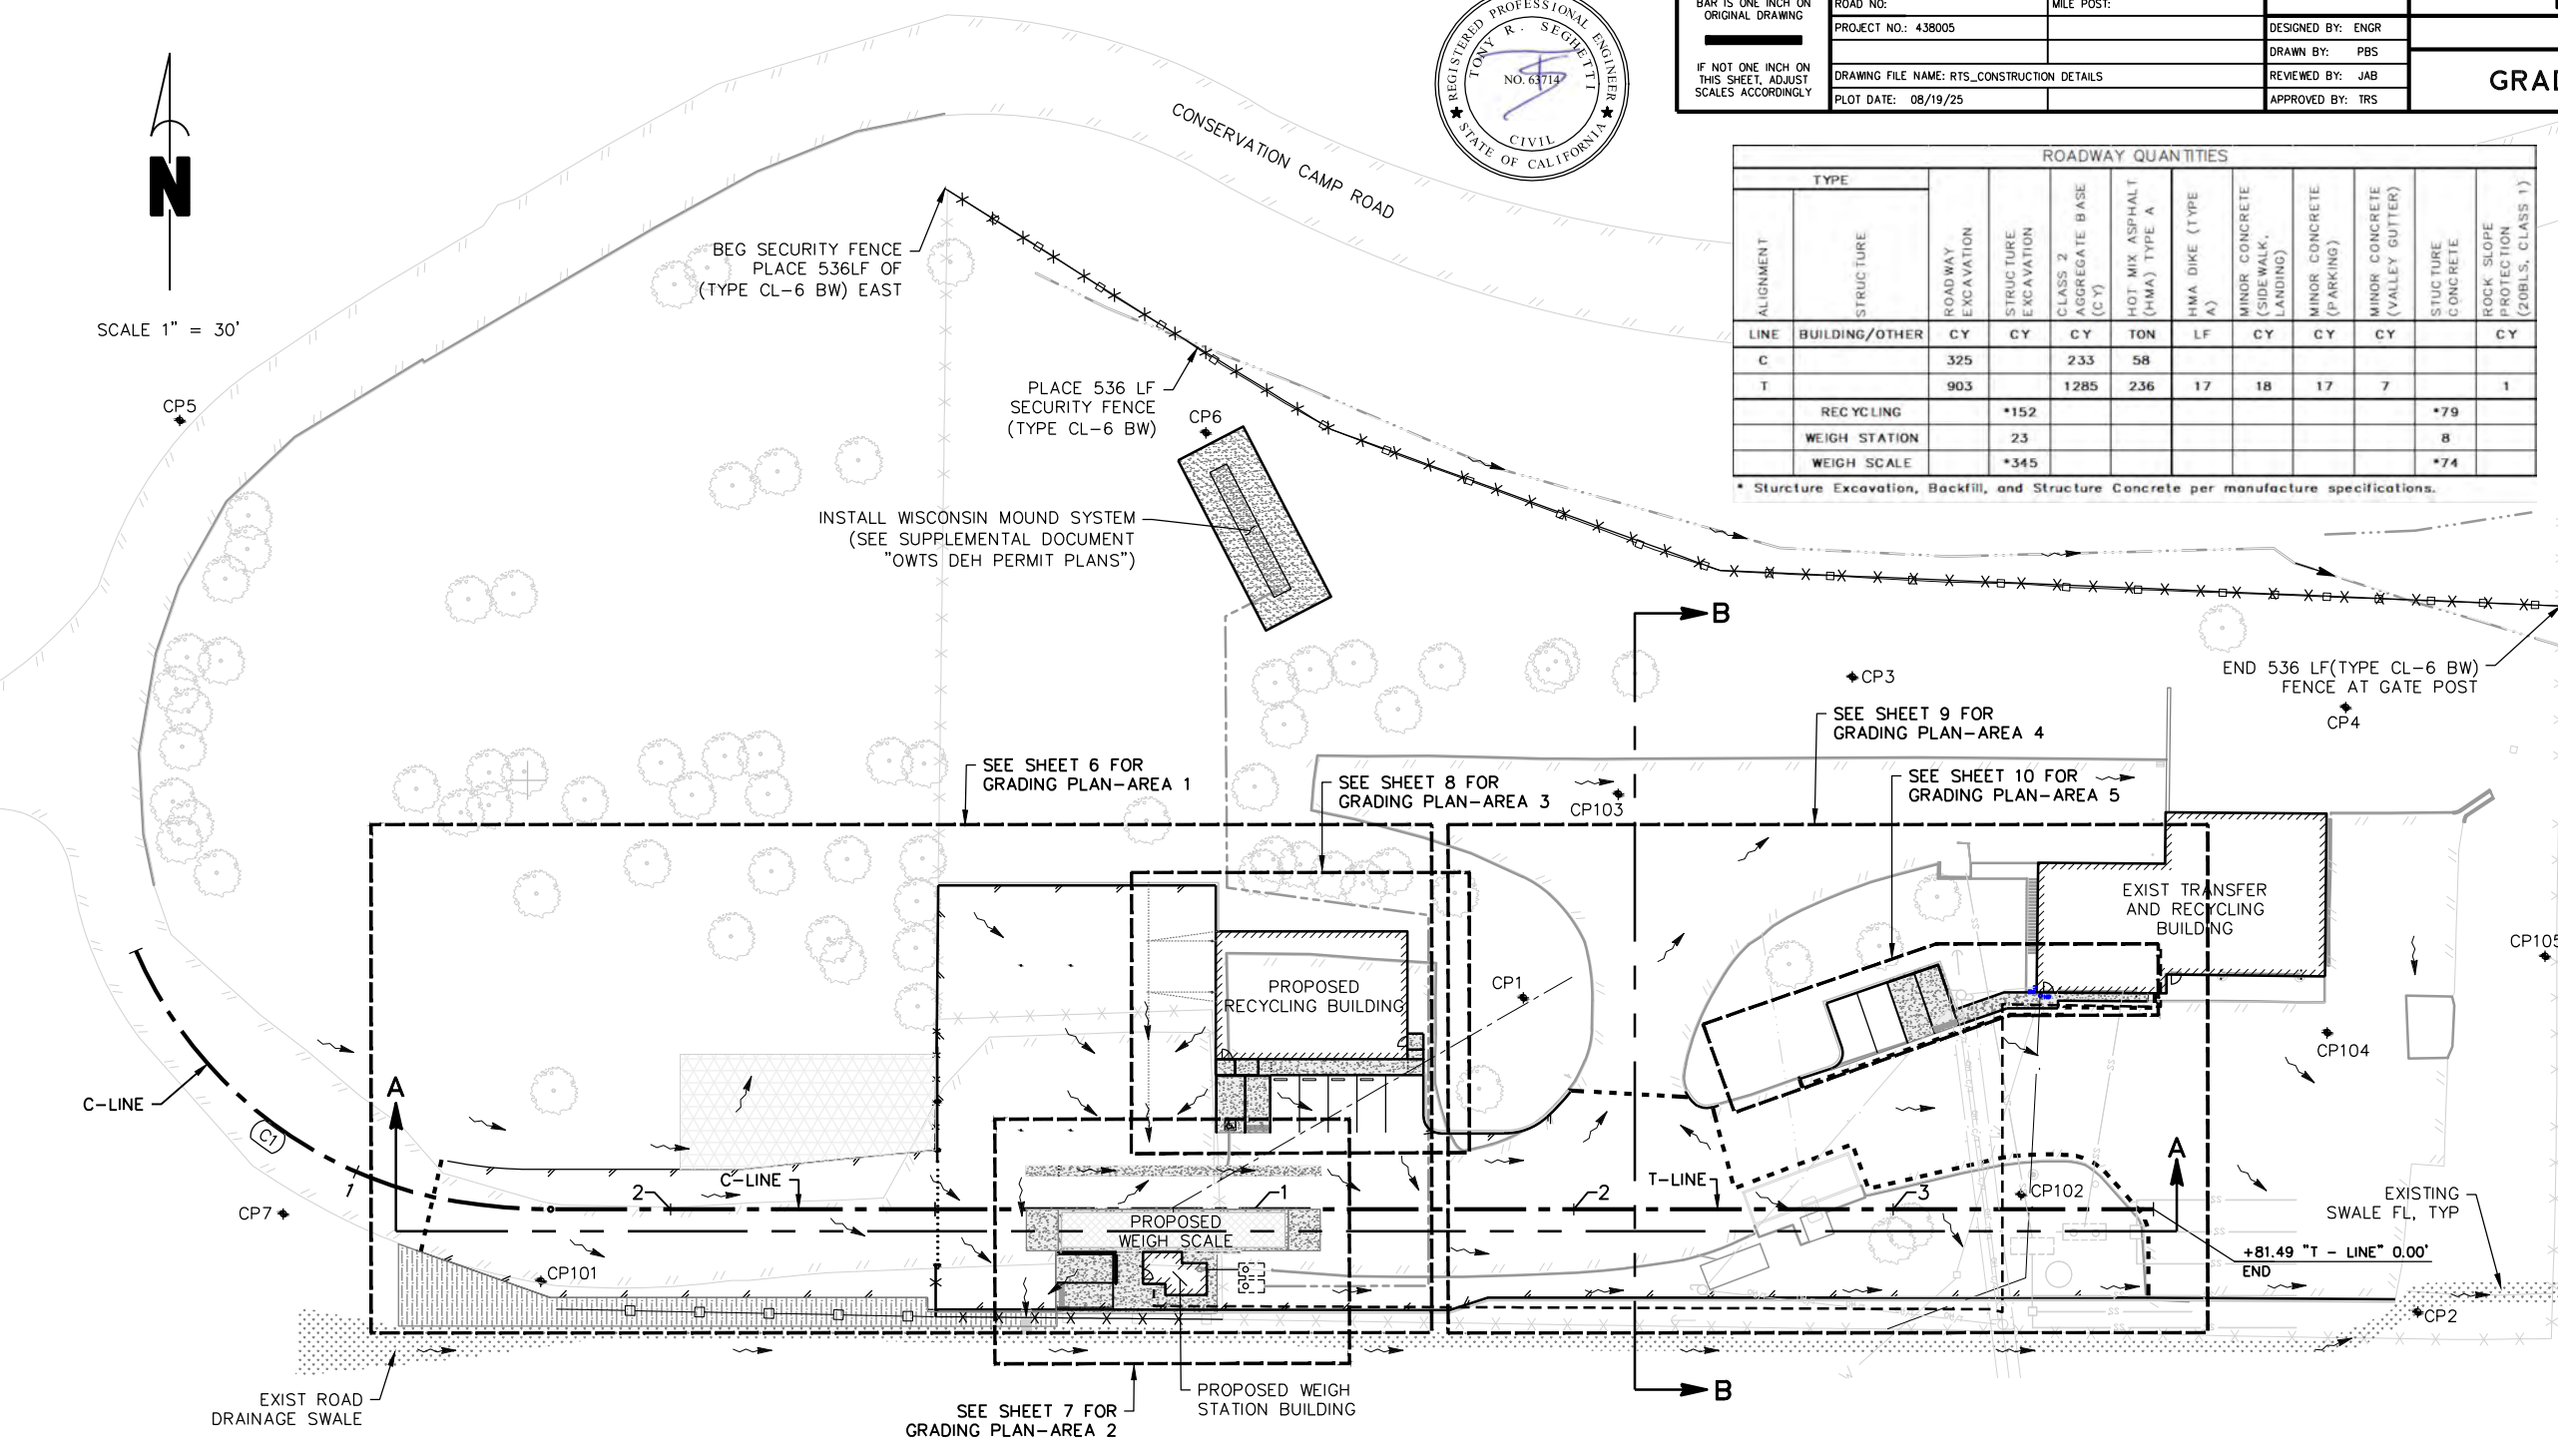
POINT TABLE				
POINT NUMBER	NORTHING	EASTING	ELEVATION	DESCRIPTION
1	1940140.52	6053370.76	CPSET80DSPIKE	CPSET80DSPIKE
2	1940042.11	6053650.76	CPSET80DSPIKE	CPSET80DSPIKE
3	1940240.96	6053473.73	CPSET80DSPIKE	CPSET80DSPIKE
4	1940231.43	6053628.19	CPSET80DSPIKE	CPSET80DSPIKE
5	1940072.87	6052982.46	CPSET80DSPIKE	CPSET80DSPIKE
6	1940317.41	6053271.32	CPSET80D&SHINER	CPSET80D&SHINER
7	1940321.25	6052950.05	SETCP80D&SHINER	SETCP80D&SHINER
101	1940051.80	6053063.12	CP/MAG&TAG HUMCO DPW CONTROL	CP/MAG&TAG HUMCO DPW CONTROL
102	1940078.92	6053526.52	CP/80&TAG HUMCO SURVEY	CP/80&TAG HUMCO SURVEY
103	1940204.26	6053400.48	CP/MAG&TAG HUMCO DPW CONTROL	CP/MAG&TAG HUMCO DPW CONTROL
104	1940129.58	6053622.37	CP/PKS	CP/PKS
105	1940153.50	6053690.63	CP/80D&SHINER	CP/80D&SHINER



LEGEND:




 HMA SECTION LIMITS
 PCC SECTION LIMITS


SEE SECTION DEPTH ON SITE PLAN

 LIMITS OF 4'x4' (MIN) CLEAR WIDTH AT ADA DOORWAY THRESHOLD, OR WHERE SHOWN. LANDING SET TO 1.50% CROSS SLOPE (2.0% MAX) IN ALL DIRECTIONS, TYP

 BUILDING STRUCTURE

 SWALE FL/SURFACE FLOW DIRECTION
 X.X% GRADE SLOPE PERCENT


 BOLLARD
 GRADEBREAK
 EDGE OF PAVEMENT



THE ACTUAL LOCATION OF TEMP CONSTRUCTION STAGING AND WASHOUT AREA SHALL BE APPROVED BY THE RESIDENT ENGINEER PRIOR TO CONTRACTOR INSTALLATION. STAGING AREA SHALL BE REESTABLISHED TO PRE-CONSTRUCTION CONDITIONS.



ROAD NAME: CONSERVATION CAMP RD		HUMCO		COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS		SHEET 6 OF 58
ROAD NO:	MILE POST:	DESIGNED BY: ENGR	REDWAY TRANSFER STATION			
PROJECT NO: 438005		DRAWN BY: PBS	GRADING PLAN-AREA 1			
DRAWING FILE NAME: RTS_CONSTRUCTION DETAILS		REVIEWED BY: JAB				
PLOT DATE: 08/19/25		APPROVED BY: TRS				


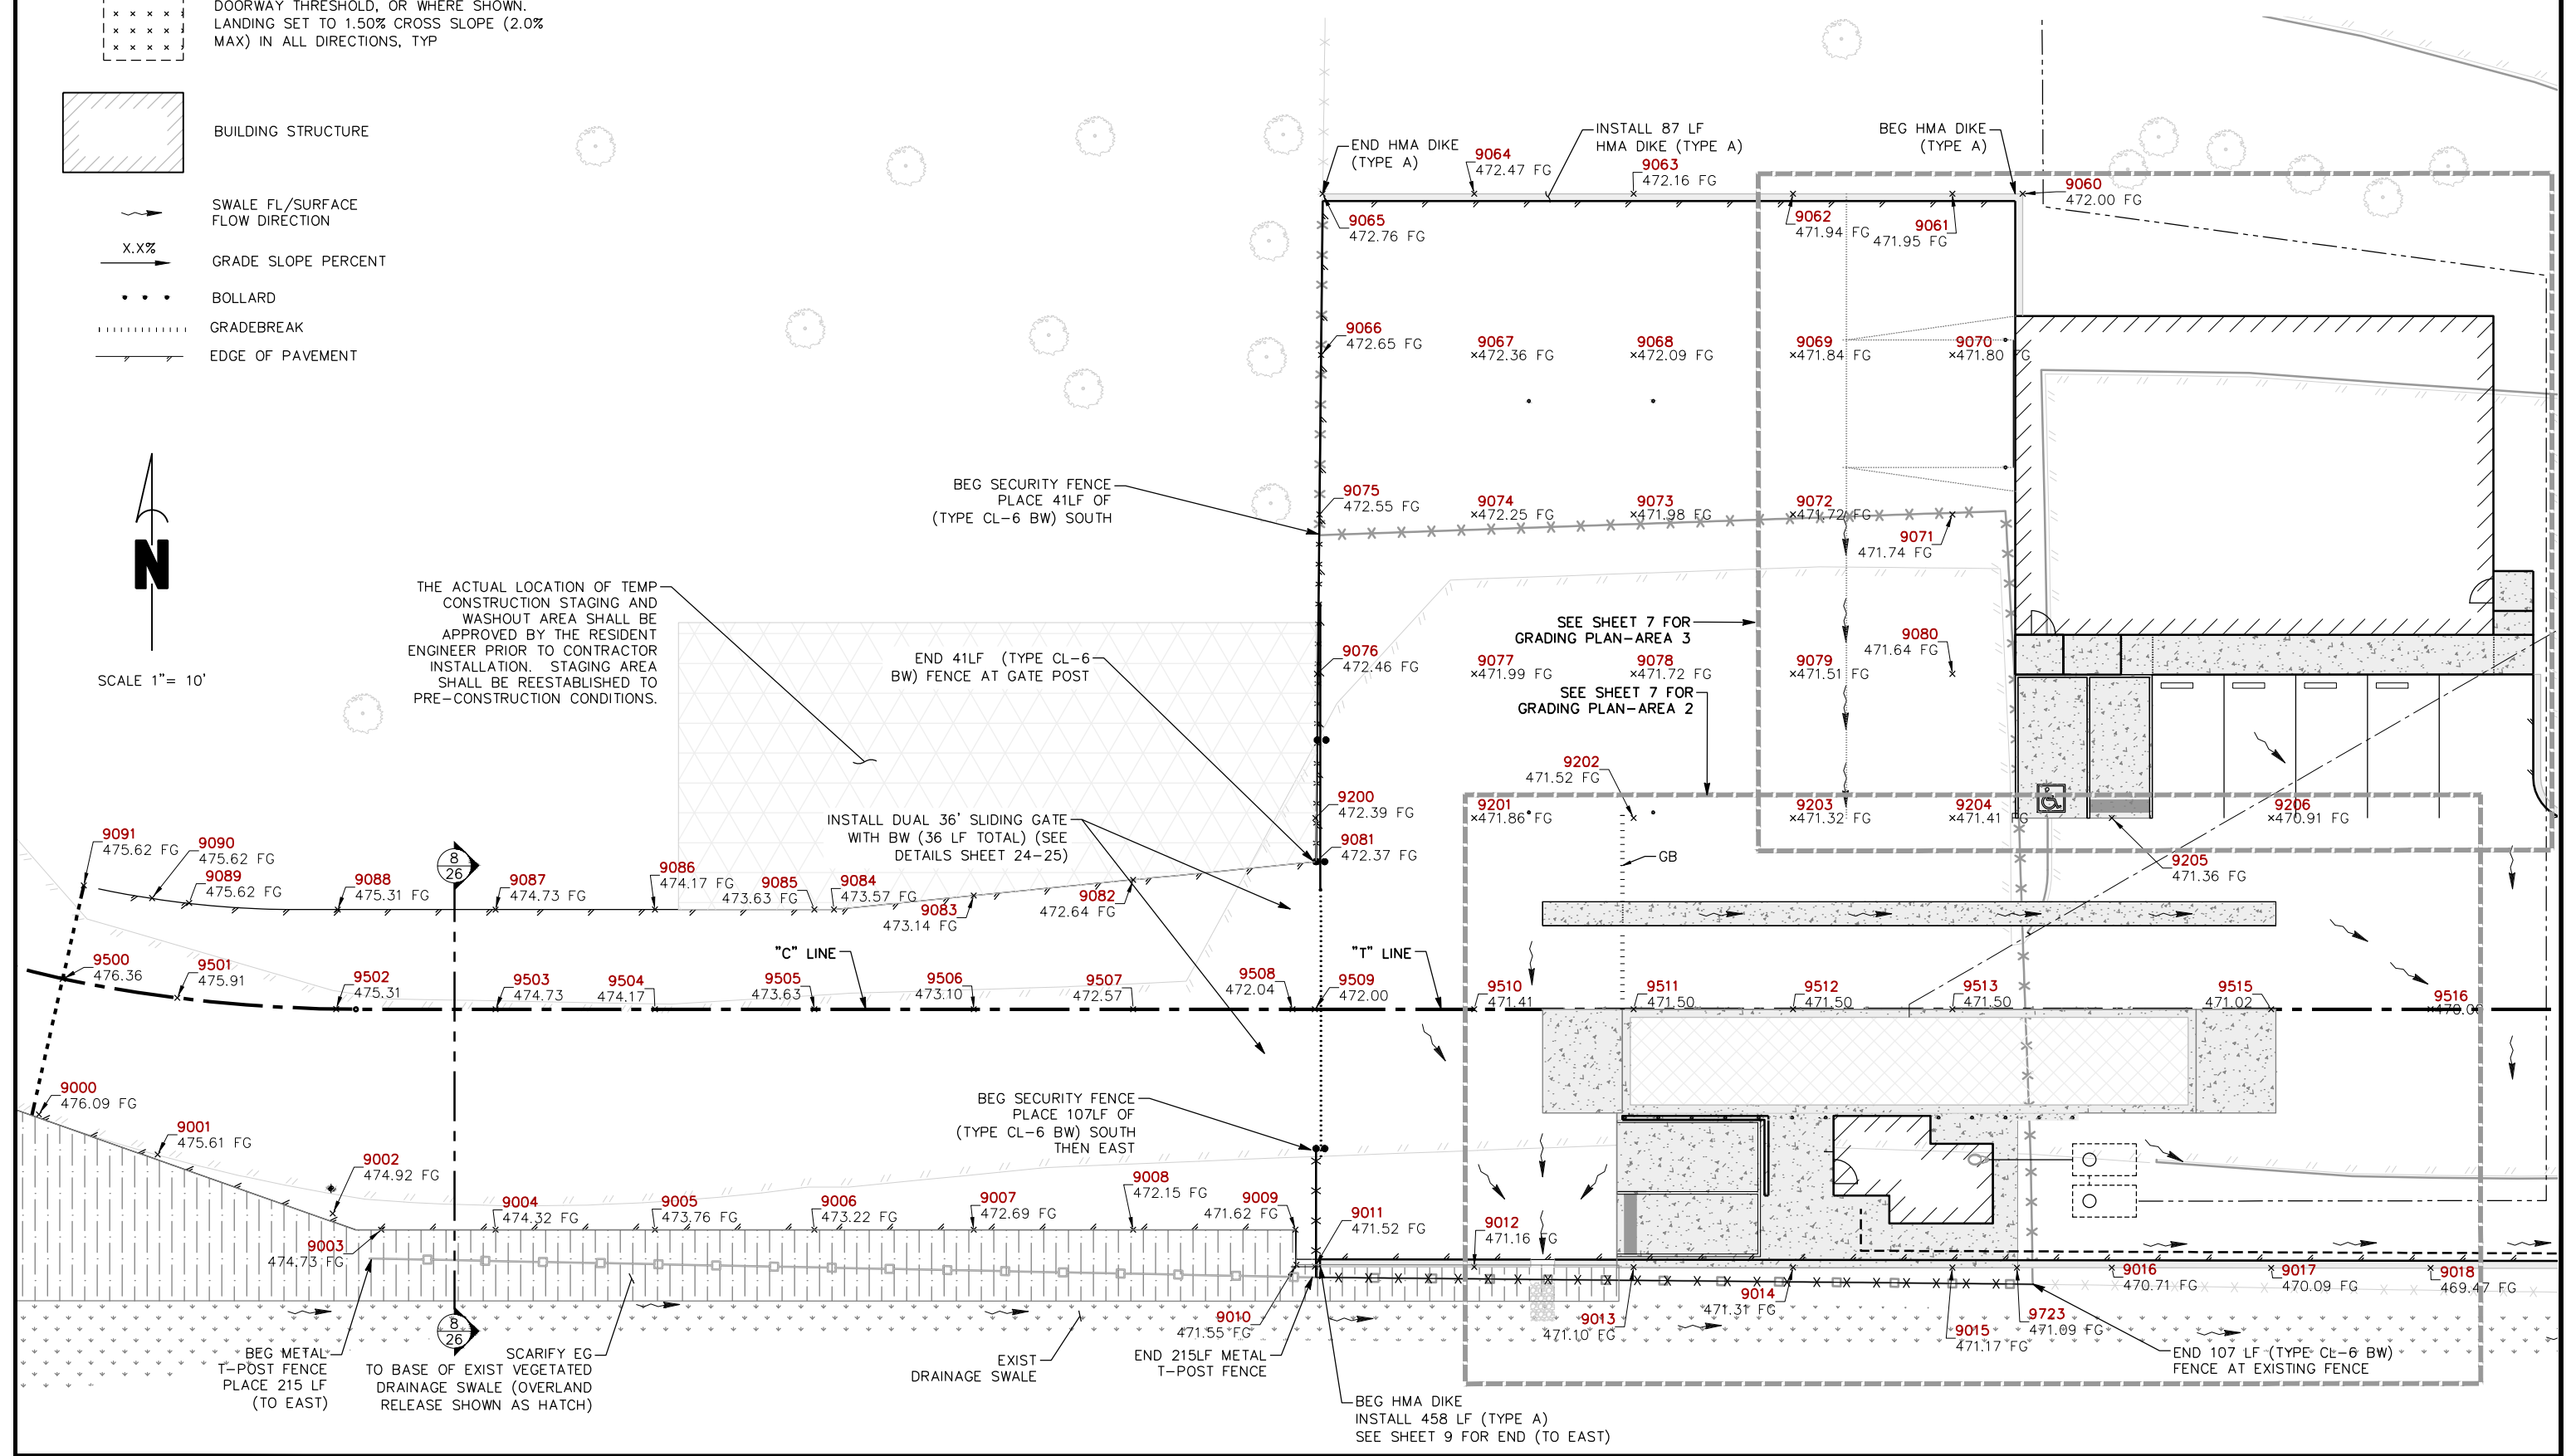




ROAD NAME: CONSERVATION CAMP RD		HUMCO		COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS		SHEET 7 OF 58
BAR IS ONE INCH ON ORIGINAL DRAWING	ROAD NO:	MILE POST:	DESIGNED BY: ENGR	REDWAY TRANSFER STATION		
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY	PROJECT NO: 438005		DRAWN BY: PBS	GRADING PLAN-AREA 2		
	DRAWING FILE NAME: RTS_CONSTRUCTION DETAILS		REVIEWED BY: JAB			
	PLOT DATE: 08/19/25		APPROVED BY: TRS			

LEGEND:

- HMA SECTION LIMITS
- PCC SECTION LIMITS
- LIMITS OF 4'x4' (MIN) CLEAR WIDTH AT ADA DOORWAY THRESHOLD, OR WHERE SHOWN. LANDING SET TO 1.50% CROSS SLOPE (2.0% MAX) IN ALL DIRECTIONS, TYP
- BUILDING STRUCTURE
- SWALE FL/SURFACE FLOW DIRECTION
- X.X% GRADE SLOPE PERCENT
- BOLLARD
- GRADE BREAK
- EDGE OF PAVEMENT

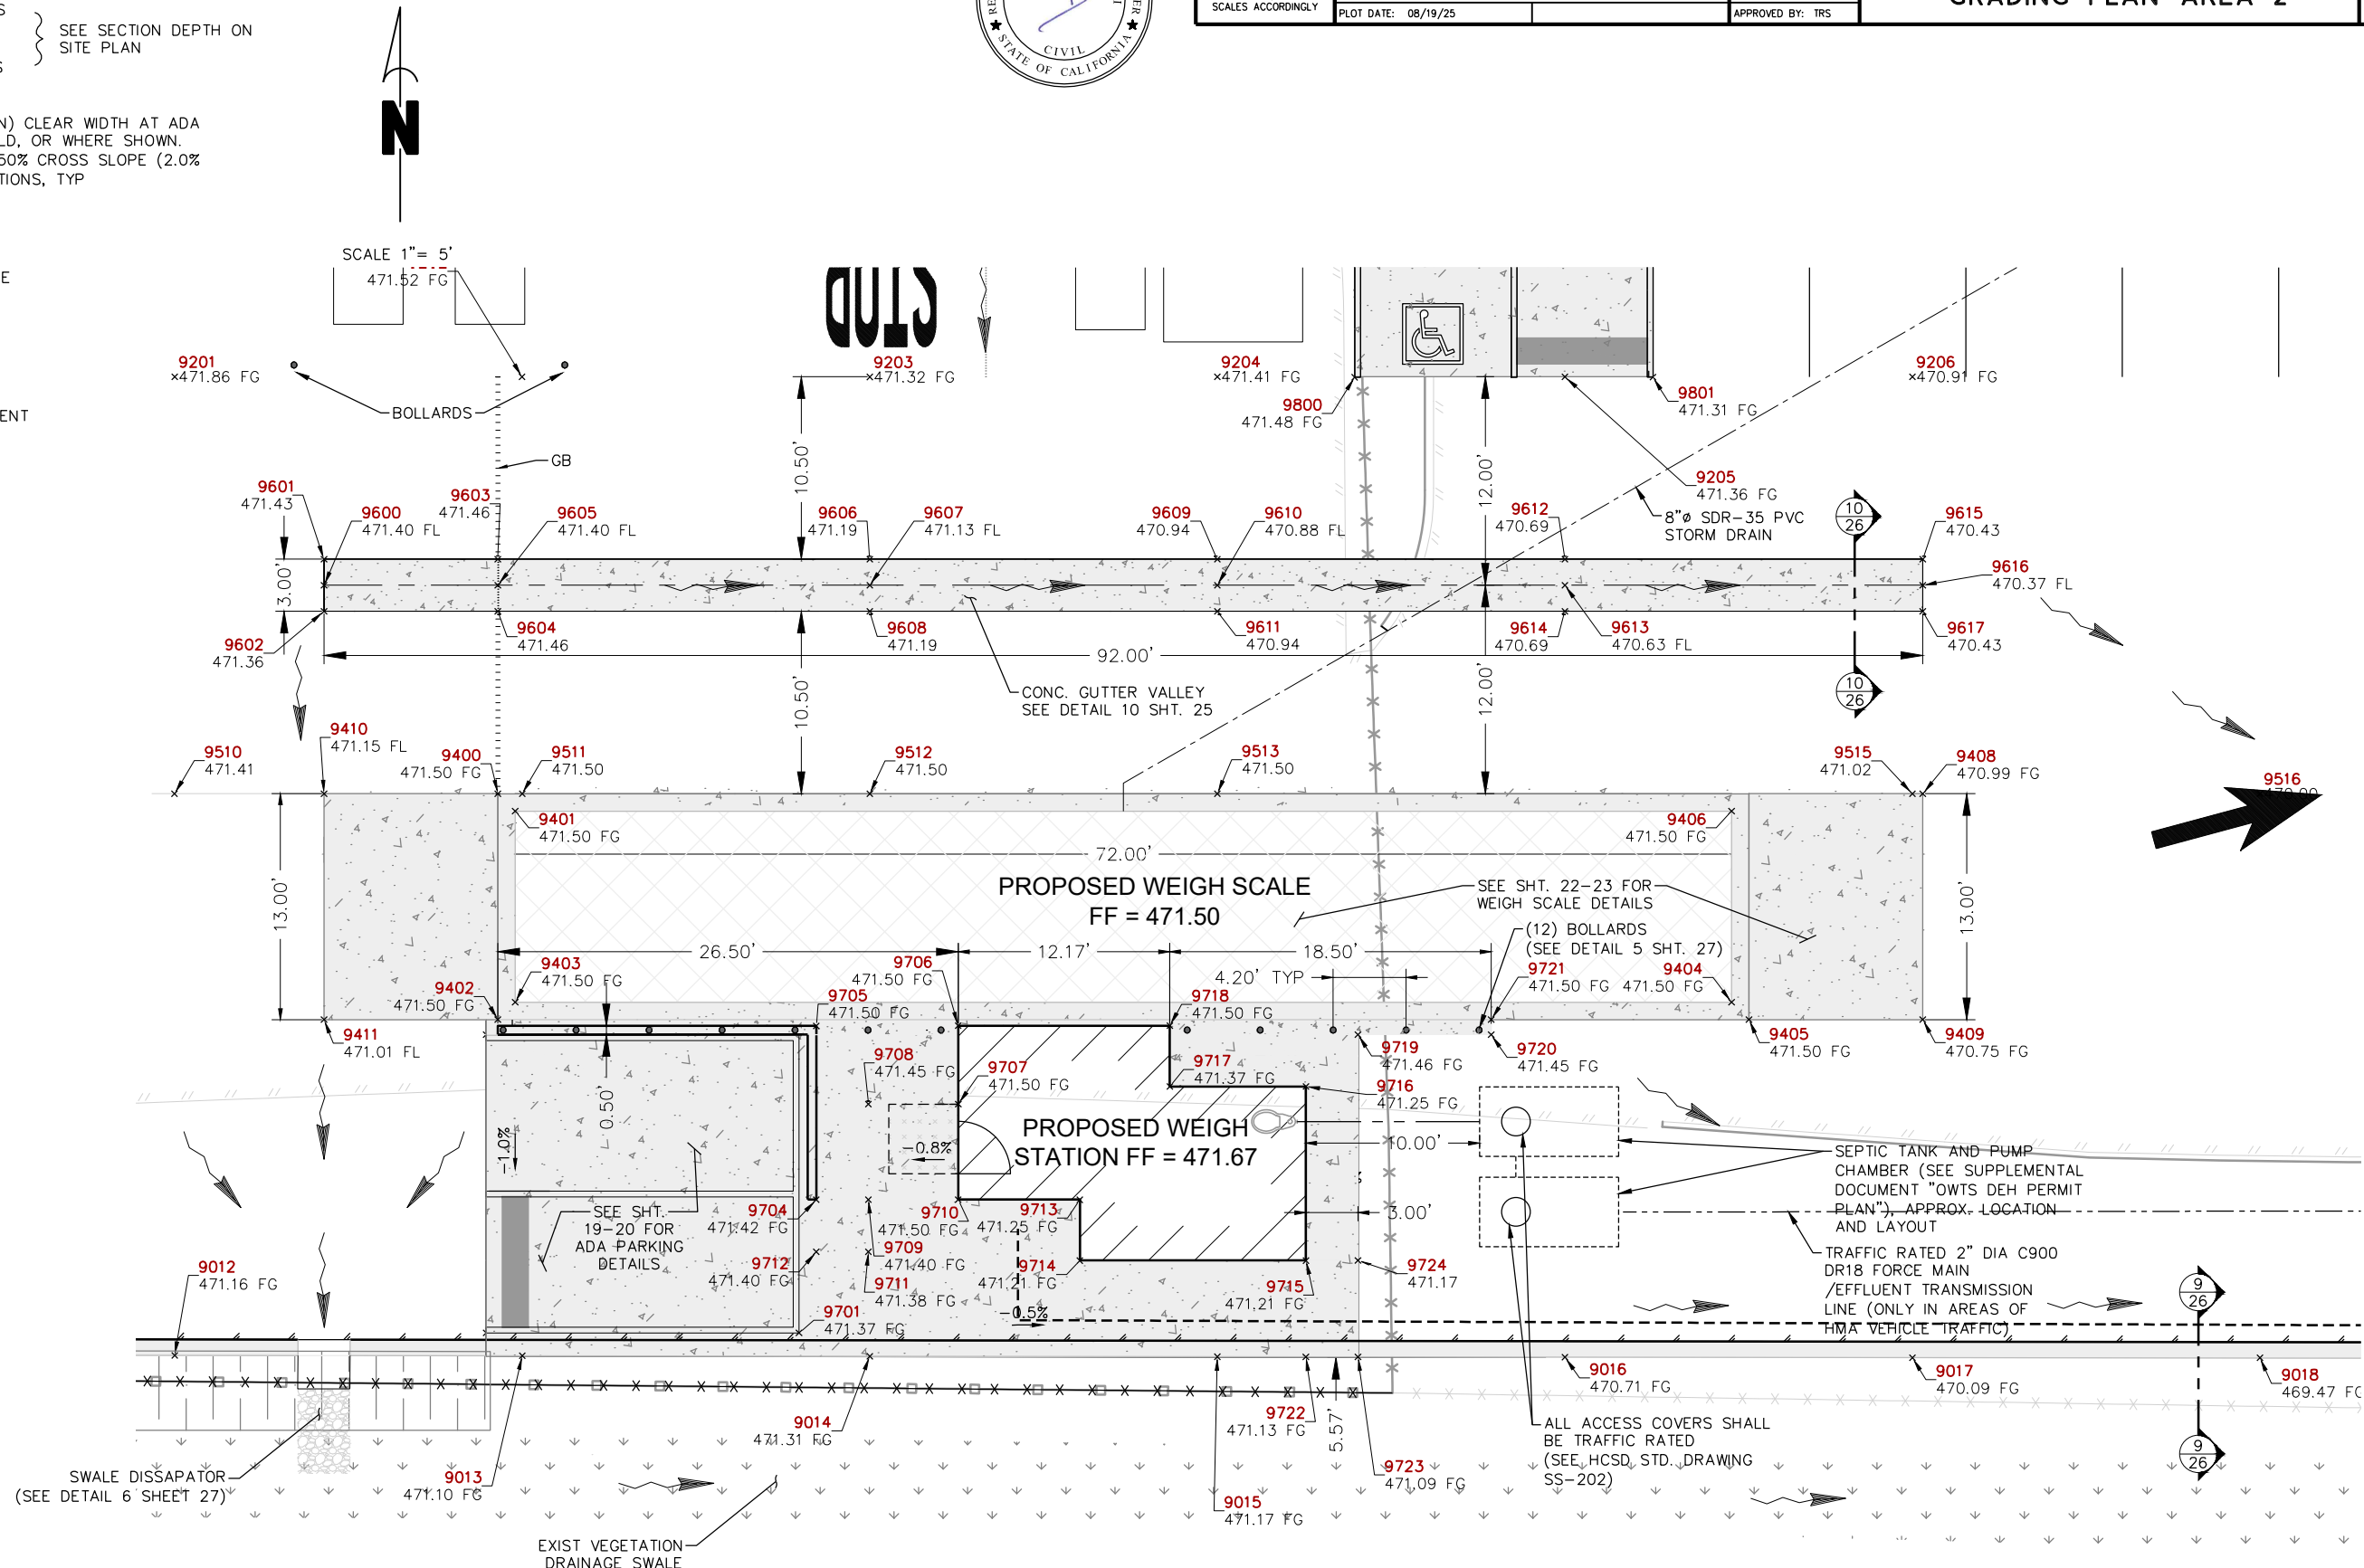




ROAD NAME: CONSERVATION CAMP RD		HUMCO		COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS		SHEET 8 OF 58
PROJECT NO: 438005		DESIGNED BY: ENGR		REDWAY TRANSFER STATION		
DRAWING FILE NAME: RTS_CONSTRUCTION DETAILS		DRAWN BY: PBS		GRADING PLAN-AREA 3		
PLOT DATE: 08/19/25		REVIEWED BY: JAB				
IF NOT ONE INCH ON ORIGINAL DRAWING		APPROVED BY: TRS				
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY						

- LEGEND:**
- HMA SECTION LIMITS
 - PCC SECTION LIMITS
 - LIMITS OF 4'x4' (MIN) CLEAR WIDTH AT ADA DOORWAY THRESHOLD, OR WHERE SHOWN. LANDING SET TO 1.50% CROSS SLOPE (2.0% MAX) IN ALL DIRECTIONS, TYP
 - BUILDING STRUCTURE
 - SWALE FL/SURFACE FLOW DIRECTION
 - X.X% GRADE SLOPE PERCENT
 - BOLLARD
 - GRADEBREAK
 - EDGE OF PAVEMENT
- SEE SECTION DEPTH ON SITE PLAN




SCALE 1" = 5'


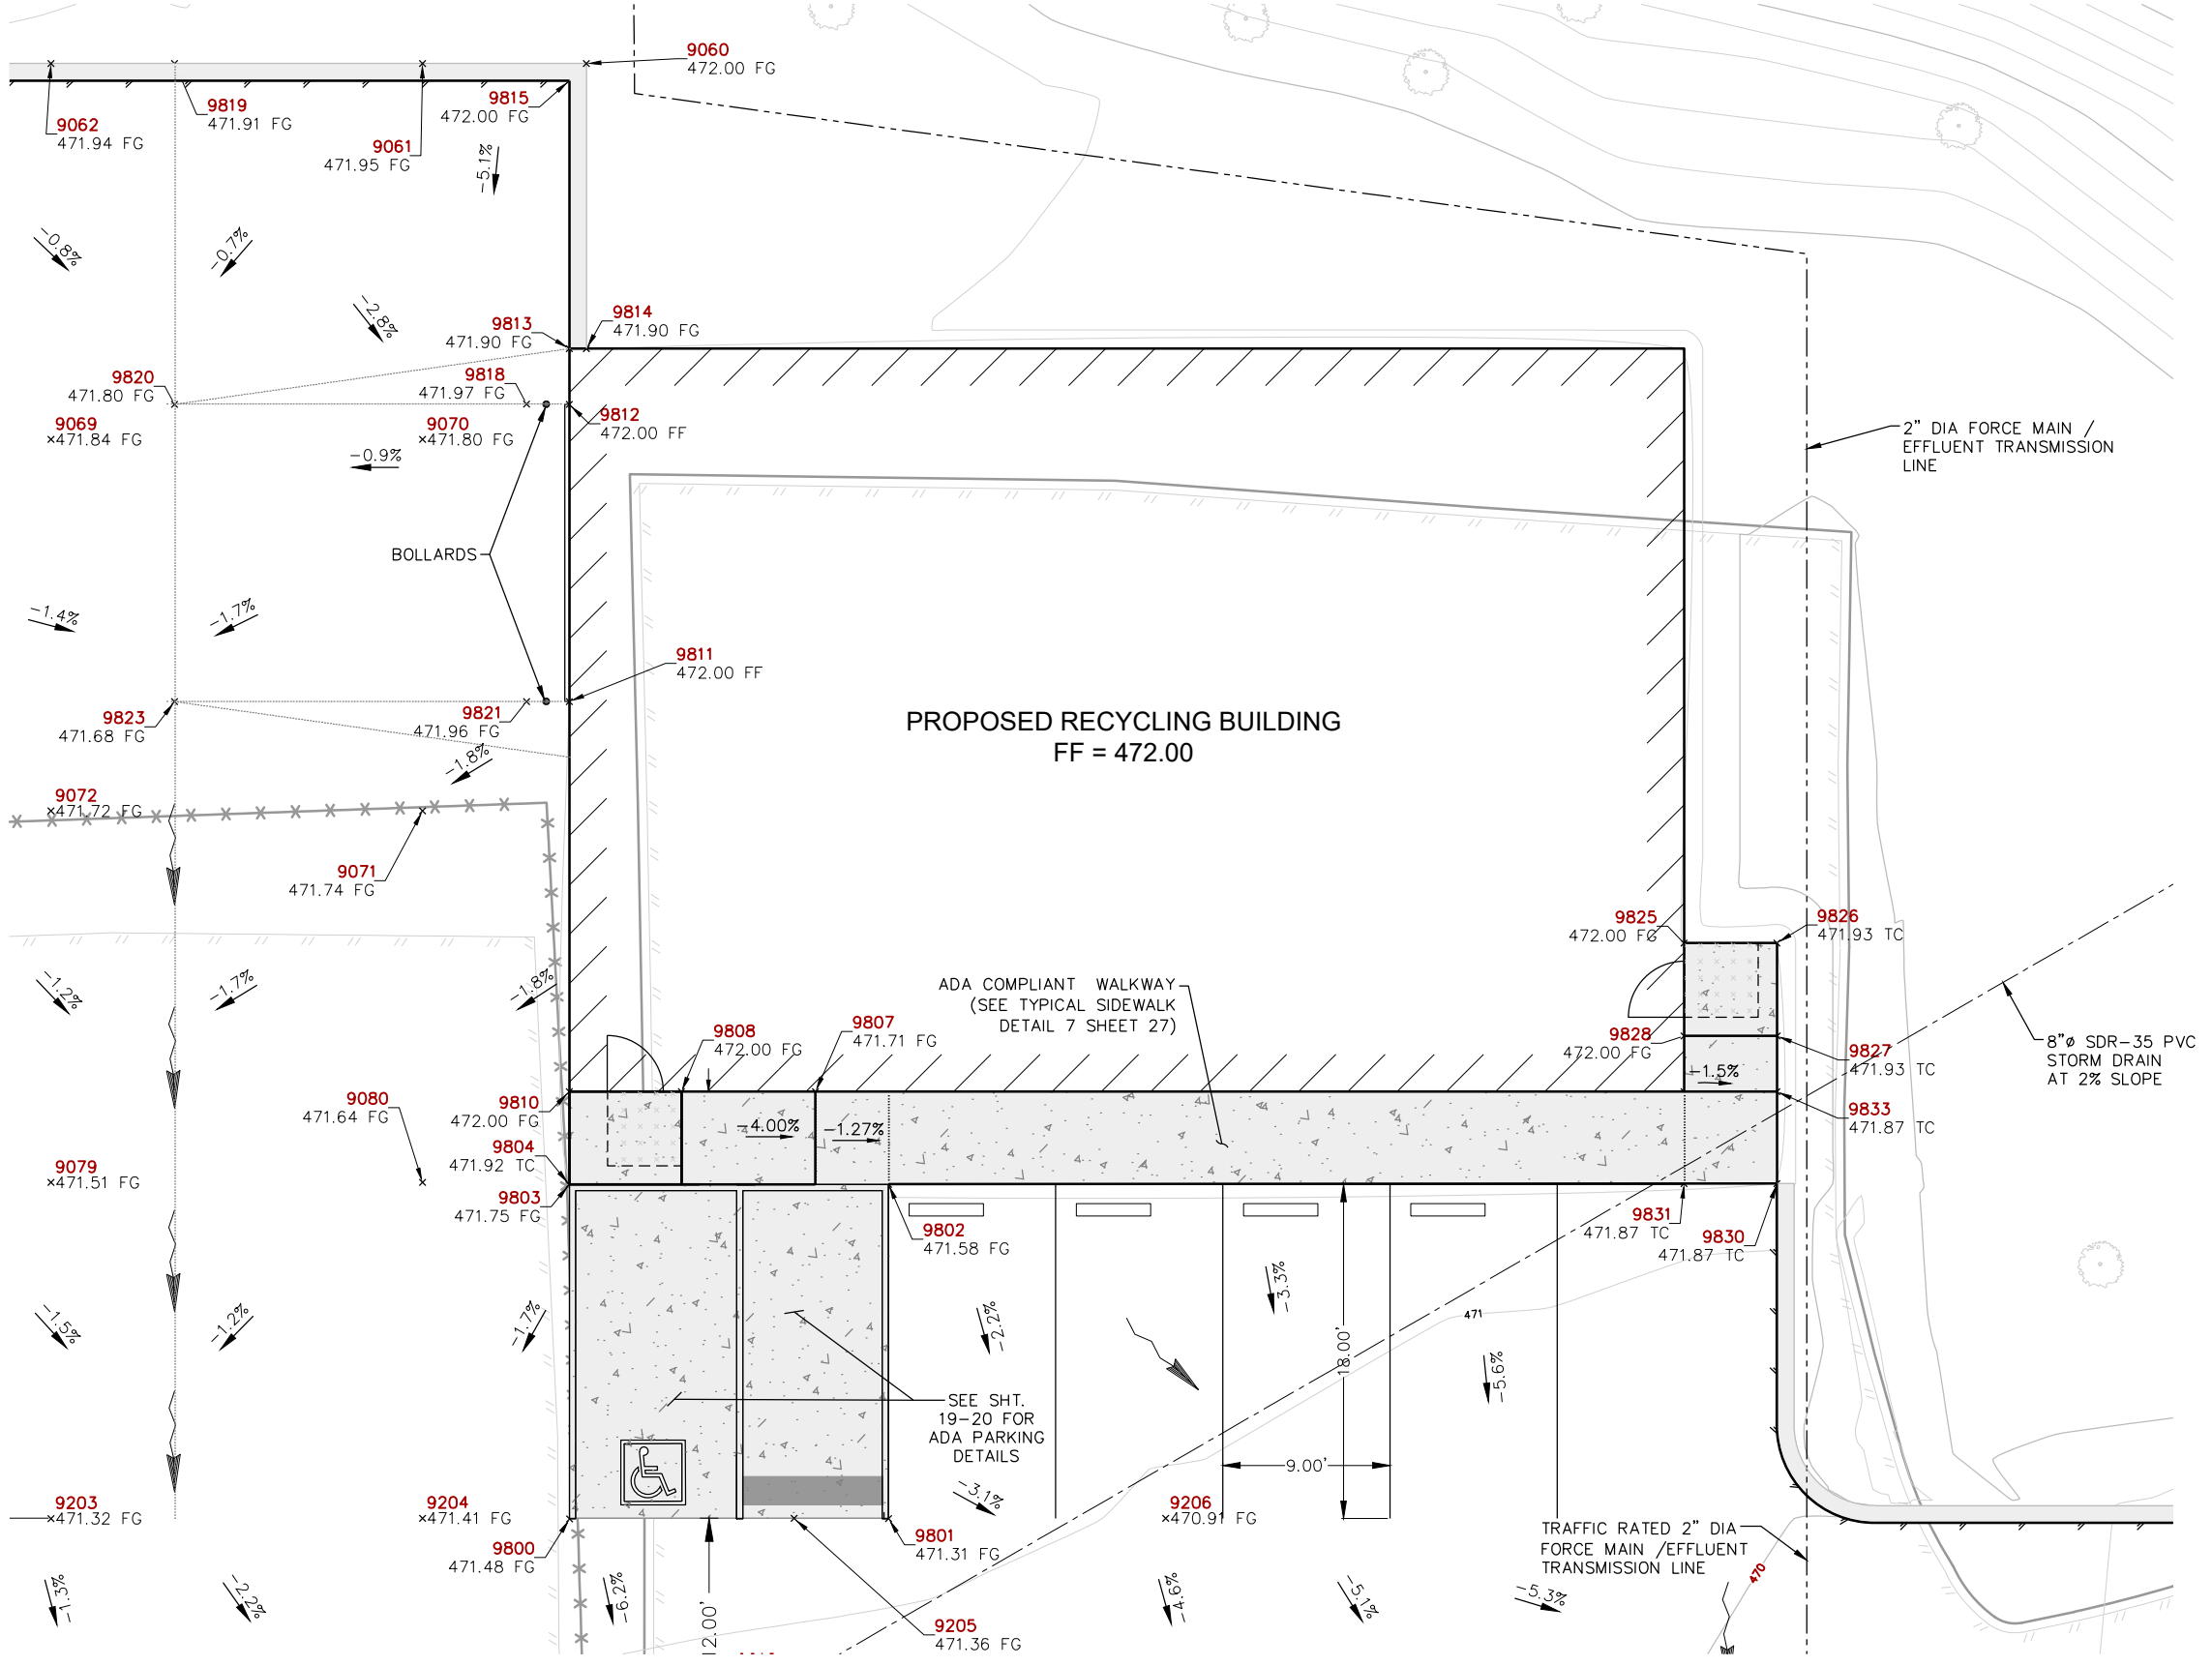




N



PROPOSED RECYCLING BUILDING GRADING DETAILS

LEGEND:


-  HMA SECTION LIMITS
-  PCC SECTION LIMITS
-  LIMITS OF 4'x4' (MIN) CLEAR WIDTH AT ADA DOORWAY THRESHOLD, OR WHERE SHOWN. LANDING SET TO 1.50% CROSS SLOPE (2.0% MAX) IN ALL DIRECTIONS, TYP

-  BUILDING STRUCTURE
-  SWALE FL/SURFACE FLOW DIRECTION
-  GRADE SLOPE PERCENT
-  BOLLARD
-  GRADEBREAK
-  EDGE OF PAVEMENT

SCALE 1" = 10'



ROAD NAME: CONSERVATION CAMP RD		HUMCO		COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS	SHEET 9 OF 58
ROAD NO:	MILE POST:	DESIGNED BY: ENGR			
PROJECT NO: 438005		DRAWN BY: PBS		GRADING PLAN-AREA 4	
DRAWING FILE NAME: RTS_CONSTRUCTION DETAILS		REVIEWED BY: JAB			
PLOT DATE: 08/19/25		APPROVED BY: TRS			

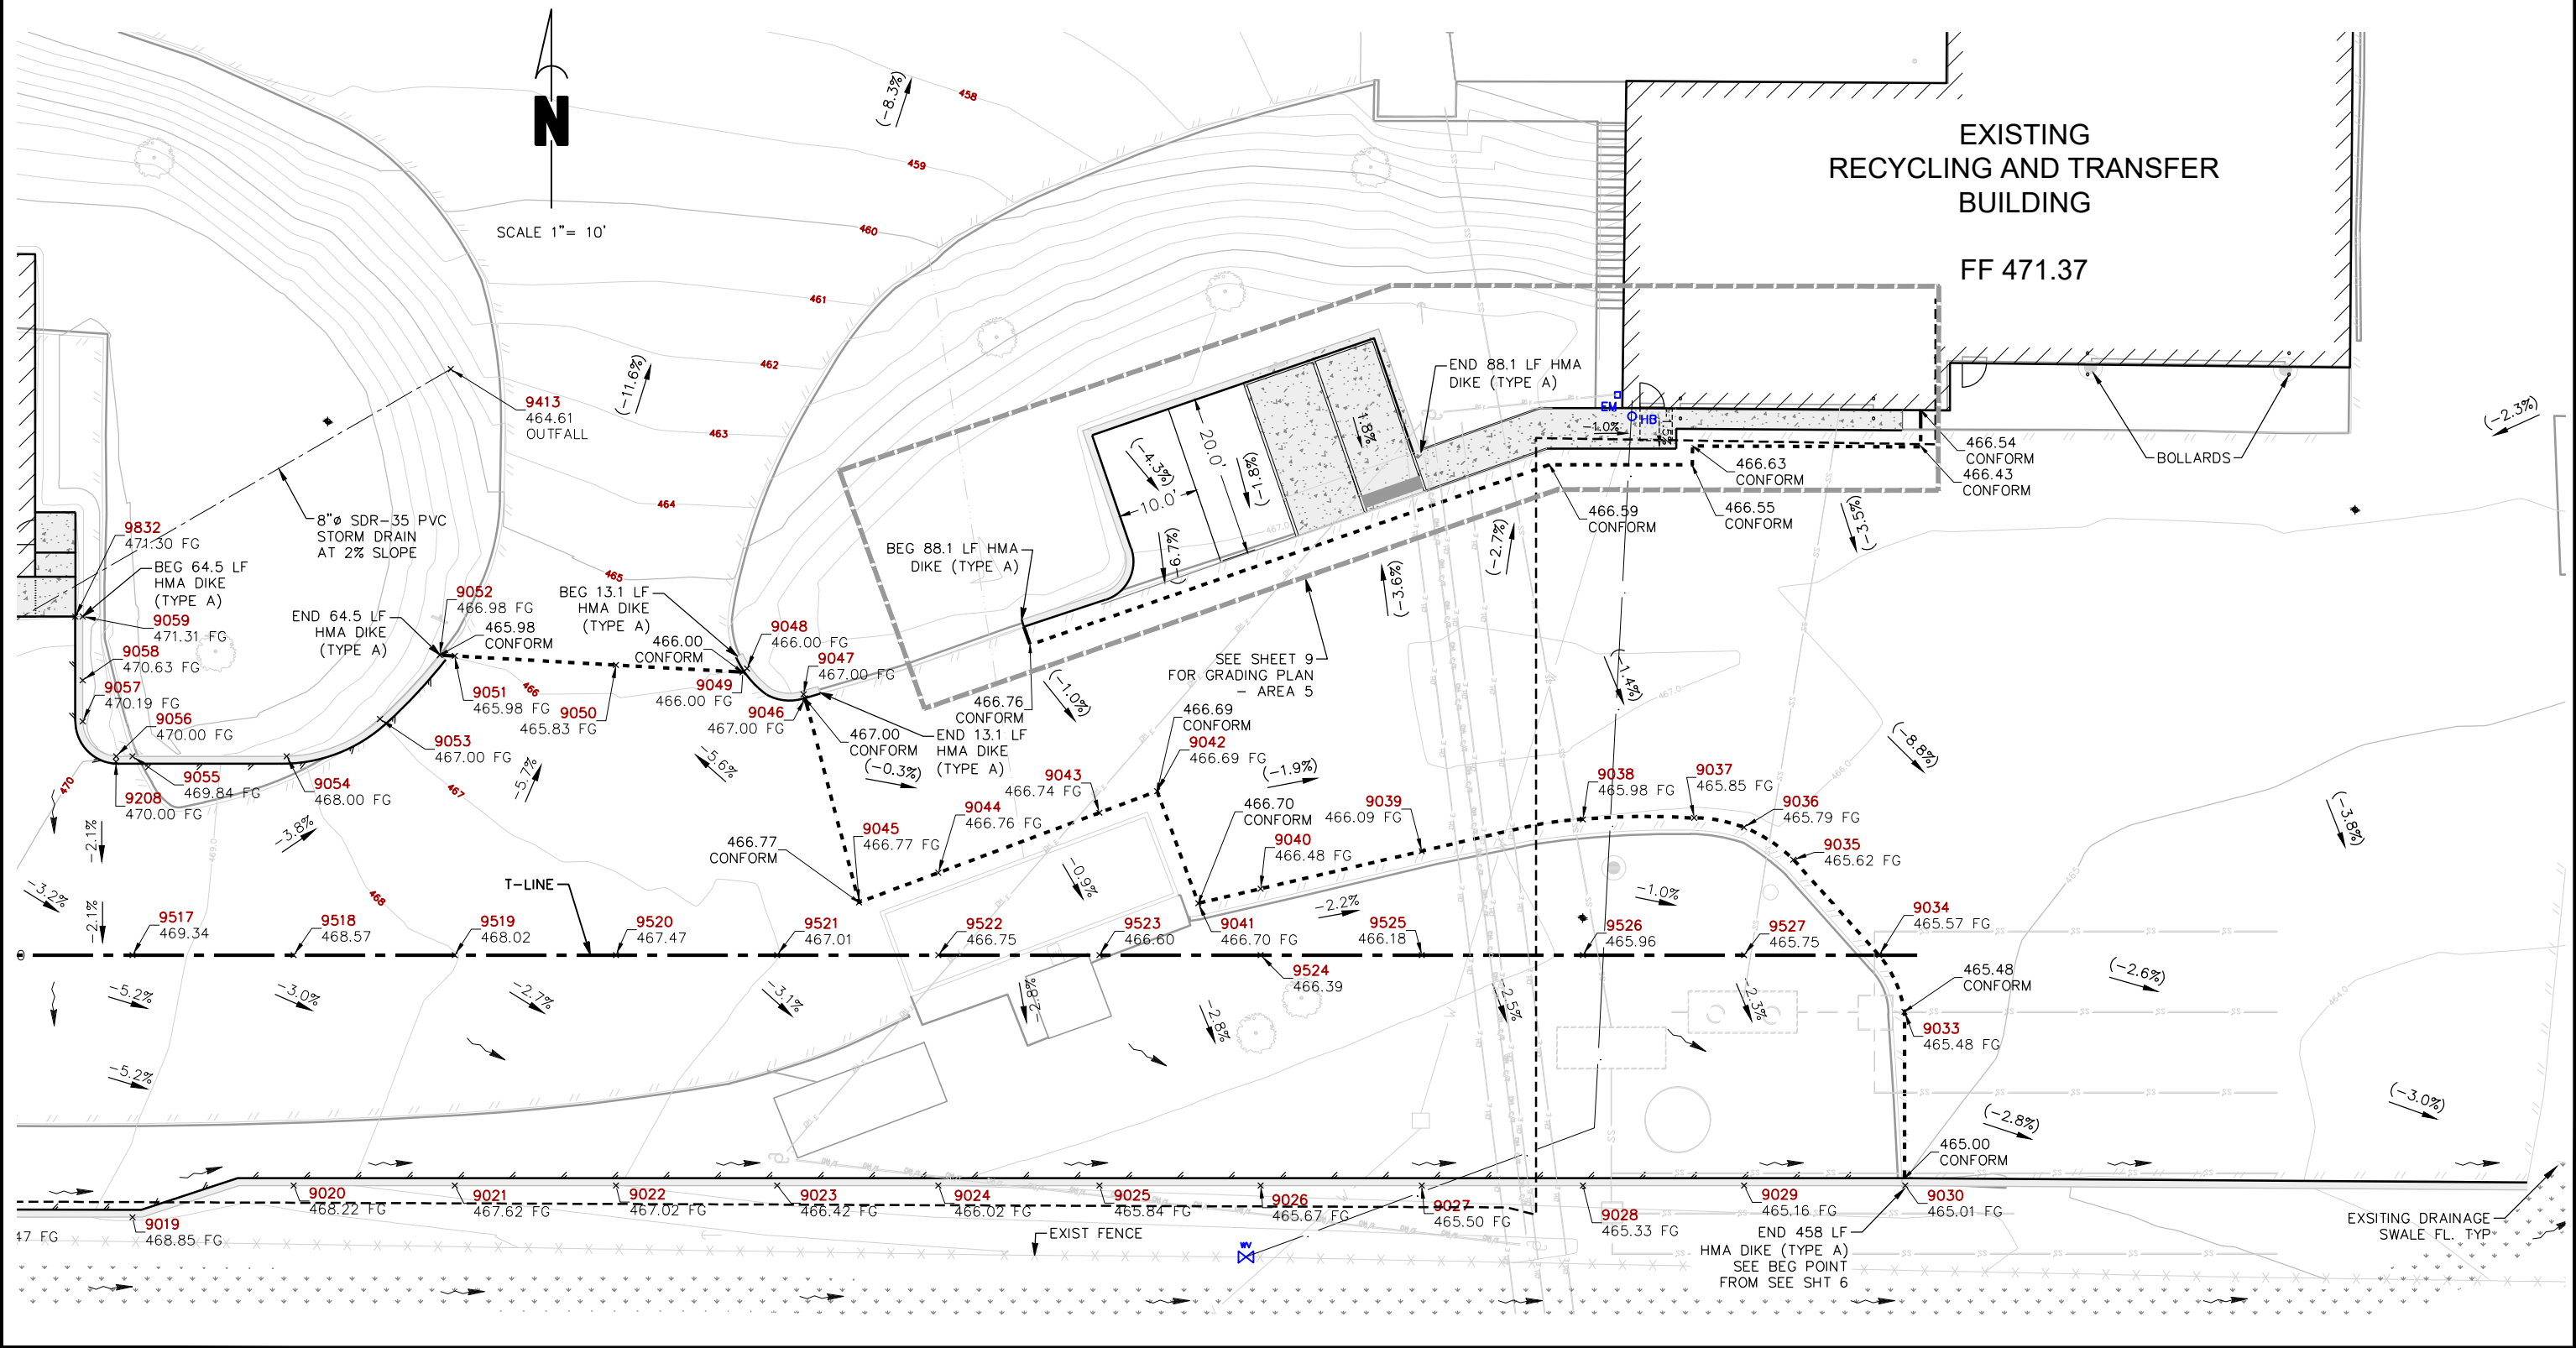




ROAD NAME: CONSERVATION CAMP RD		HUMCO		COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS		SHEET 10 OF 58
BAR IS ONE INCH ON ORIGINAL DRAWING	ROAD NO:	MILE POST:	DESIGNED BY: ENGR	REDWAY TRANSFER STATION		
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY	PROJECT NO: 438005		DRAWN BY: PBS	GRADING PLAN-AREA 5		
	DRAWING FILE NAME: RTS_CONSTRUCTION DETAILS		REVIEWED BY: JAB			
	PLOT DATE: 08/19/25		APPROVED BY: TRS			


LEGEND:

- HMA SECTION LIMITS
- PCC SECTION LIMITS
- LIMITS OF 4'x4' (MIN) CLEAR WIDTH AT ADA DOORWAY THRESHOLD, OR WHERE SHOWN. LANDING SET TO 1.50% CROSS SLOPE (2.0% MAX) IN ALL DIRECTIONS, TYP
- BUILDING STRUCTURE
- SWALE FL/SURFACE FLOW DIRECTION
- X.X% GRADE SLOPE PERCENT
- BOLLARD
- GRADEBREAK
- EDGE OF PAVEMENT

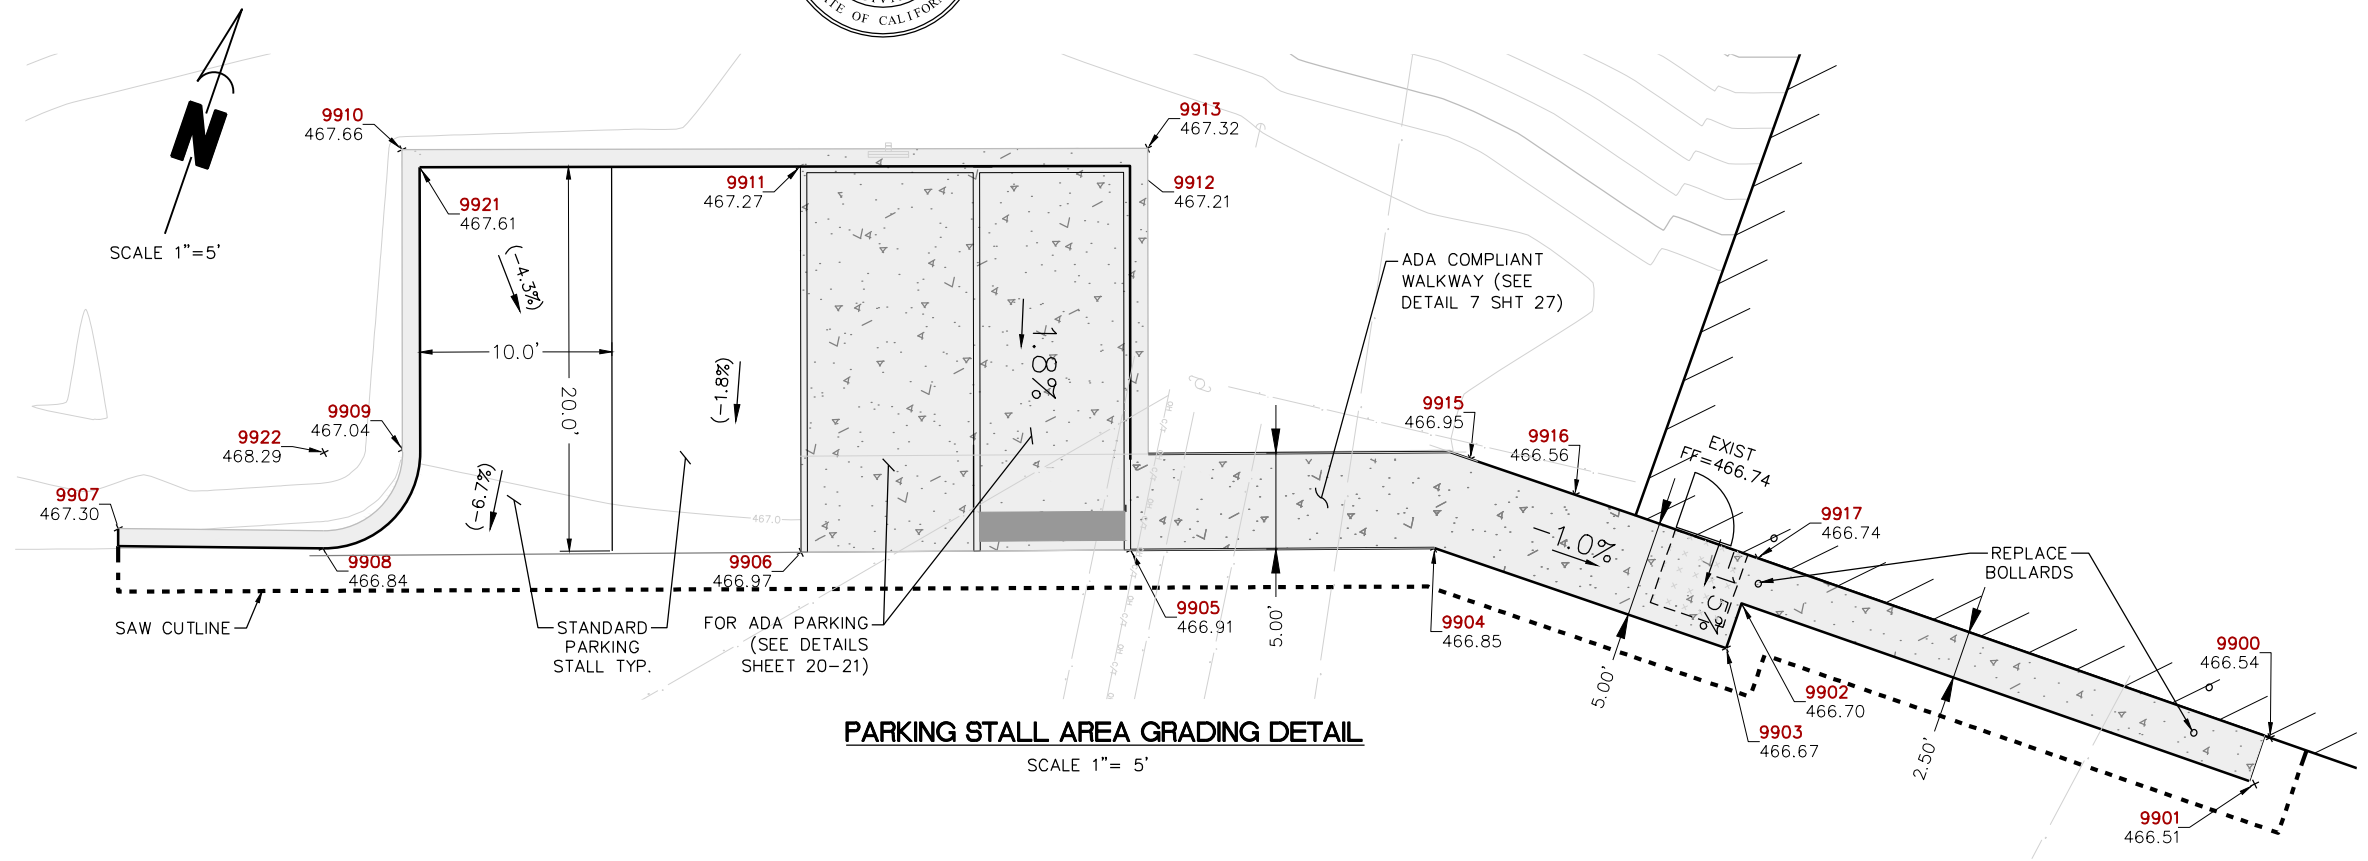

PARKING STALL AREA GRADING DETAIL
SCALE 1" = 5'

8"Ø SDR-35 PVC
STORM DRAIN
AT 2% SLOPE





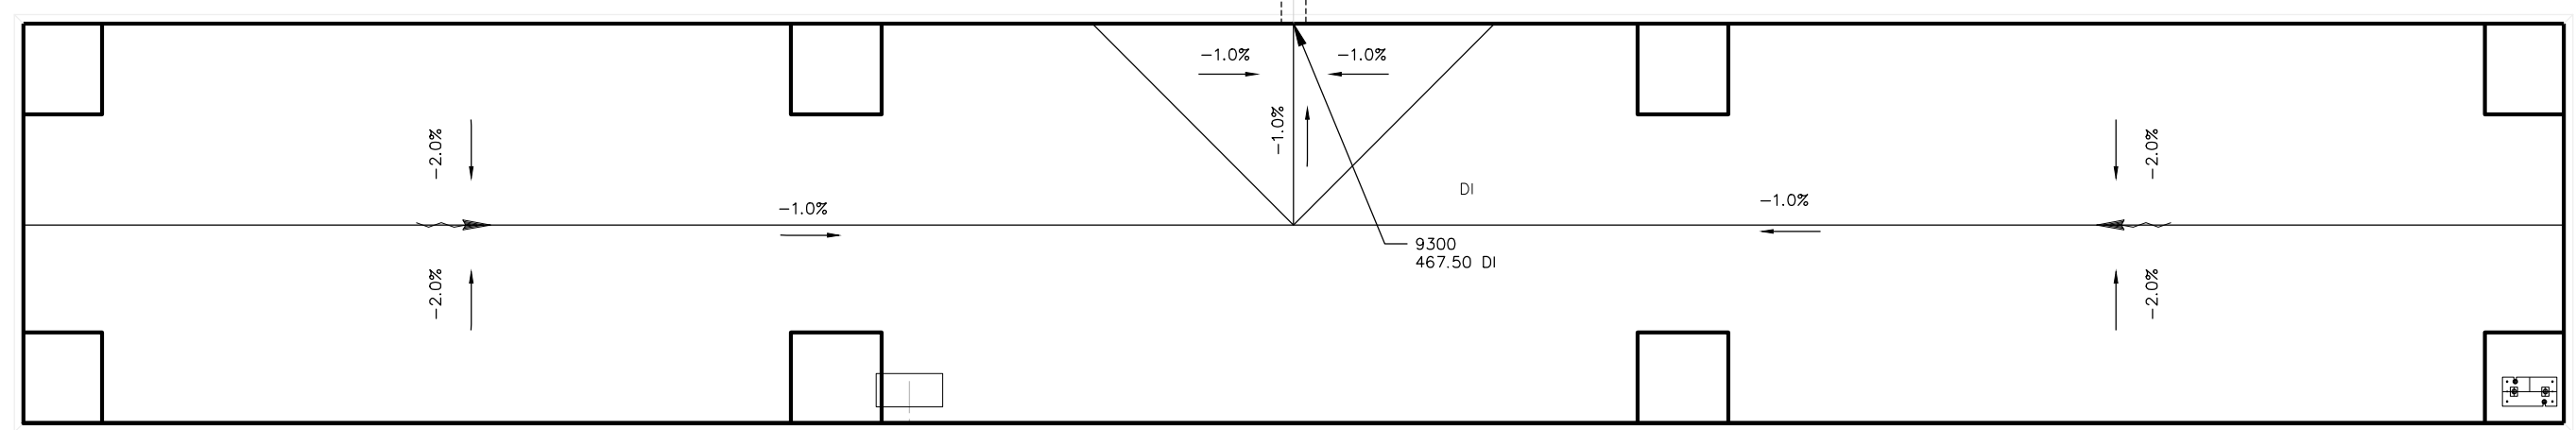


WEIGH SCALE DRAINAGE GRADES
NOT TO SCALE







BAR IS ONE INCH ON ORIGINAL DRAWING IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY	ROAD NAME: CONSERVATION CAMP RD	HUMCO	COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS
	ROAD NO:	MILE POST:	DESIGNED BY: ENGR
	PROJECT NO: 438005		DRAWN BY: PBS
	DRAWING FILE NAME:		REVIEWED BY: JAB
	PLOT DATE: 08/19/25	APPROVED BY: TRS	"C" LINE CONSERVATION CAMP ROAD SECTIONS

SHEET
11
OF
58

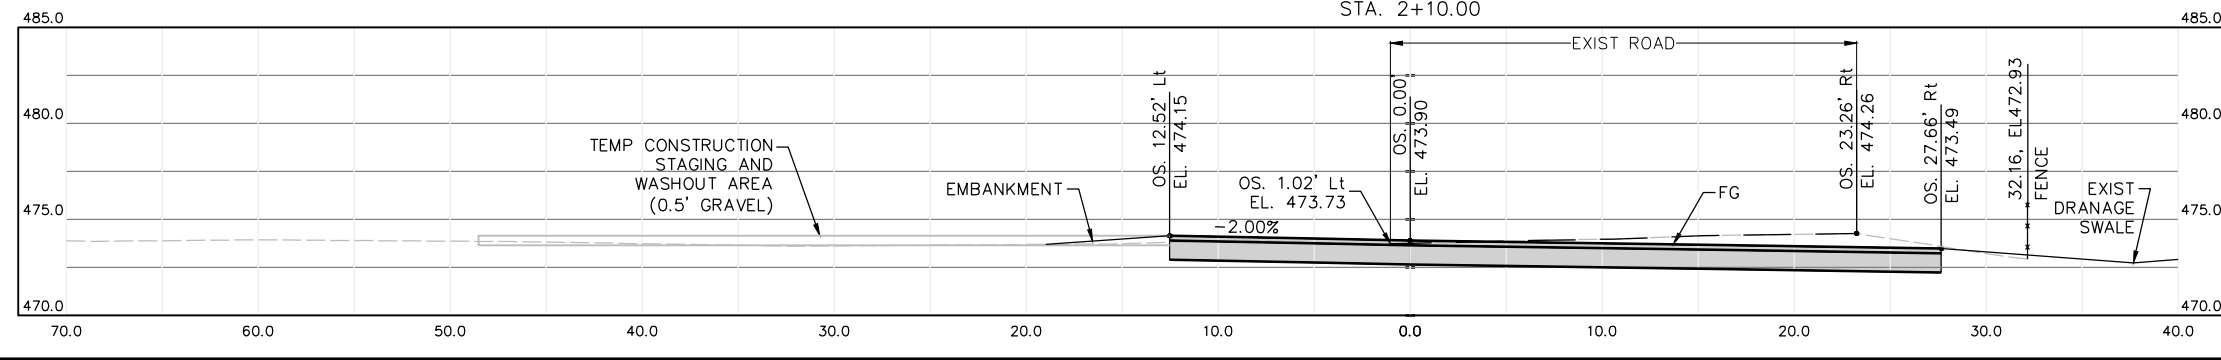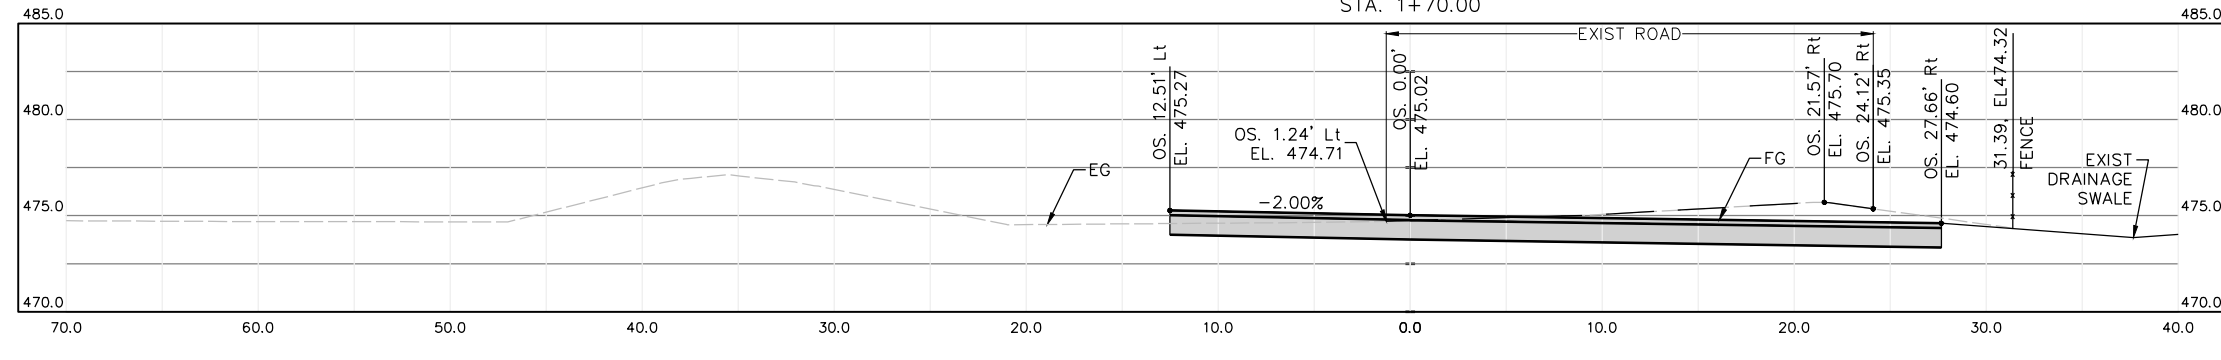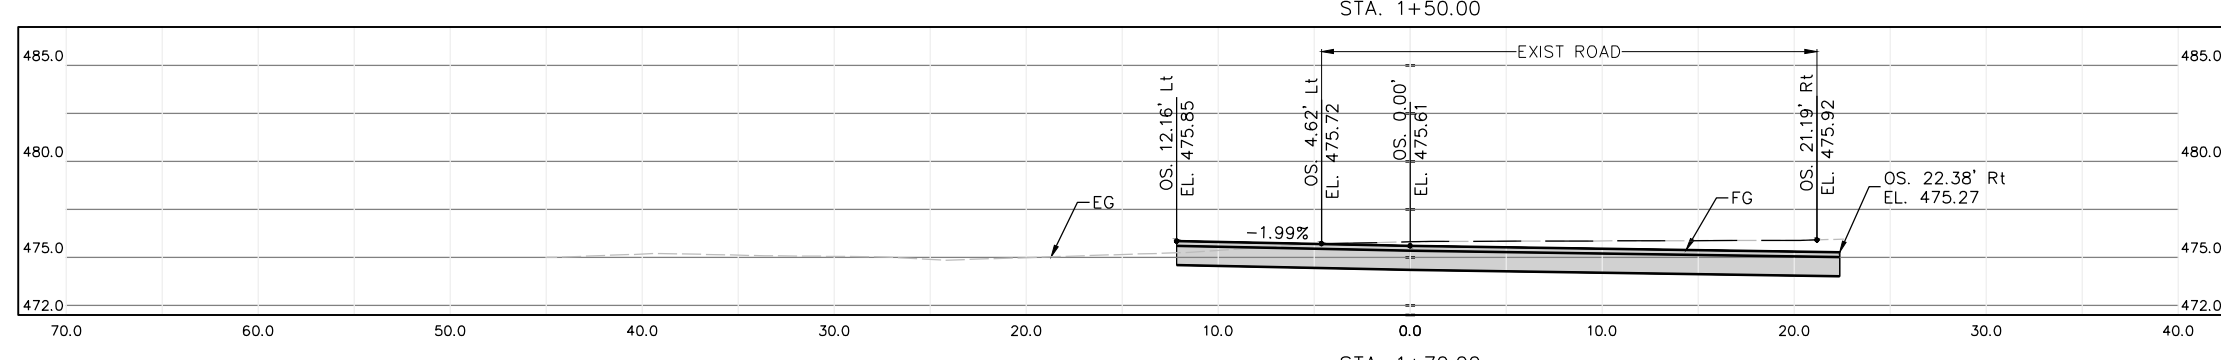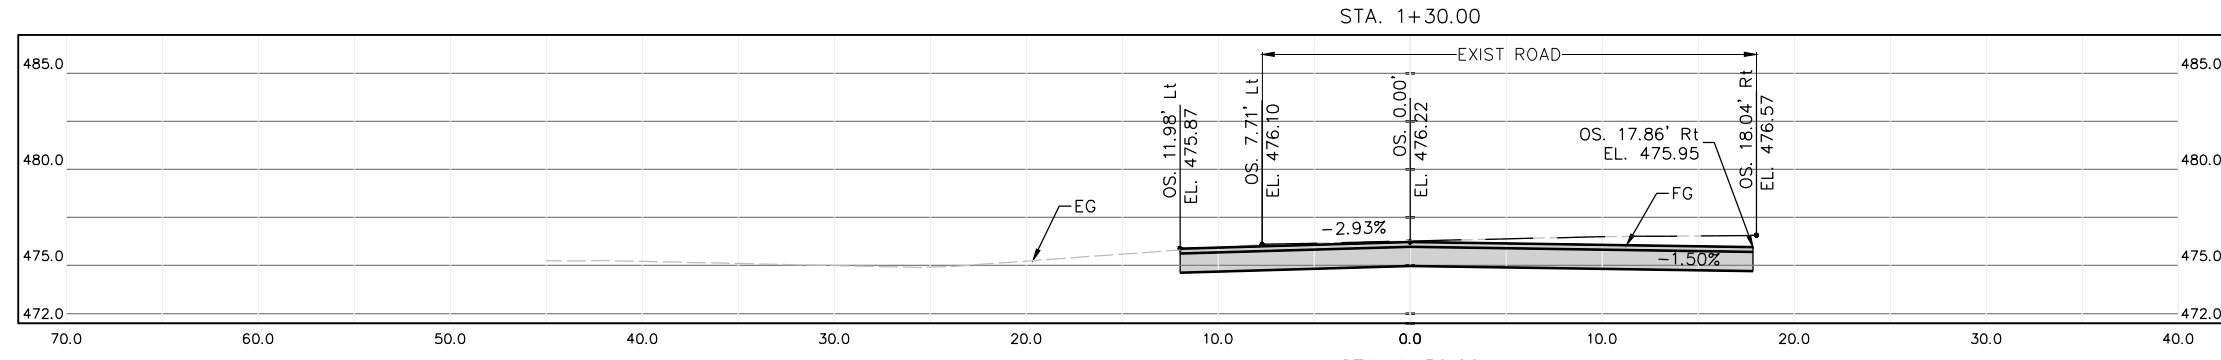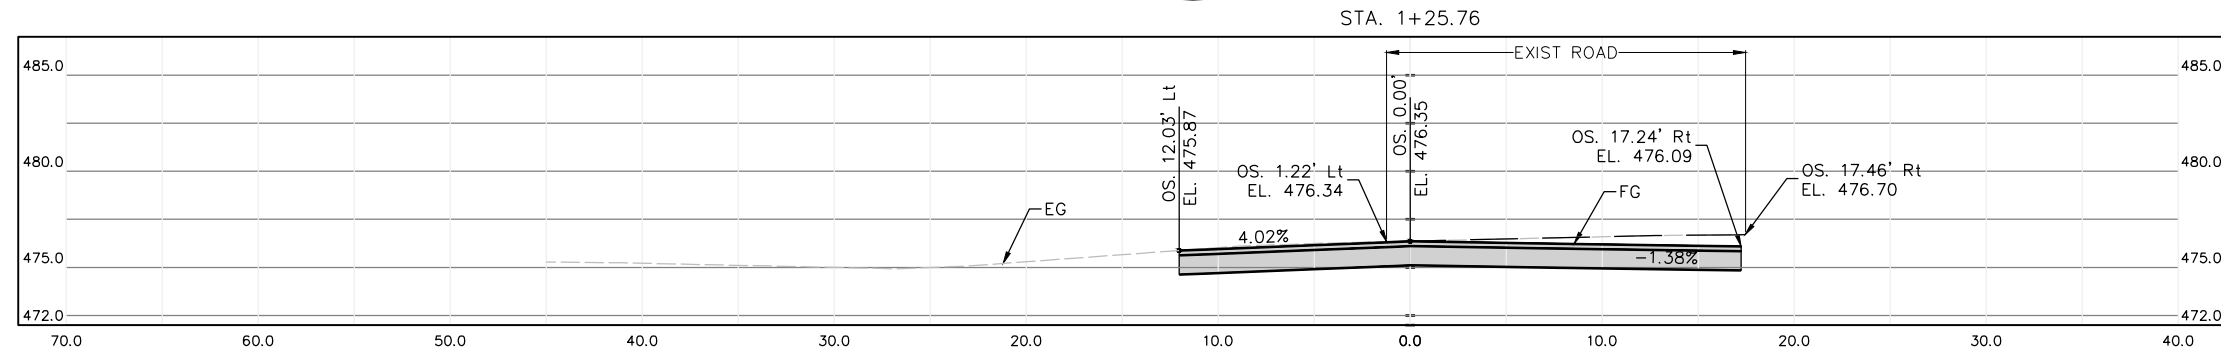







BAR IS ONE INCH ON ORIGINAL DRAWING IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY	ROAD NAME: CONSERVATION CAMP RD	HUMCO	COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS "T" LINE TRANSFER AREA SECTIONS	SHEET 12 OF 58
	PROJECT NO: 438005 DRAWING FILE NAME: PLOT DATE: 08/19/25	MILE POST: DESIGNED BY: ENGR DRAWN BY: PBS REVIEWED BY: JAB APPROVED BY: TRS		

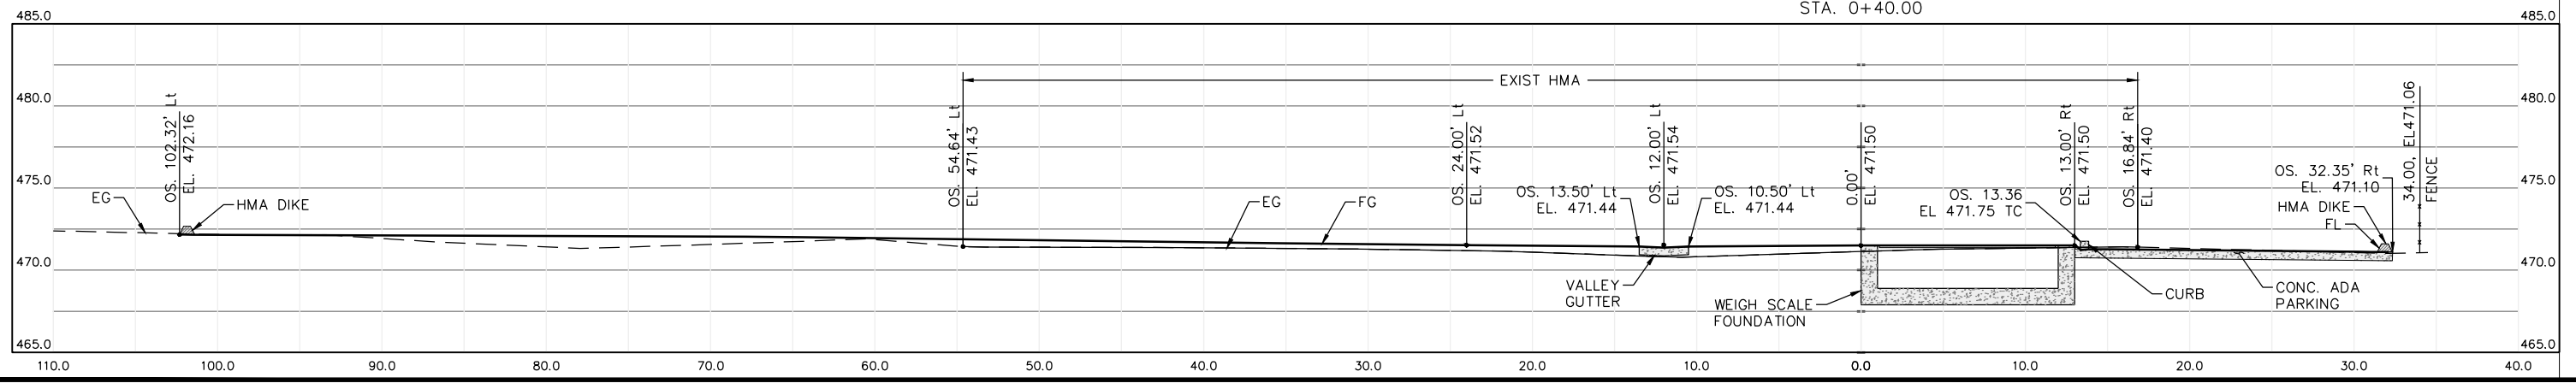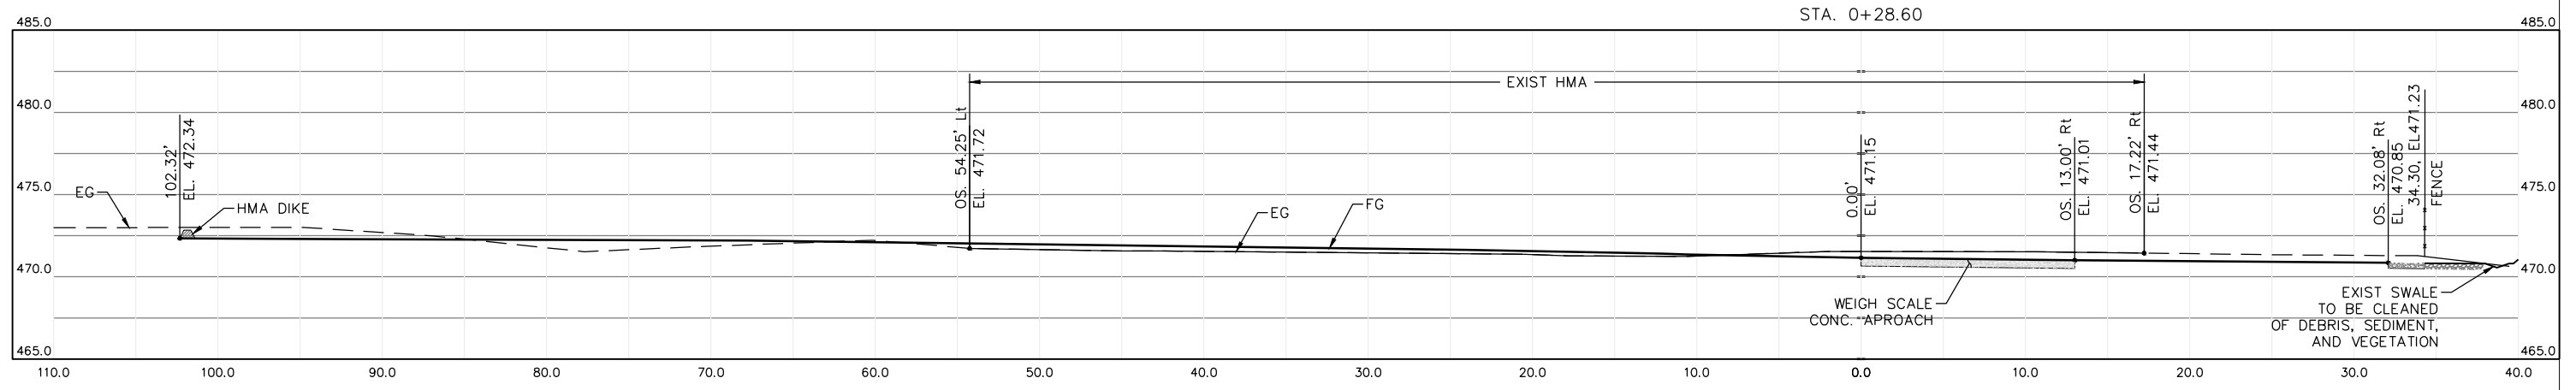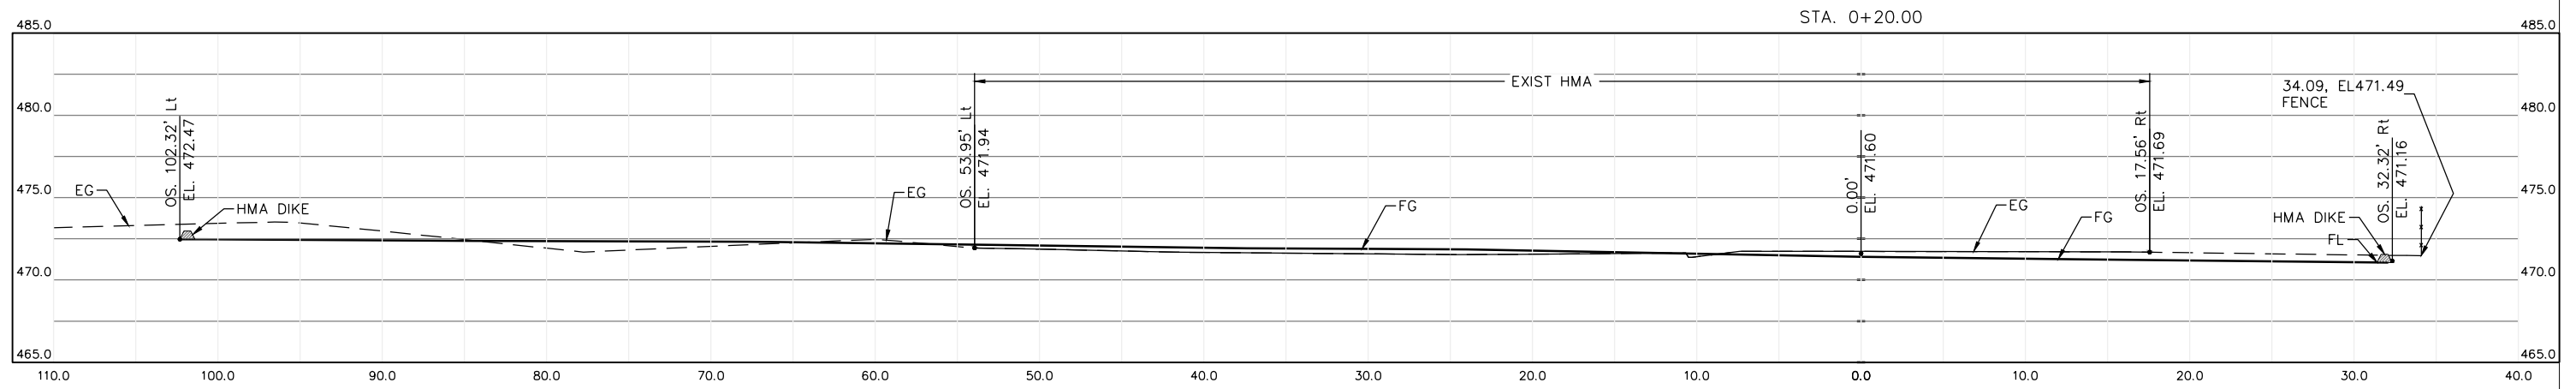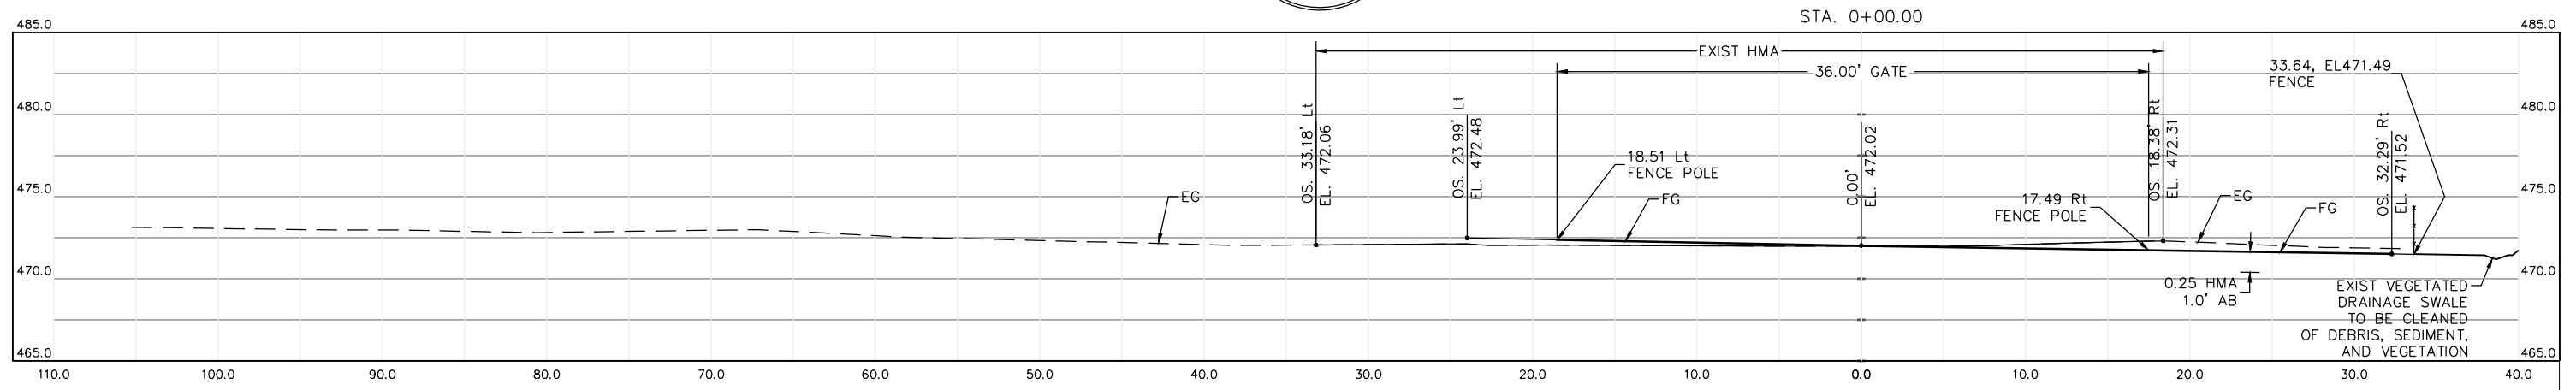







BAR IS ONE INCH ON ORIGINAL DRAWING IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY	ROAD NAME: CONSERVATION CAMP RD	HUMCO	COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS	SHEET 13 OF 58
	ROAD NO:	MILE POST:	DESIGNED BY: ENGR	
	PROJECT NO: 438005		DRAWN BY: PBS	
	DRAWING FILE NAME:		REVIEWED BY: JAB	
	PLOT DATE: 08/19/25		APPROVED BY: TRS	

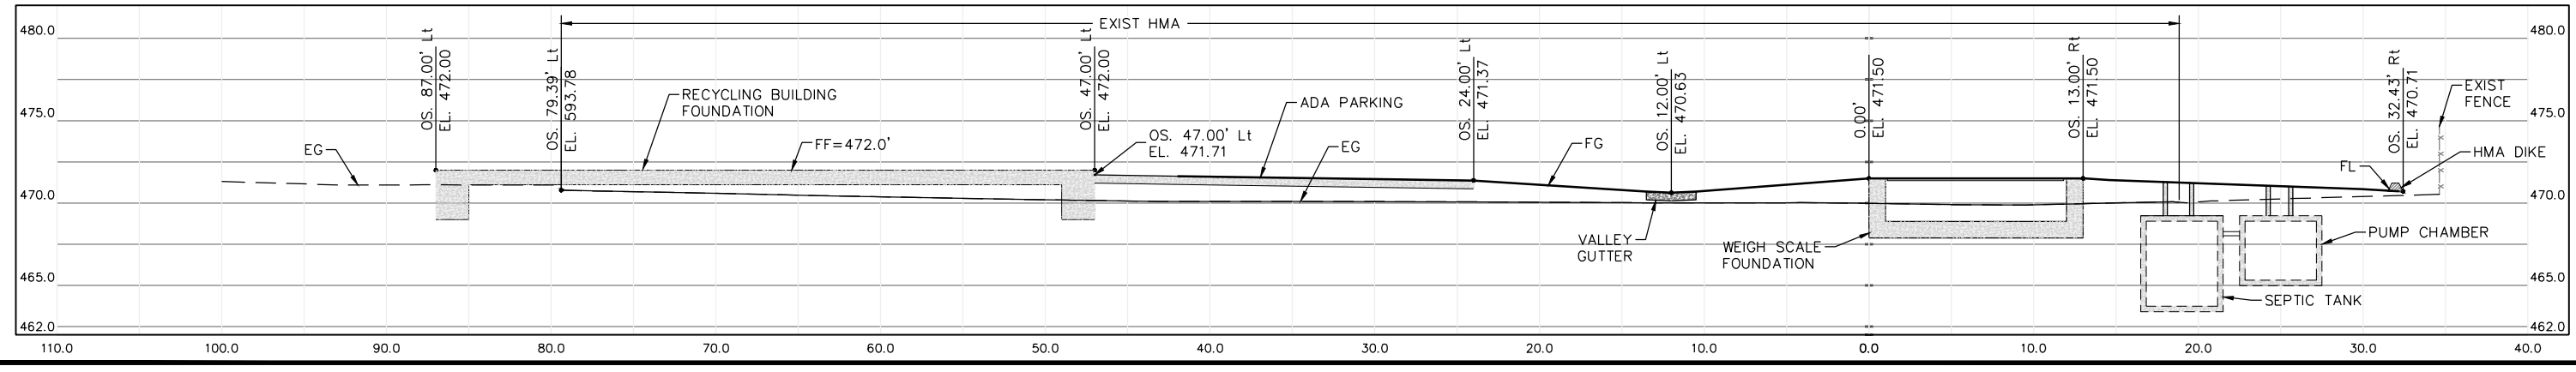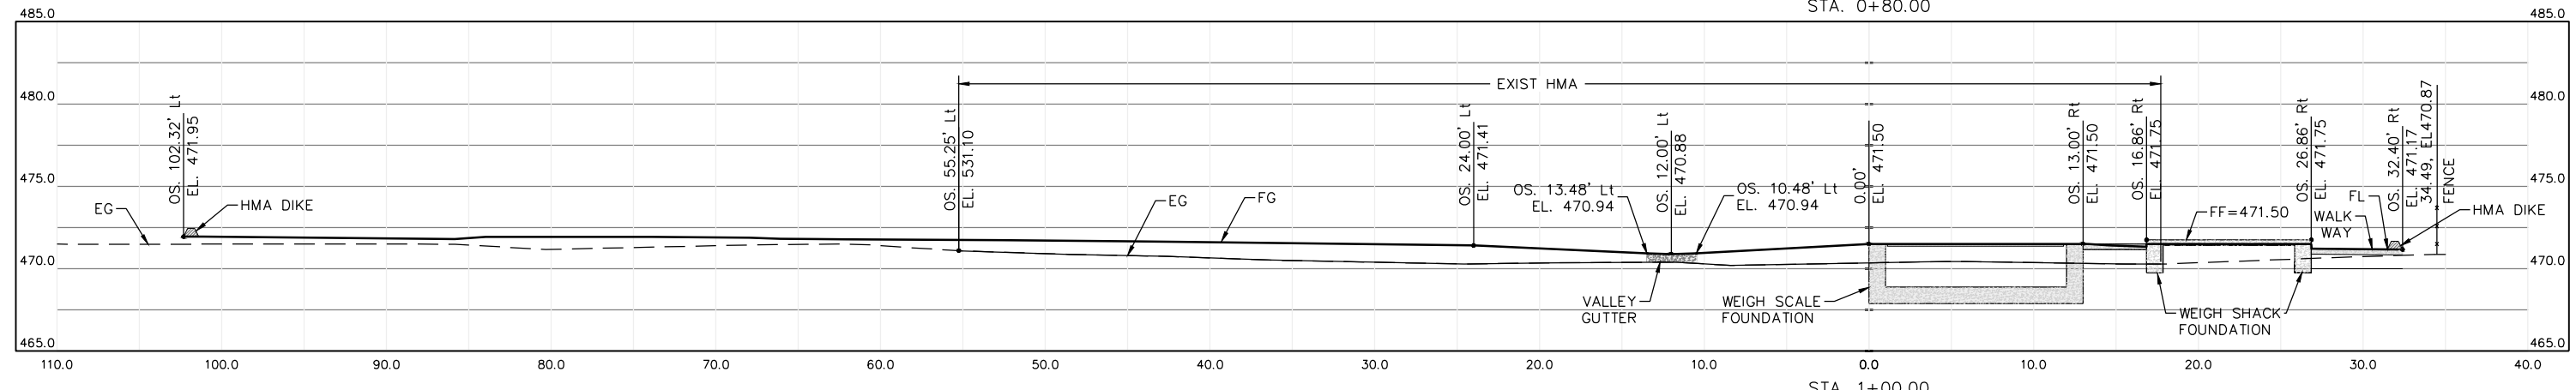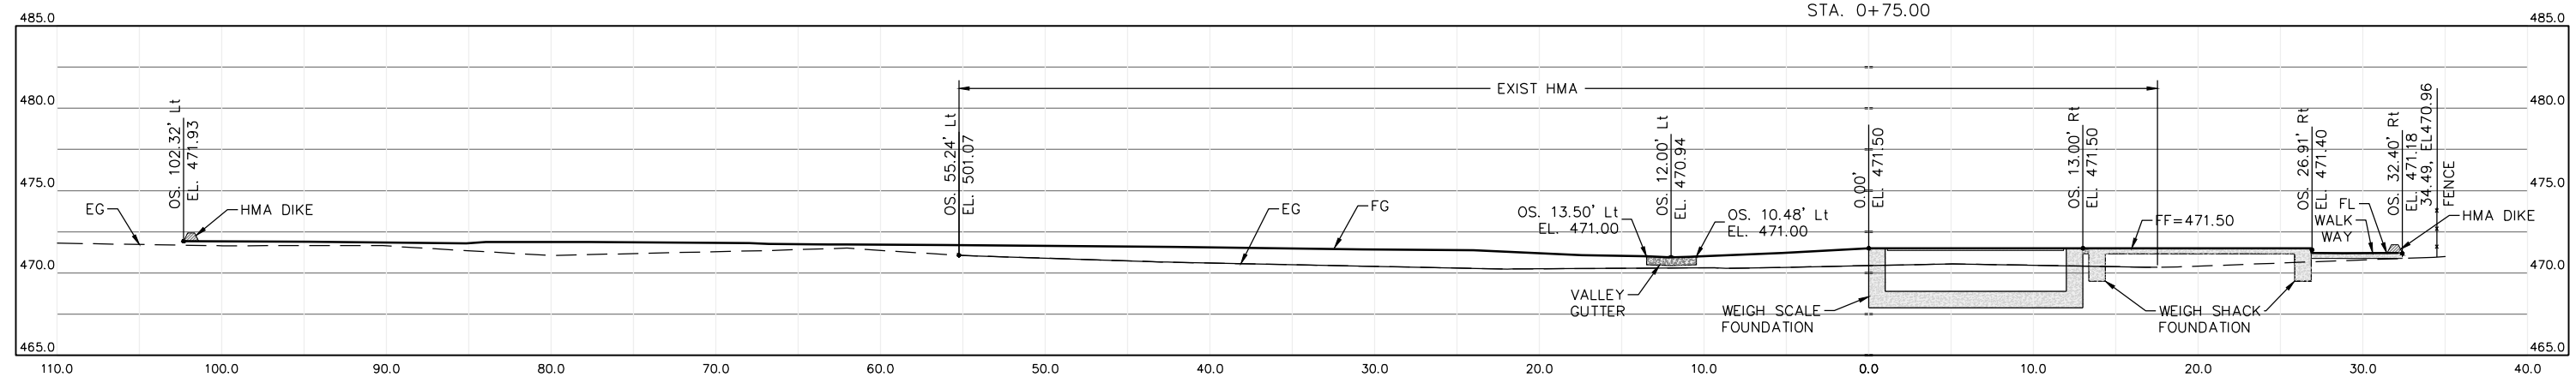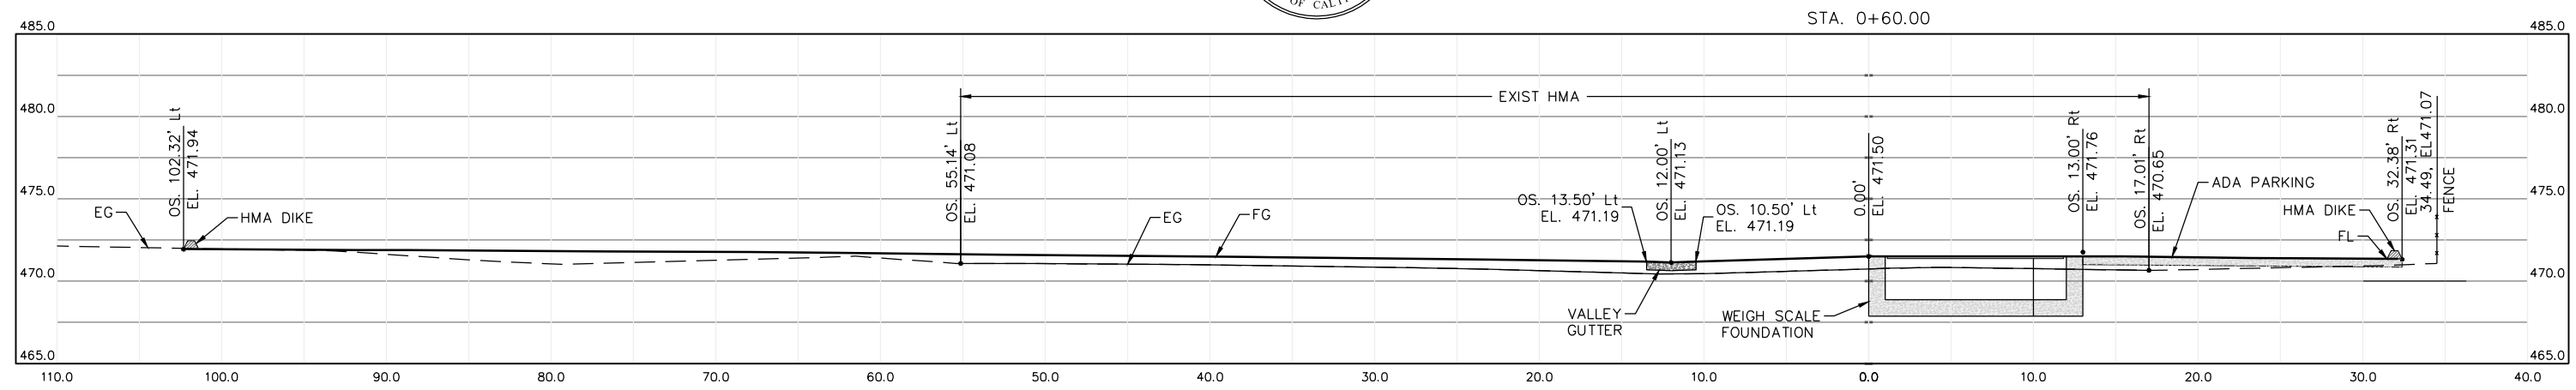







BAR IS ONE INCH ON ORIGINAL DRAWING	ROAD NAME: CONSERVATION CAMP RD	HUMCO	COUNTY OF HUMBOLDT
	ROAD NO:	MILE POST:	DEPARTMENT OF PUBLIC WORKS
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY	PROJECT NO: 438005	DESIGNED BY: ENGR	REDWAY TRANSFER STATION
	DRAWING FILE NAME:	DRAWN BY: PBS	"T" LINE TRANSFER AREA
	PLOT DATE: 08/19/25	REVIEWED BY: JAB	SECTIONS
		APPROVED BY: TRS	SHEET 14 OF 58

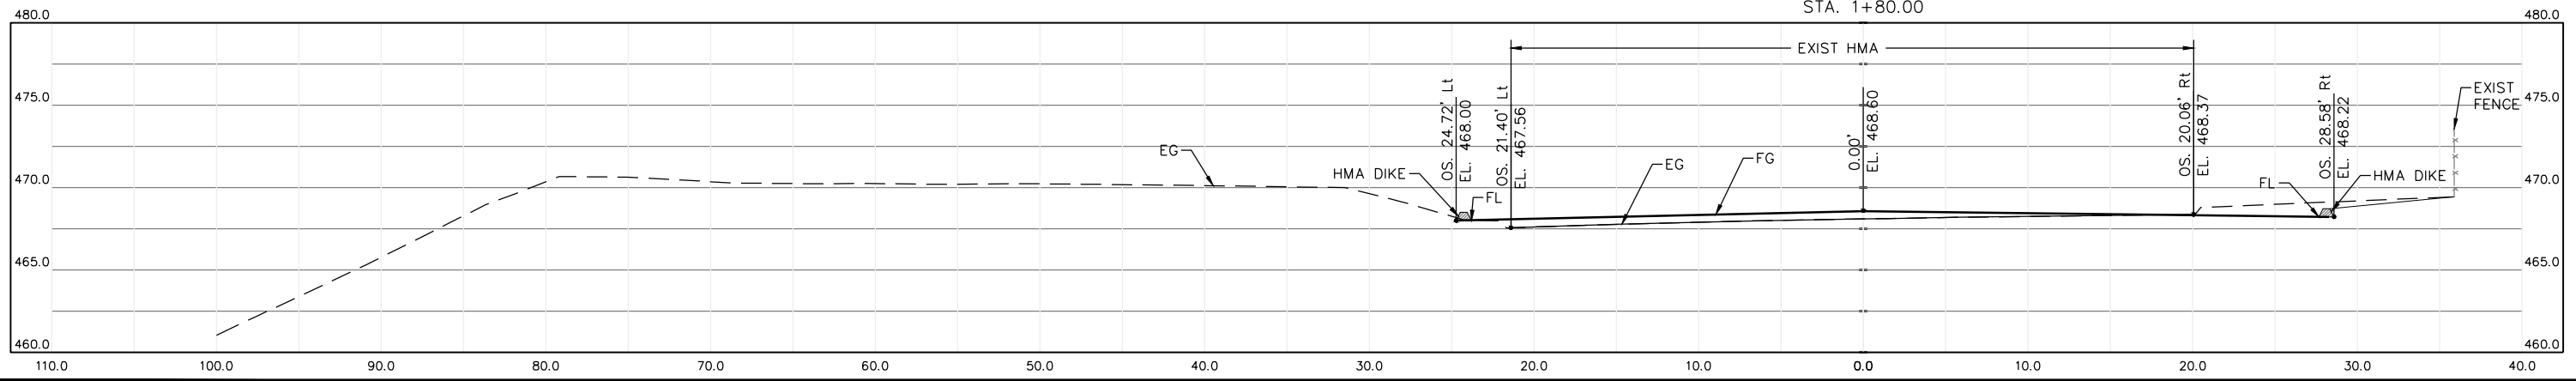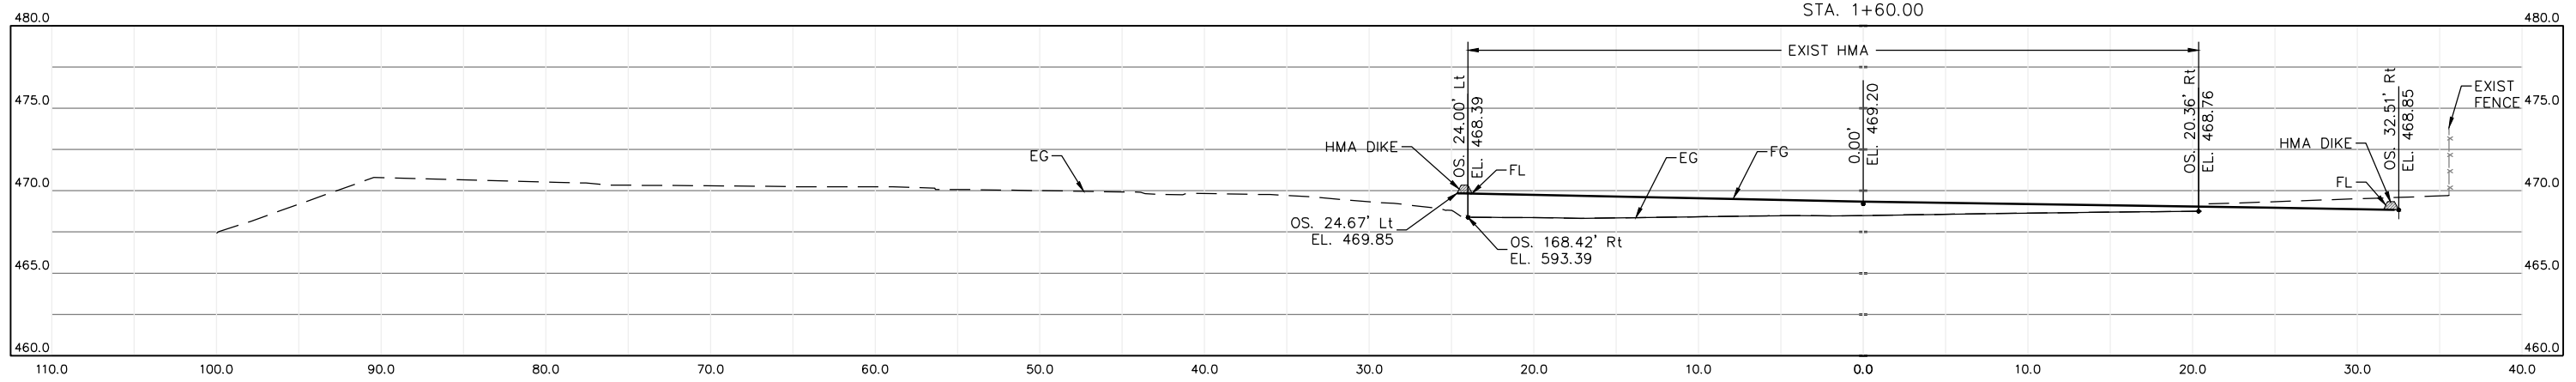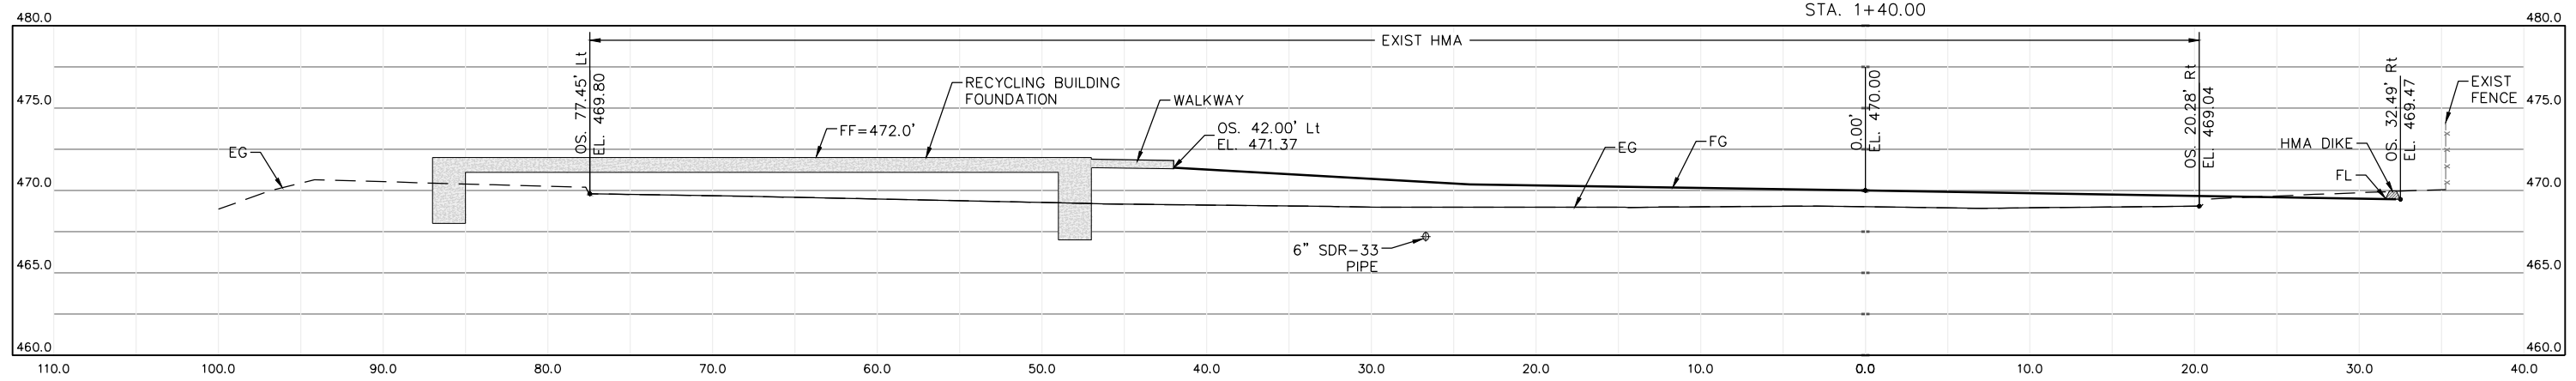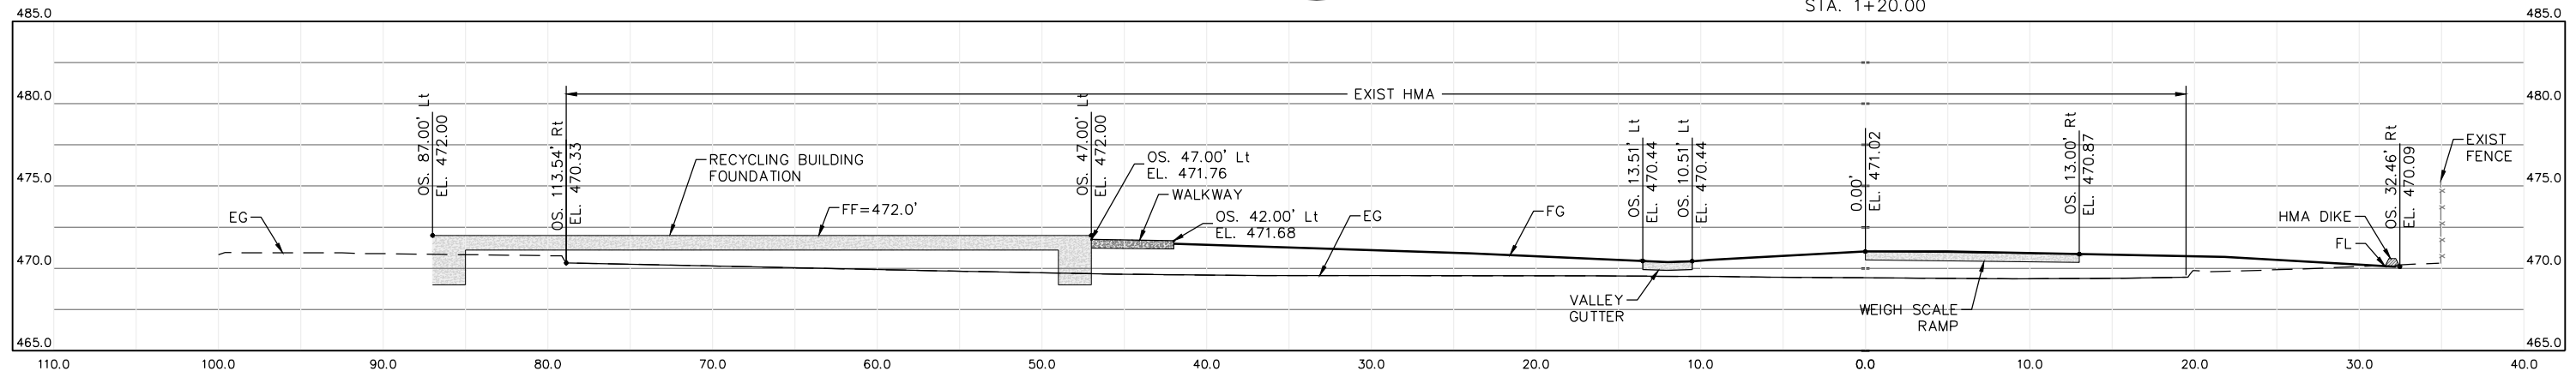




ROAD NAME: CONSERVATION CAMP RD		HUMCO		COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS	
ROAD NO:	MILE POST:	DESIGNED BY: ENGR	REDWAY TRANSFER STATION "T" LINE TRANSFER AREA SECTIONS		
PROJECT NO: 438005		DRAWN BY: PBS			
DRAWING FILE NAME:		REVIEWED BY: JAB			
PLOT DATE: 08/19/25		APPROVED BY: TRS			

SHEET
15
OF
58

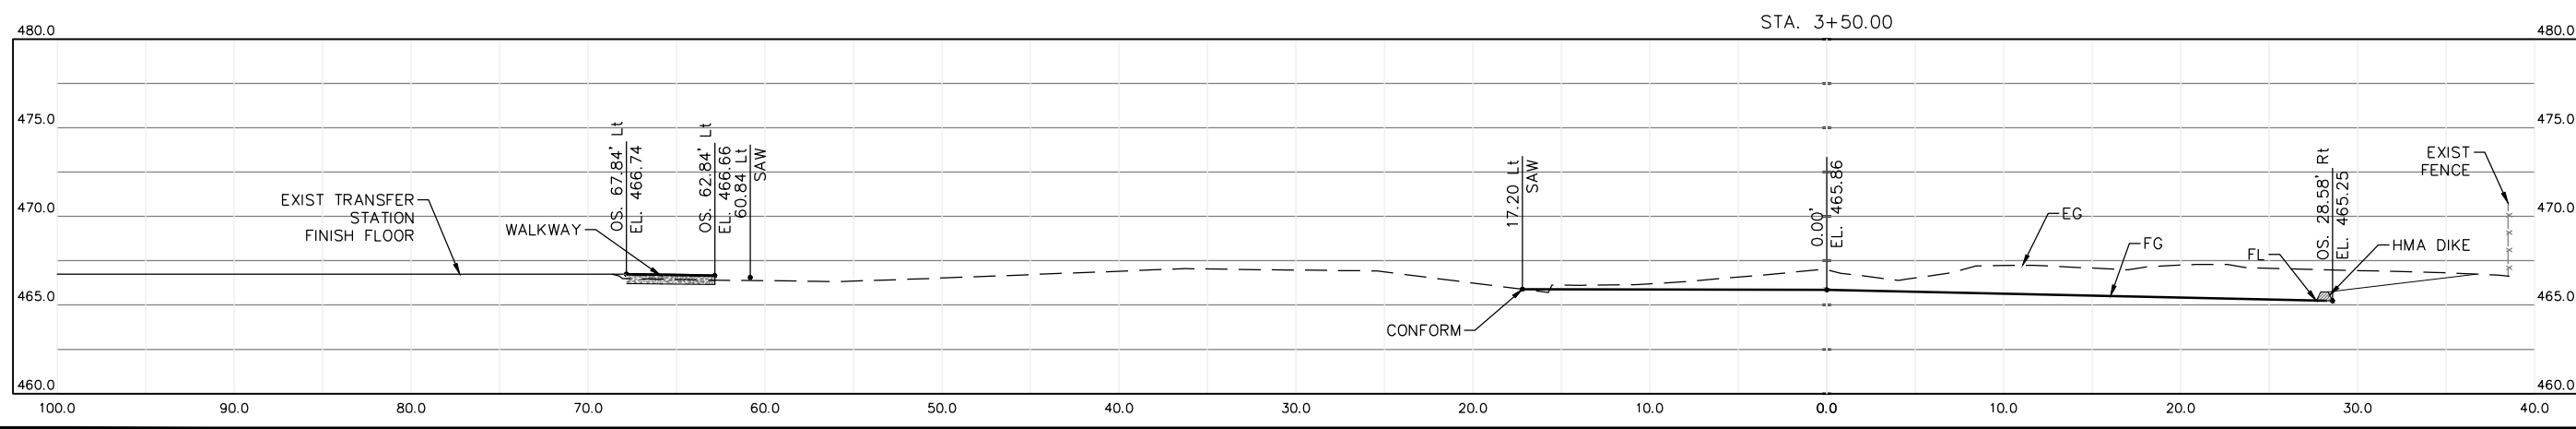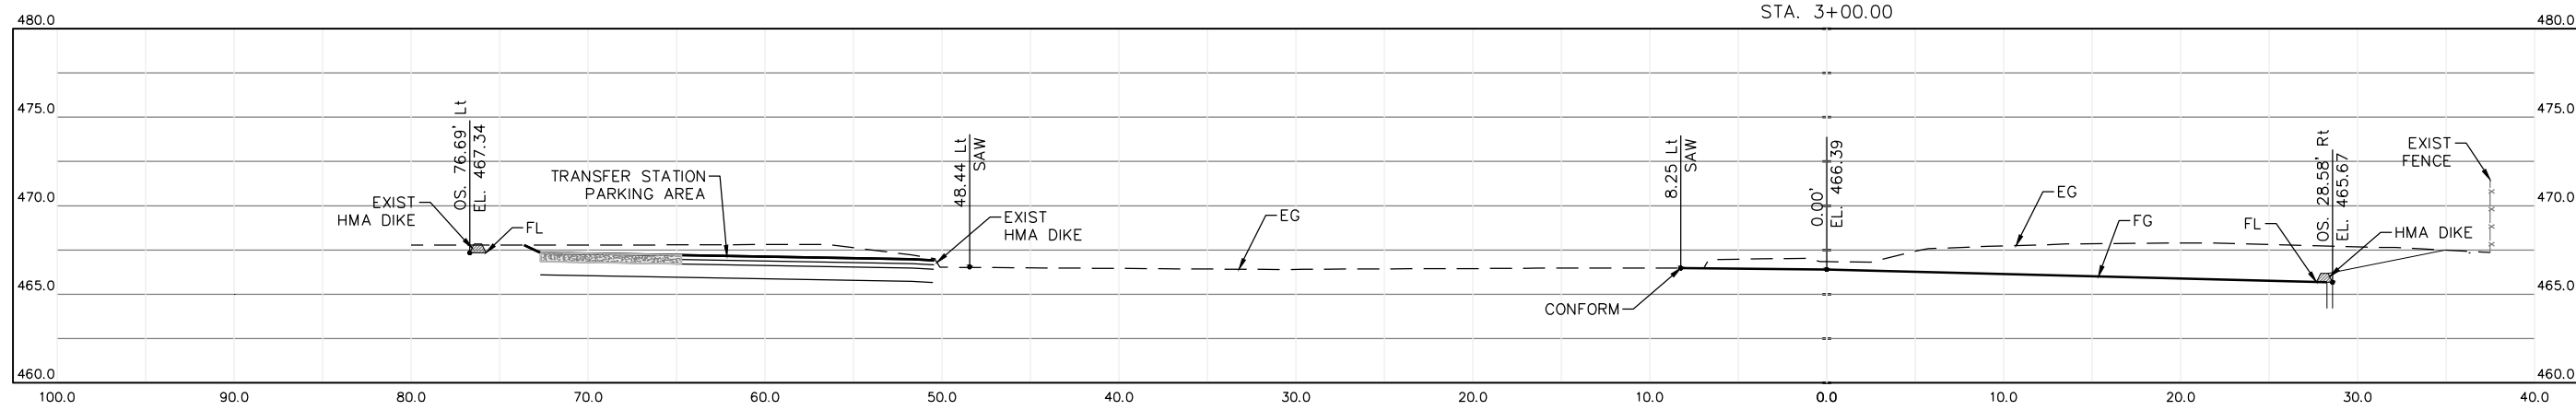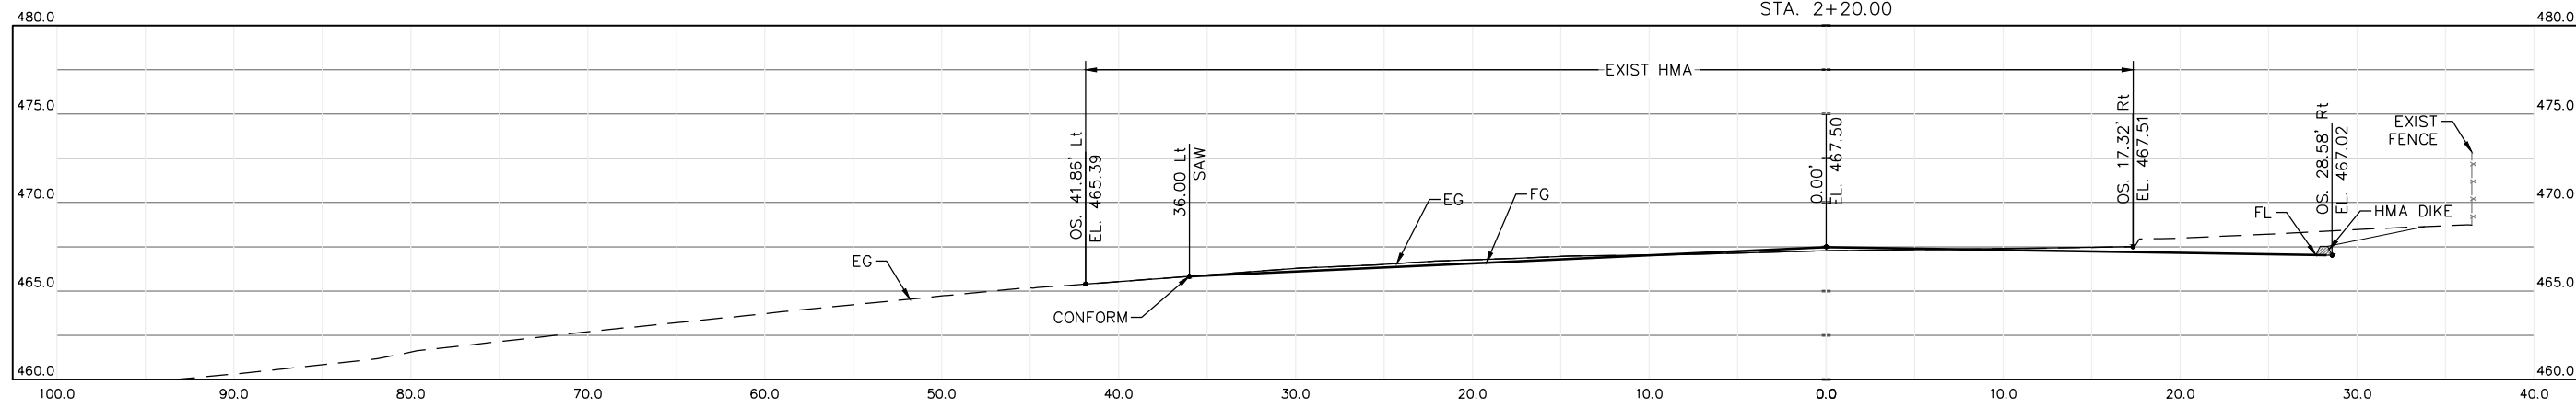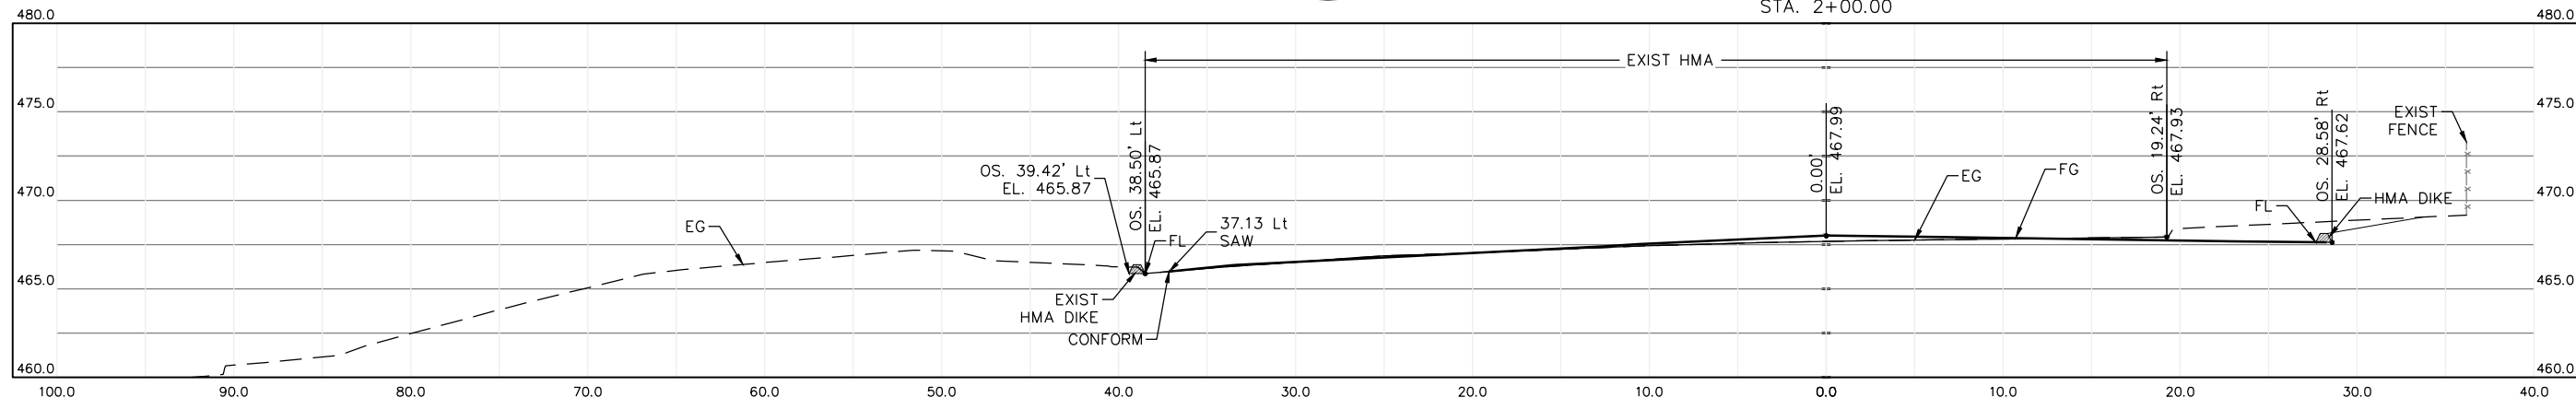





BAR IS ONE INCH ON ORIGINAL DRAWING IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY	ROAD NAME: CONSERVATION CAMP RD	HUMCO	COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS	SHEET 16 OF 58
	ROAD NO:	MILE POST:	DESIGNED BY: ENGR	
	PROJECT NO: 438005		DRAWN BY: PBS	
	DRAWING FILE NAME:		REVIEWED BY: JAB	
	PLOT DATE: 08/19/25		APPROVED BY: TRS	

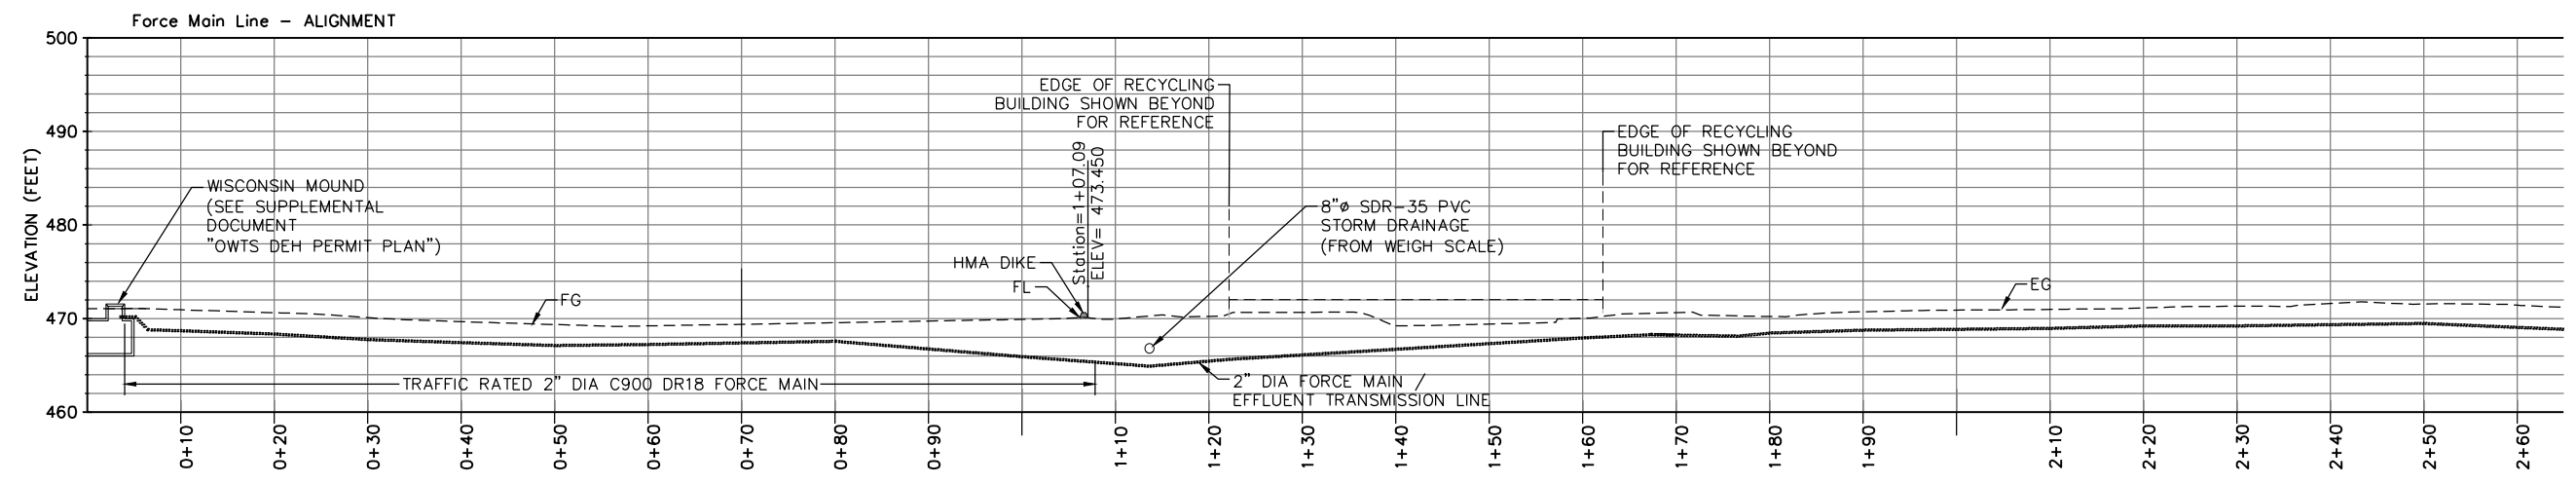


"J" LINE PROFILE
AT STATION 0 + 0.00 TO 2 + 65.00
 SCALE 1:5

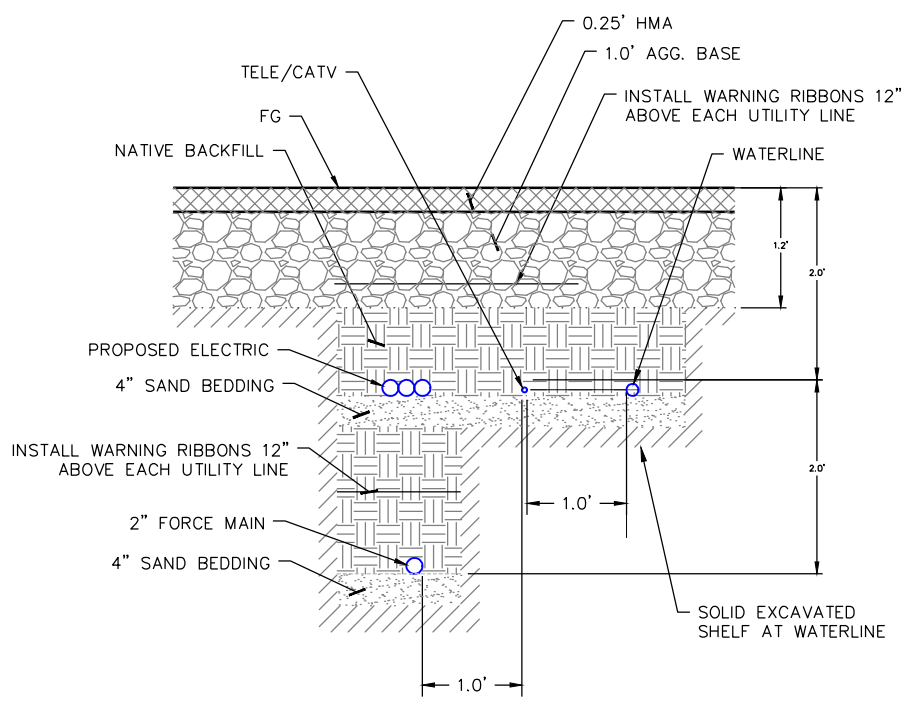

JOINT-SERVICE TRENCH, TYPICAL
 SCALE 1:1

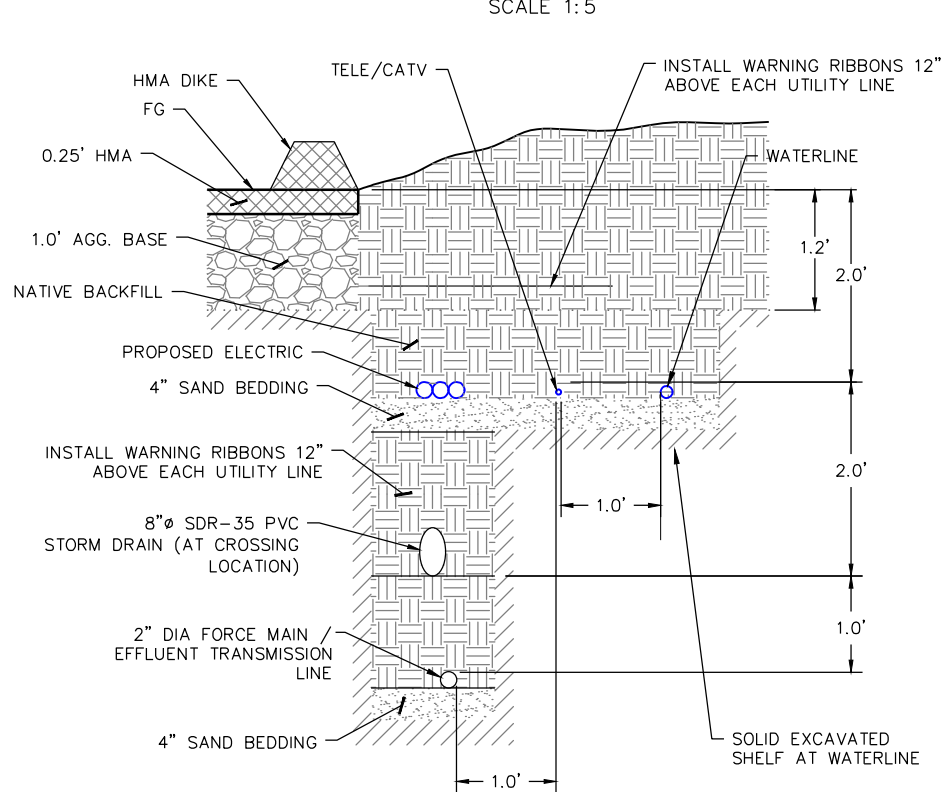

JOINT-SERVICE TRENCH
AT STATION 1 + 13.63
 SCALE 1:1

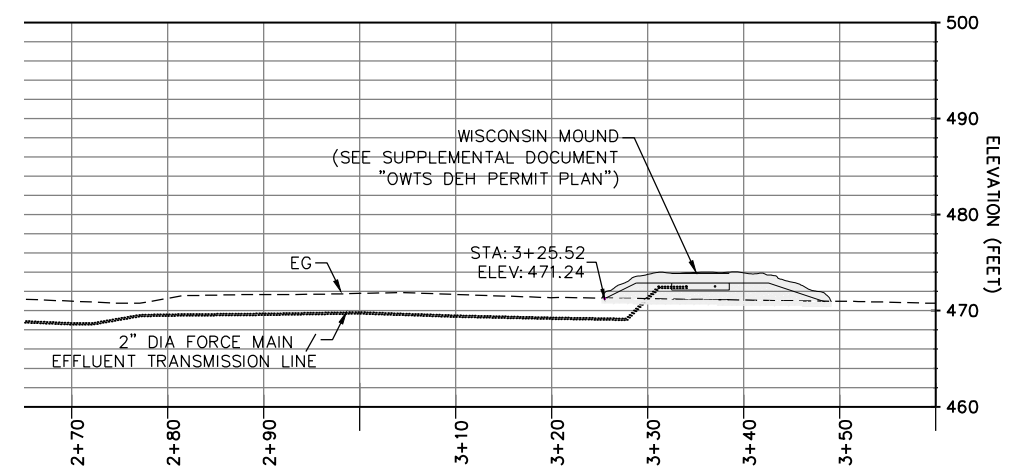


"J" LINE PROFILE
AT STATION 2 + 65.00 TO 3 + 60.00
 SCALE 1:5

SIGN SUMMARY					
SIGN CODE	QTY	SIGN MESSAGE	SOURCE	PANEL SIZE (WIDTH X HEIGHT)	NOTES
R1-1	1	"STOP"	MANUAL UNIFORM TRAFFIC CONTROL DEVICES	30" X 30"	
R5-1	2	"DO NOT ENTER"	MANUAL UNIFORM TRAFFIC CONTROL DEVICES	30" X 30"	
W13-1P	1	10 M.P.H.	MANUAL UNIFORM TRAFFIC CONTROL DEVICES	18" X 18"	
CUSTOM-1	3	"STOP"	-	24" X 24"	PORTABLE STOP SIGN
CUSTOM-2	2	"RECYCLING"	HUMBOLDT COUNTY PUBLIC WORKS		HCPW WILL SUPPLY THE SIGN
CUSTOM-3	2	"WASTE"	HUMBOLDT COUNTY PUBLIC WORKS		HCPW WILL SUPPLY THE SIGN
CUSTOM-4	3	<i>DIRECTIONAL ARROW</i>	HUMBOLDT COUNTY PUBLIC WORKS		HCPW WILL SUPPLY THE SIGN
CUSTOM-5	1	"ADA UNLOADING"	HUMBOLDT COUNTY PUBLIC WORKS		HCPW WILL SUPPLY THE SIGN

PAVEMENT MARKING WORDS AND ARROWS			
#	QTY	DESCRIPTION	SOURCE
1	7	TYPE I 10'-0" ARROW	CALTRANS STD. PLAN (A24A)
2	1	TYPE VIII (R) ARROW	CALTRANS STD. PLAN (A24A)
3	4	"STOP" MARKING	CALTRANS STD. PLAN (A24D)

(R1-1)
 (R5-1)
 (W13-1P)
 CUSTOM-2
 CUSTOM-3
 CUSTOM-4
 CUSTOM-5

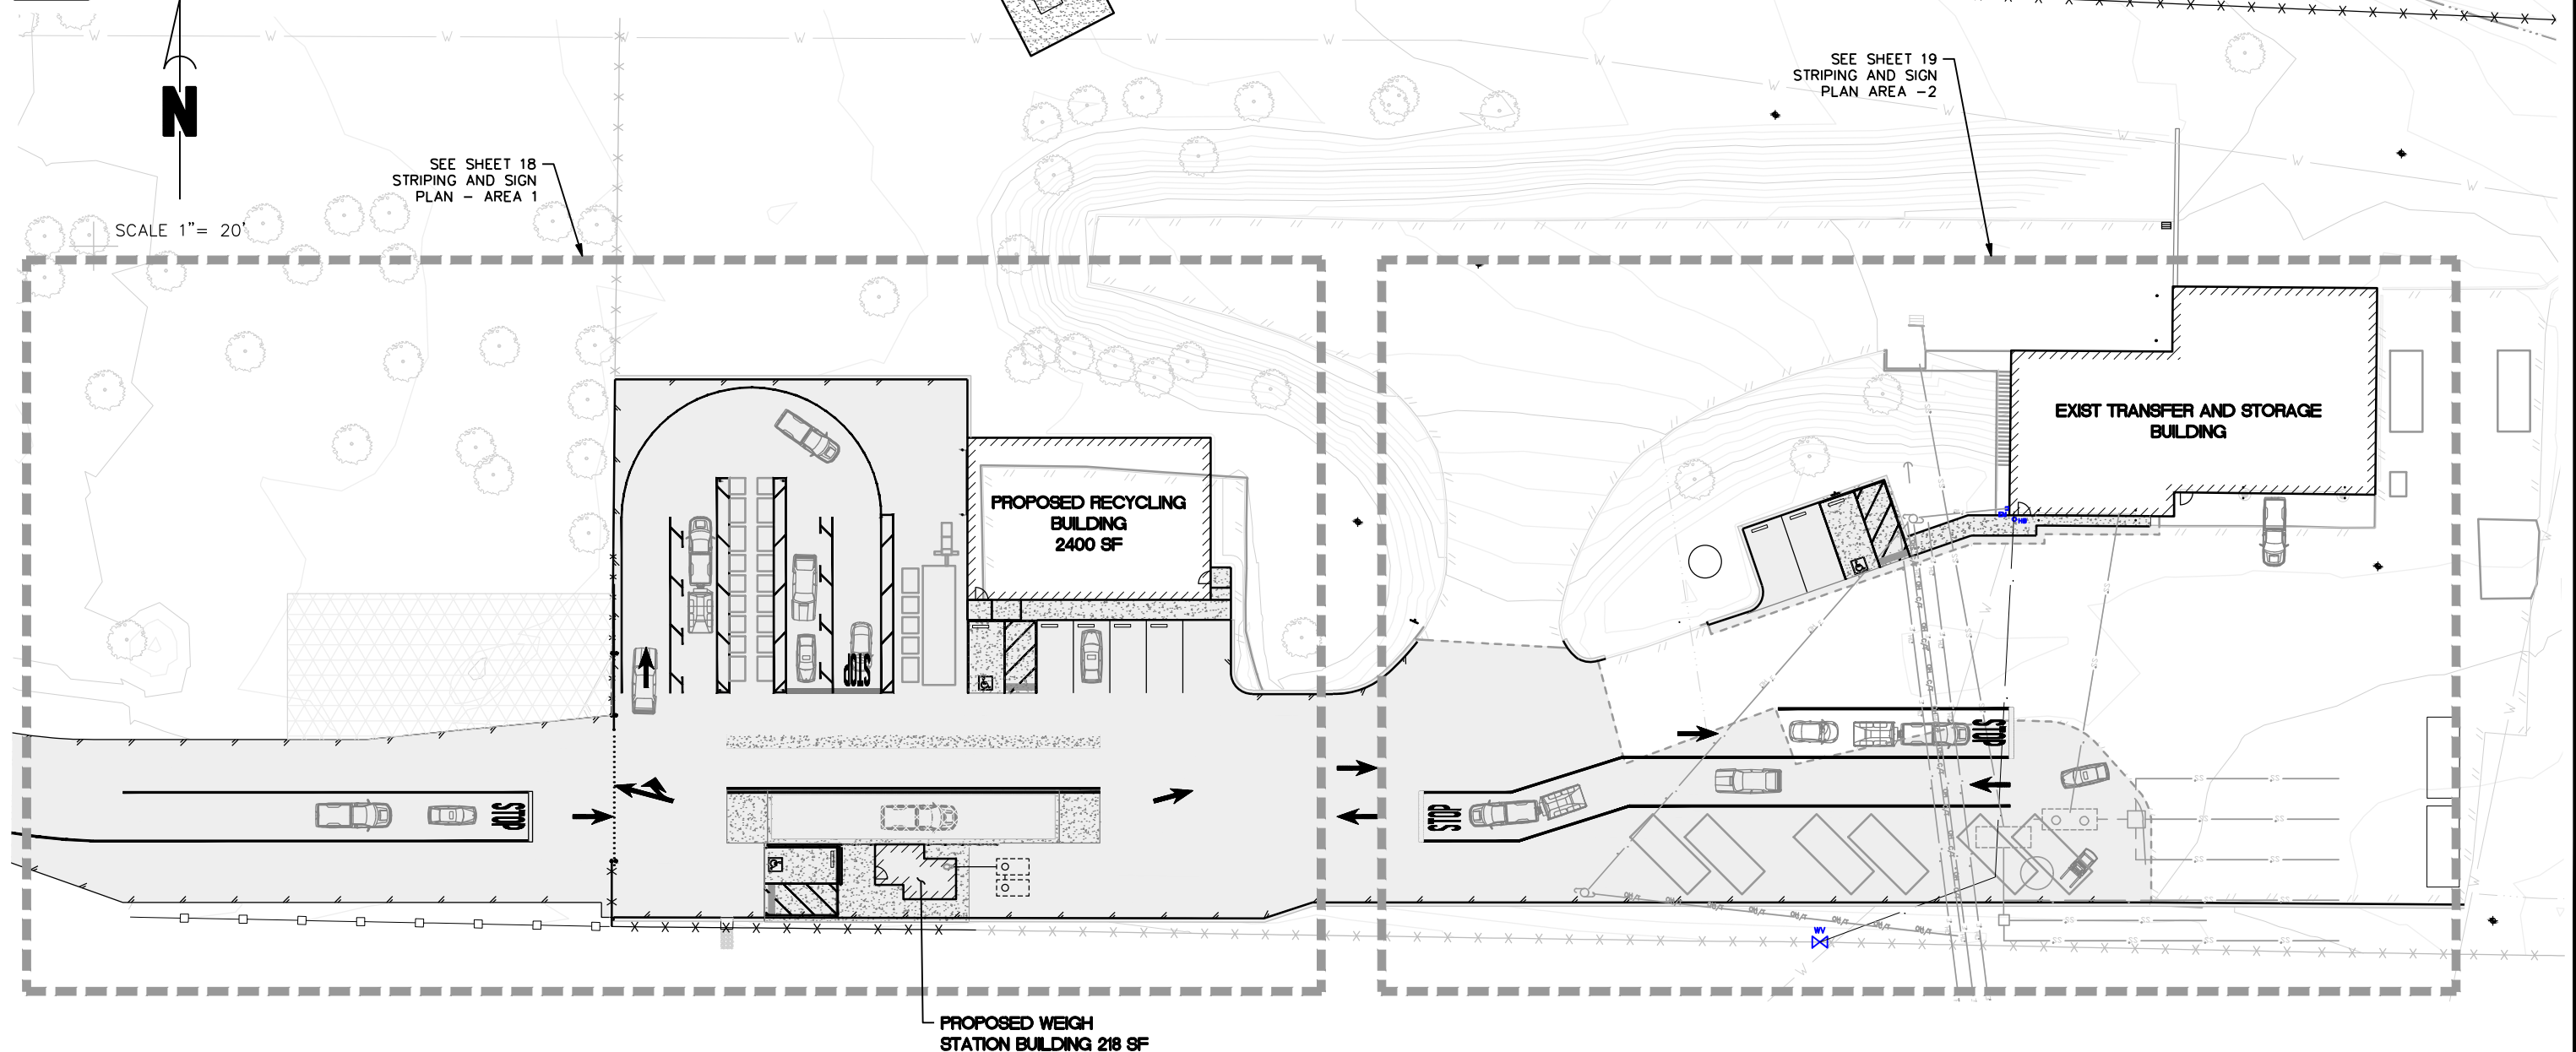


ROAD NAME: CONSERVATION CAMP RD ROAD NO: PROJECT NO: 438005 DRAWING FILE NAME: RTS_SITE PLAN PLOT DATE: 08/19/25	MILE POST: DESIGNED BY: ENGR DRAWN BY: PBS REVIEWED BY: JAB APPROVED BY: TRS	COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS REDWAY TRANSFER STATION STRIPING AND SIGN OVERVIEW	SHEET 17 OF 58
--	--	---	---------------------------------------

ABBREVIATION
 MUTCD (MANUAL ON UNIFORM CONTROL DEVICES)
 HCPW (HUMBOLDT COUNTY PUBLIC WORKS)
 ADA (AMERICAN DISABILITY ACT)



BAR IS ONE INCH ON ORIGINAL DRAWING	ROAD NAME: CONSERVATION CAMP RD	HUMCO	COUNTY OF HUMBOLDT
	ROAD NO:	MILE POST:	DEPARTMENT OF PUBLIC WORKS
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY	PROJECT NO: 438005	DESIGNED BY: ENGR	REDWAY TRANSFER STATION
	DRAWING FILE NAME: RTS_SITE PLAN	DRAWN BY: PBS	STRIPING AND SIGN - AREA 2
	PLOT DATE: 08/19/25	REVIEWED BY: JAB	
		APPROVED BY: TRS	SHEET 19 OF 58

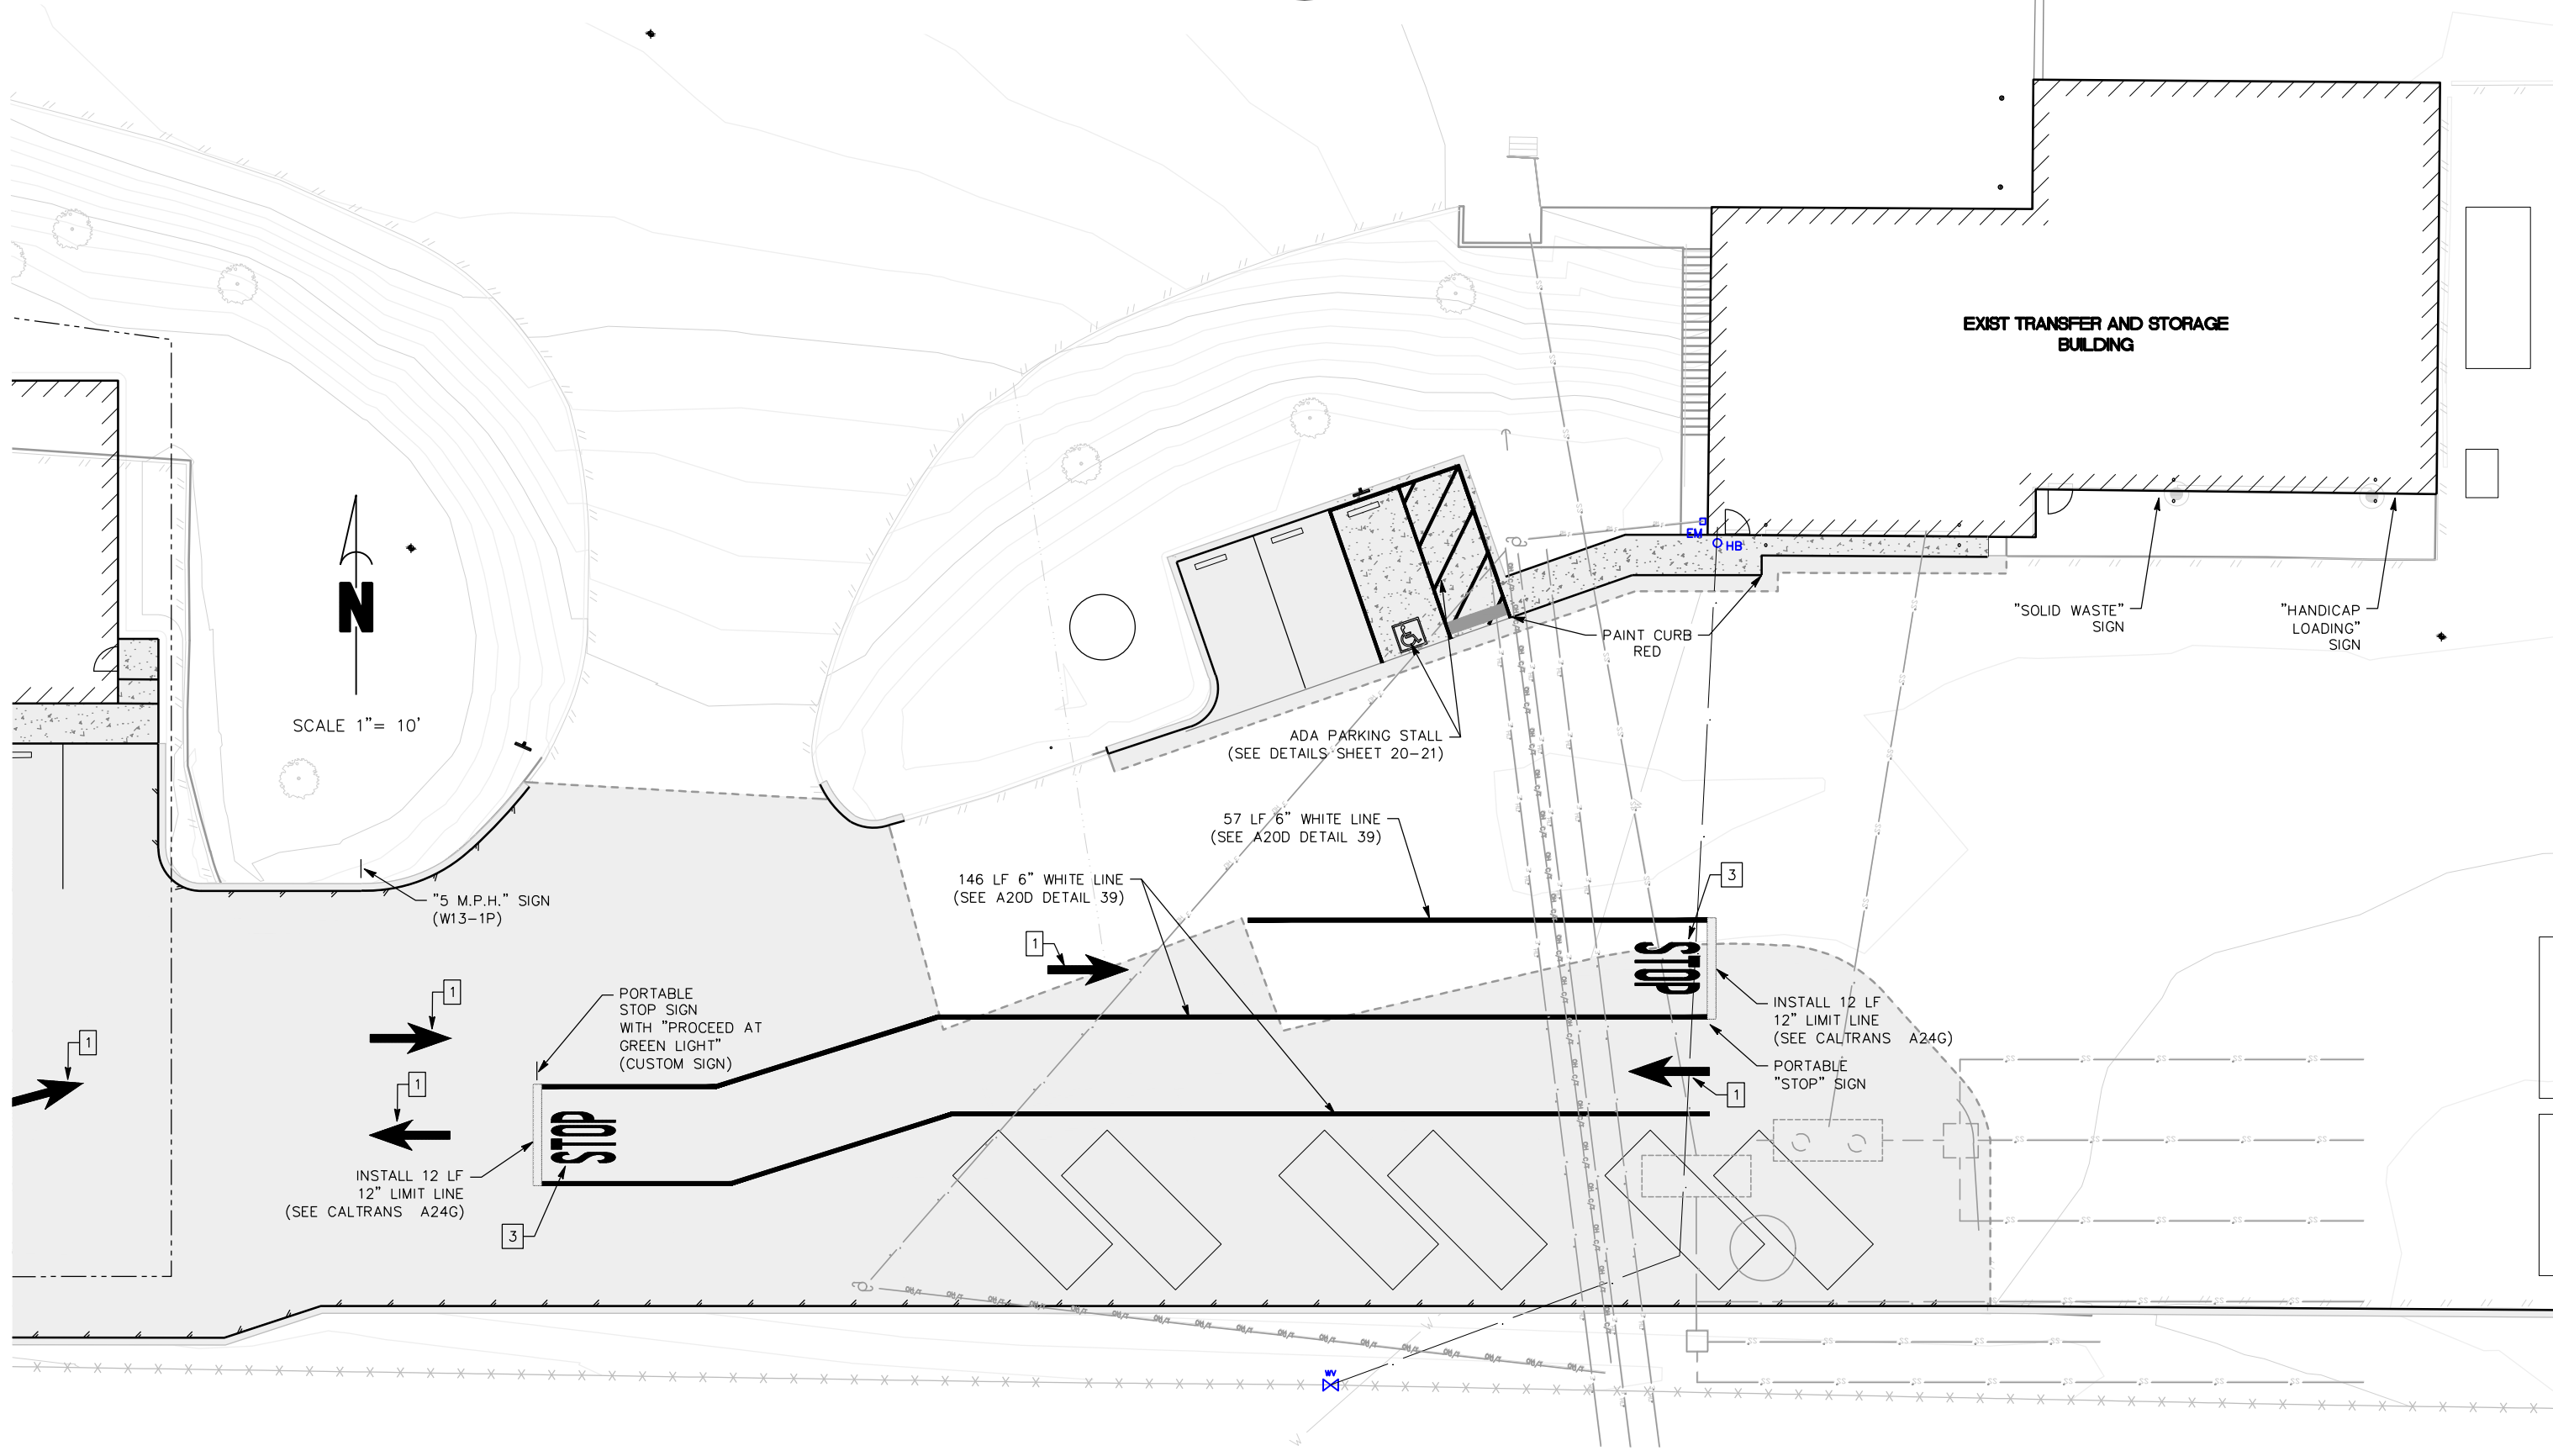

GENERAL NOTES

ADA PARKING NOTES:

- ACCESSIBLE PARKING SPACES SERVING A PARTICULAR BUILDING SHALL BE LOCATED ON THE SHORTEST ACCESSIBLE ROUTE OF TRAVEL FROM ADJACENT PARKING TO AN ACCESSIBLE ENTRANCE. IN PARKING FACILITIES THAT DO NOT SERVE A PARTICULAR BUILDING, ACCESSIBLE PARKING SHALL BE LOCATED ON THE SHORTEST ACCESSIBLE ROUTE OF TRAVEL TO AN ACCESSIBLE PEDESTRIAN ENTRANCE OF THE PARKING FACILITY.
- ONE IN EVERY SIX ACCESSIBLE OFF-STREET PARKING STALLS, BUT NOT LESS THAN ONE, SHALL BE SERVED BY AN ACCESSIBLE AISLE OF 8'-0" MINIMUM WIDTH AND SHALL BE SIGNED VAN ACCESSIBLE OR AS ALLOWED PER 2022 CBC SECTION 11B-208.2.4. THE R7-8B SIGN SHALL BE MOUNTED BELOW THE R99B (CA) PLAQUE OR THE R99C (CA) SIGN.
- IN EACH PARKING STALL, A CURB OR BUMPER SHALL BE PROVIDED AND LOCATED TO PREVENT ENCROACHMENT OF VEHICLES OVER THE REQUIRED WIDTH OF WALKWAYS. PARKING STALLS SHALL BE SO LOCATED THAT PERSONS WITH DISABILITIES ARE NOT COMPELLED TO WHEEL OR WALK BEHIND PARKED CARS OTHER THAN THEIR OWN.
- SURFACE SLOPES OF ACCESSIBLE OFF-STREET PARKING STALLS SHALL BE THE MINIMUM POSSIBLE AND SHALL NOT EXCEED 2 PERCENT IN ANY DIRECTION.
- 2022 CBC TABLE 11B-208.2 SHALL BE USED TO DETERMINE THE REQUIRED NUMBER OF ACCESSIBLE PARKING STALLS IN EACH PARKING LOT OR GARAGE
- WHERE PLAQUE R99B (CA), SIGN R99C (CA) OR SIGN R7-8B ARE INSTALLED, THE BOTTOM OF THE LOWER SIGN OR PLAQUE PANEL SHALL BE A MINIMUM OF 5'-0" ABOVE THE SURROUNDING SURFACE. SIGNS LOCATED IN AN ACCESSIBLE ROUTE SHALL BE 80" MIN TO THE BOTTOM OF THE SIGN.
- THE WORDS "NO PARKING", SHALL BE PAINTED IN WHITE LETTERS NO LESS THAN 1'-0" HIGH AND LOCATED SO THAT IT IS VISIBLE TO TRAFFIC ENFORCEMENT OFFICIALS IN THE LOADING AND UNLOADING ACCESS AISLE. SEE DETAIL 3 SHEET 20.
- A R100B (CA) SIGN SHALL BE POSTED IN A CONSPICUOUS PLACE AT EACH ENTRANCE TO OFF-STREET PARKING FACILITIES OR IMMEDIATELY ADJACENT TO AND VISIBLE FROM EACH STALL. THE SIGN SHALL INCLUDE THE ADDRESS WHERE THE TOWED VEHICLE MAY BE RECLAIMED AND THE TELEPHONE NUMBER OF THE LOCAL TRAFFIC LAW ENFORCEMENT AGENCY AS A PERMANENT PART OF THE SIGN. MINIMUM TEXT HEIGHT SHALL BE 1".
- WHERE A SINGLE (NON-VAN) ACCESSIBLE PARKING SPACE IS PROVIDED, THE LOADING AND UNLOADING ACCESS AISLE SHALL BE 5'-0" WIDE MINIMUM, ON THE PASSENGER SIDE OF THE VEHICLE AS THE VEHICLE IS GOING FORWARD INTO THE PARKING SPACE.
- WHERE A VAN ACCESSIBLE PARKING SPACE IS PROVIDED, THE LOADING AND UNLOADING ACCESS AISLE SHALL BE 8'-0" WIDE MINIMUM, AND SHALL BE ON THE PASSENGER SIDE OF THE VEHICLE AS THE VEHICLE IS GOING FORWARD INTO THE PARKING SPACE. THESE SPACES REQUIRE SIGN R7-8B IN ADDITION TO THE SIGNAGE
- THE ACCESSIBLE PARKING ONLY SIGN SHALL BE SIGN R99C (CA) OR SIGN R99 (CA) WITH PLAQUE R99B (CA). MINIMUM TEXT HEIGHT SHALL BE 1".
- ALL ACCESSIBLE PARKING SPACES, ACCESS AISLES, AND VEHICULAR ROUTES SERVING THEM SHALL HAVE A MINIMUM VERTICAL CLEARANCE OF 98".

ACCESSIBLE ROUTE WALKING SURFACE NOTES:

- FLOOR AND GROUND SURFACES SHALL BE STABLE, FIRM AND SLIP RESISTANT.
- OPENINGS IN FLOOR OR GROUND SURFACES SHALL NOT ALLOW PASSAGE OF A SPHERE MORE THAN 1/2 INCH DIAMETER. ELONGATED OPENINGS SHALL BE PLACED SO THAT THE LONG DIMENSION IS PERPENDICULAR TO THE DOMINANT DIRECTION OF TRAVEL.
- CHANGES IN LEVEL OF 1/4 INCH HIGH MAXIMUM SHALL BE PERMITTED TO BE VERTICAL AND WITHOUT EDGE TREATMENT. CHANGES IN LEVEL BETWEEN 1/4 INCH HIGH MINIMUM AND 1/2 INCH HIGH MAXIMUM SHALL BE BEVELED WITH A SLOPE NOT STEEPER THAN 1:2.
- CHANGES IN LEVEL GREATER THAN 1/2 INCH HIGH SHALL BE RAMPED AND SHALL COMPLY WITH RAMP DETAILS AND NOTES.
- ABRUPT CHANGES IN LEVEL EXCEEDING 4 INCHES IN A VERTICAL DIMENSION BETWEEN WALKS, SIDEWALKS OR OTHER PEDESTRIAN WAYS AND ADJACENT SURFACES OR FEATURES SHALL BE IDENTIFIED BY WARNING CURBS AT LEAST 6 INCHES IN HEIGHT ABOVE THE WALK OR SIDEWALK SURFACE. EXCEPTIONS: A WARNING CURB IS NOT REQUIRED BETWEEN A WALK OR SIDEWALK AND AN ADJACENT STREET OR DRIVEWAY. A WARNING CURB IS NOT REQUIRED WHEN A GUARD OR HANDRAIL IS PROVIDED WITH A GUIDE RAIL CENTERED 2 INCHES MINIMUM AND 4 INCHES MAXIMUM ABOVE THE SURFACE OF THE WALK OR SIDEWALK.
- SLOPE: THE RUNNING SLOPE OF WALKING SURFACES SHALL NOT BE STEEPER THAN 1:20 (5%). THE CROSS SLOPE OF WALKING SURFACES SHALL NOT BE STEEPER THAN 1:48 (2%). EXCEPTION: THE RUNNING SLOPE OF SIDEWALKS SHALL NOT EXCEED THE GENERAL GRADE ESTABLISHED FOR THE ADJACENT STREET OR HIGHWAY.
- CLEAR WIDTH: THE CLEAR WIDTH OF INTERIOR WALKING SURFACES SHALL BE 36 INCHES MINIMUM (48" MINIMUM OUTSIDE). EXCEPTIONS: WITHIN EMPLOYEE WORK AREAS, CLEARANCES ON COMMON USE CIRCULATION PATHS SHALL BE PERMITTED TO BE DECREASED BY WORK AREA EQUIPMENT PROVIDED THAT THE DECREASE IS ESSENTIAL TO THE FUNCTION OF THE WORK BEING PERFORMED. THE CLEAR WIDTH SHALL BE PERMITTED TO BE REDUCED TO 32 INCHES MINIMUM FOR A LENGTH OF 24 INCHES MAXIMUM PROVIDED THAT REDUCED WIDTH SEGMENTS ARE SEPARATED BY SEGMENTS THAT ARE 48 INCHES LONG MINIMUM AND 36 INCHES WIDE MINIMUM.
- PASSING SPACES: AN ACCESSIBLE ROUTE WITH A CLEAR WIDTH LESS THAN 60 INCHES SHALL PROVIDE PASSING SPACES AT INTERVALS OF 200 FEET MAXIMUM. PASSING SPACES SHALL BE EITHER: A SPACE 60 INCHES MINIMUM BY 60 INCHES MINIMUM; OR AN INTERSECTION OF TWO WALKING SURFACES PROVIDING A T-SHAPED SPACE WHERE THE BASE AND ARMS OF THE T-SHAPED SPACE EXTEND 48 INCHES MINIMUM BEYOND THE INTERSECTION.
- CONTINUOUS GRADIENT: ALL WALKS WITH CONTINUOUS GRADIENTS SHALL HAVE RESTING AREAS, 60 INCHES IN LENGTH, AT INTERVALS OF 400 FEET MAXIMUM. THE RESTING AREA SHALL BE AT LEAST AS WIDE AS THE WALK. THE SLOPE OF THE RESTING AREA IN ALL DIRECTIONS SHALL BE 1:48 (2%) MAXIMUM.

ACCESSIBLE PATH OF TRAVEL NOTES:




- SITE ARRIVAL POINTS: AT LEAST ONE ACCESSIBLE ROUTE SHALL BE PROVIDED WITHIN THE SITE FROM ACCESSIBLE PARKING SPACES AND ACCESSIBLE PASSENGER DROP-OFF AND LOADING ZONES, PUBLIC STREETS AND SIDEWALKS, AND PUBLIC TRANSPORTATION STOPS TO THE ACCESSIBLE BUILDING OR FACILITY ENTRANCE THEY SERVE. WHERE MORE THAN ONE ROUTE IS PROVIDED, ALL ROUTES MUST BE ACCESSIBLE. EXCEPTION: AN ACCESSIBLE ROUTE SHALL NOT BE REQUIRED BETWEEN SITE ARRIVAL POINTS AND THE BUILDING OR FACILITY ENTRANCE IF THE ONLY MEANS OF ACCESS BETWEEN THEM IS A VEHICULAR WAY NOT PROVIDING PEDESTRIAN ACCESS.
- WITHIN A SITE: AT LEAST ONE ACCESSIBLE ROUTE SHALL CONNECT ACCESSIBLE BUILDINGS, ACCESSIBLE FACILITIES, ACCESSIBLE ELEMENTS, AND ACCESSIBLE SPACES THAT ARE ON THE SAME SITE. EXCEPTION: AN ACCESSIBLE ROUTE SHALL NOT BE REQUIRED BETWEEN ACCESSIBLE BUILDINGS, ACCESSIBLE FACILITIES, ACCESSIBLE ELEMENTS, AND ACCESSIBLE SPACES IF THE ONLY MEANS OF ACCESS BETWEEN THEM IS A VEHICULAR WAY NOT PROVIDING PEDESTRIAN ACCESS.
- SPACES AND ELEMENTS: AT LEAST ONE ACCESSIBLE ROUTE SHALL CONNECT ACCESSIBLE BUILDING OR FACILITY ENTRANCES WITH ALL ACCESSIBLE SPACES AND ELEMENTS WITHIN THE BUILDING OR FACILITY, INCLUDING MEZZANINES.

ADA ENTRANCE NOTES:

- WHEN SIGNS IDENTIFY, DIRECT, OR GIVE INFORMATION ABOUT ACCESSIBLE ELEMENTS AND FEATURES OF A BUILDING OR SITE, THEY SHALL INCLUDE THE INTERNATIONAL SYMBOL OF ACCESSIBILITY.
- ACCESSIBLE BUILDING ENTRANCES SHALL BE IDENTIFIED WITH A MINIMUM OF ONE INTERNATIONAL SYMBOL OF ACCESSIBILITY AND WITH ADDITIONAL DIRECTIONAL SIGNS AS NEEDED TO IDENTIFY ACCESSIBLE FACILITIES AND PATHS OF TRAVEL.




ROAD NAME: CONSERVATION CAMP RD		HUMCO		COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS		SHEET 20 OF 58
BAR IS ONE INCH ON ORIGINAL DRAWING	ROAD NO:	MILE POST:	DESIGNED BY: ENGR	REDWAY TRANSFER STATION		
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY	PROJECT NO: 438005		DRAWN BY: PBS	ADA CONSTRUCTION DETAILS		
	DRAWING FILE NAME: RTS_CONSTRUCTION DETAILS		REVIEWED BY: JAB			
	PLOT DATE: 08/19/25		APPROVED BY: TRS			

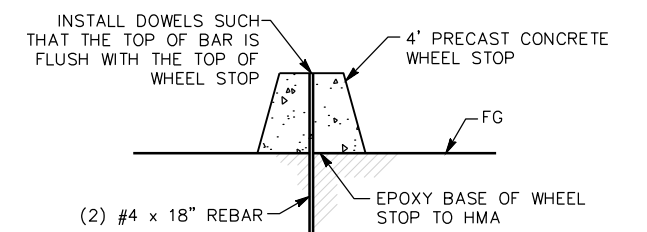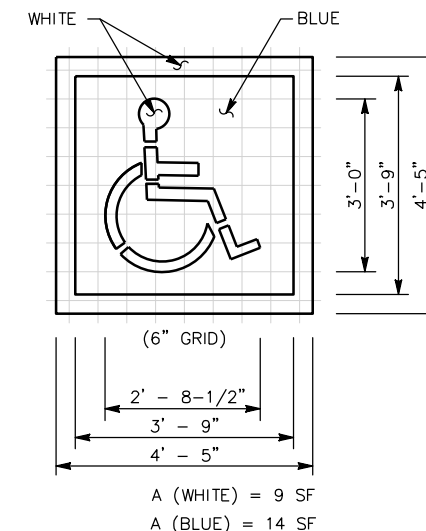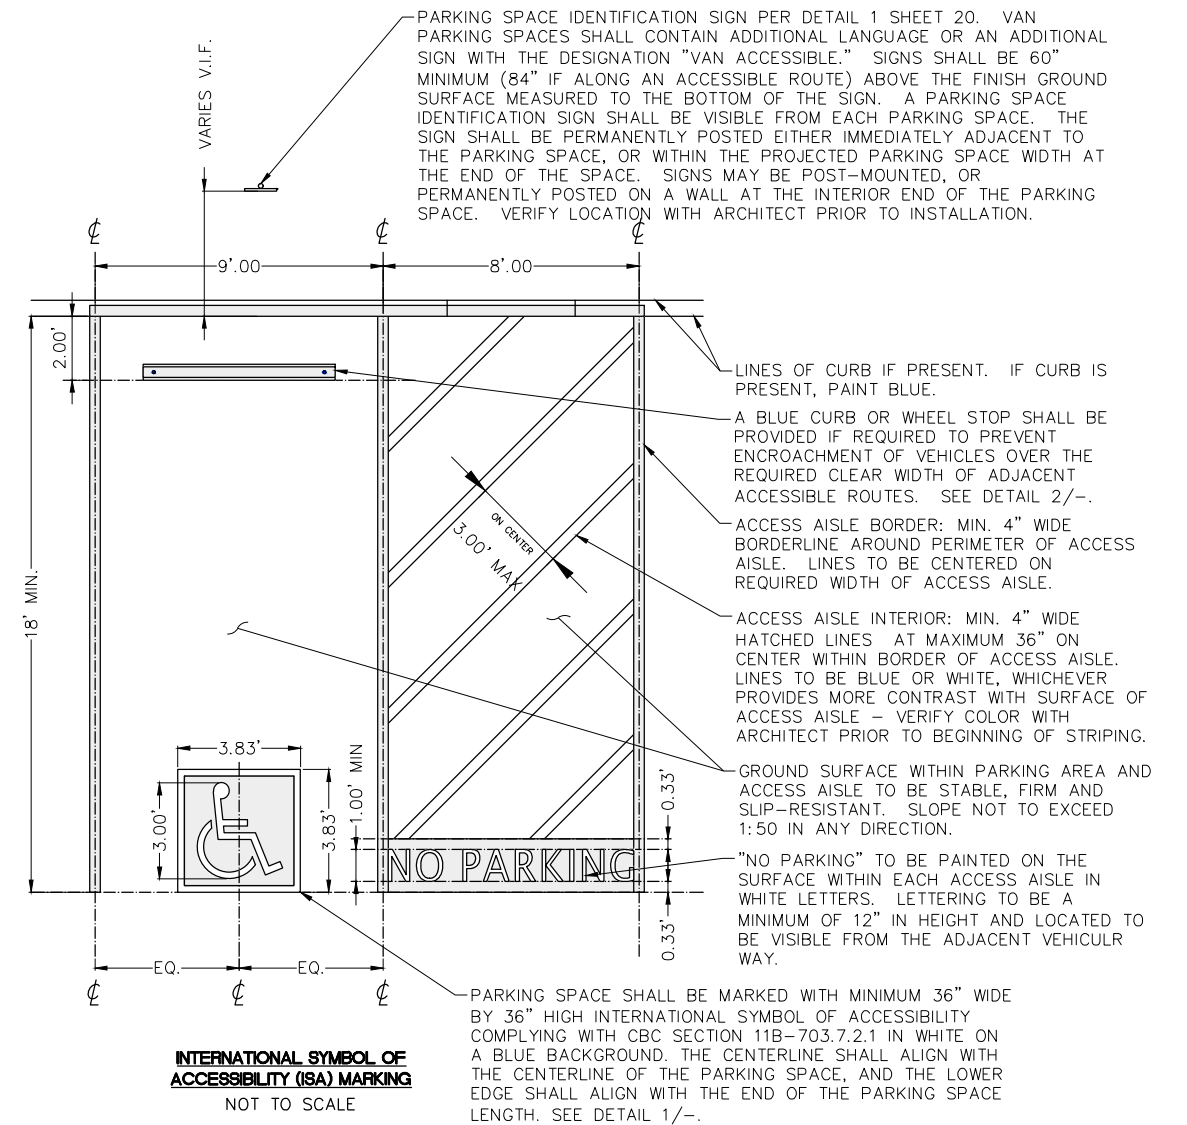


1 INTERNATIONAL SYMBOL OF ACCESSIBILITY (ISA) MARKING
NOT TO SCALE

2 CONCRETE WHEEL STOP
NOT TO SCALE

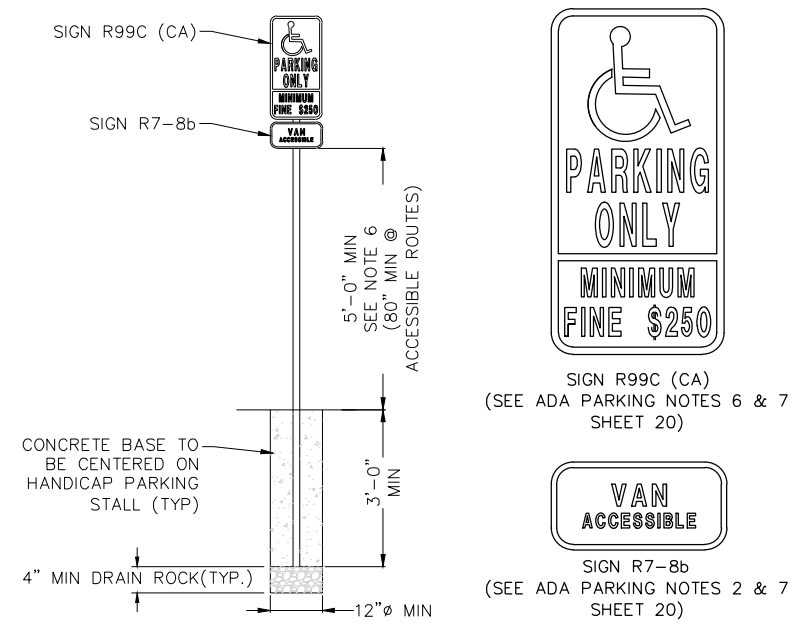


① **ADA SIGN POLE DETAIL**
NOT TO SCALE

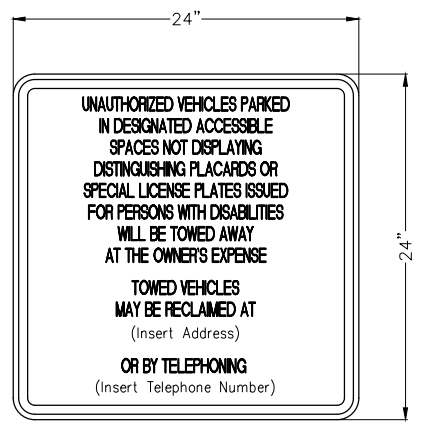


SIGN R7-8b
(SEE ADA PARKING NOTES 8 SHEET 20)


② **OFF-STREET PARKING SIGNS**
NOT TO SCALE

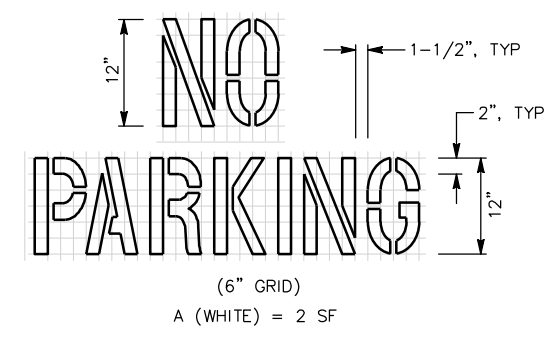

③ **LOADING + UNLOADING AREA PAVEMENT MARKING LEGEND**
NOT TO SCALE



MATERIAL REQUIREMENTS				
REBAR SCHEDULE				
BAR NO.	QUANTITY	LENGTH (IN.)	DESCRIPTION	WEIGHT
A	52	134	# 5 @ 12 O.C.	515
B	40	150	# 5 @ 12 O.C.	522
C	52	52	# 5 @ 12 O.C.	235
D	20	150	# 5 @ 12 O.C.	261
E	25	866	# 5 @ 12 O.C.	2957
F	146	150	# 5 @ 12 O.C.	3903
G	15	32	# 5 @ 8 O.C.	45
H	15	24	# 5 @ 8 O.C.	33
J	32	24	# 5 @ 8 O.C.	67
K	48	35	# 5 @ 8 O.C.	146
L	140	52	# 5 @ 12 O.C.	633
M	20	834	# 5 @ 12 O.C.	1492
TOTAL WEIGHT OF REBAR (LBS.)				7766
TOTAL LENGTH OF REBAR (FT.)				7446
CONCRETE SCHEDULE				
VOLUME (CUBIC YARDS)				
APPROACHES	9.7			
FLOOR	34.8			
PIERS	4.2			
WALLS	25.6			
TOTAL	74.2			
MISC. STEEL				
PIT COPING	3 X 3 X 1/4	155 LN./FT	809 LBS	

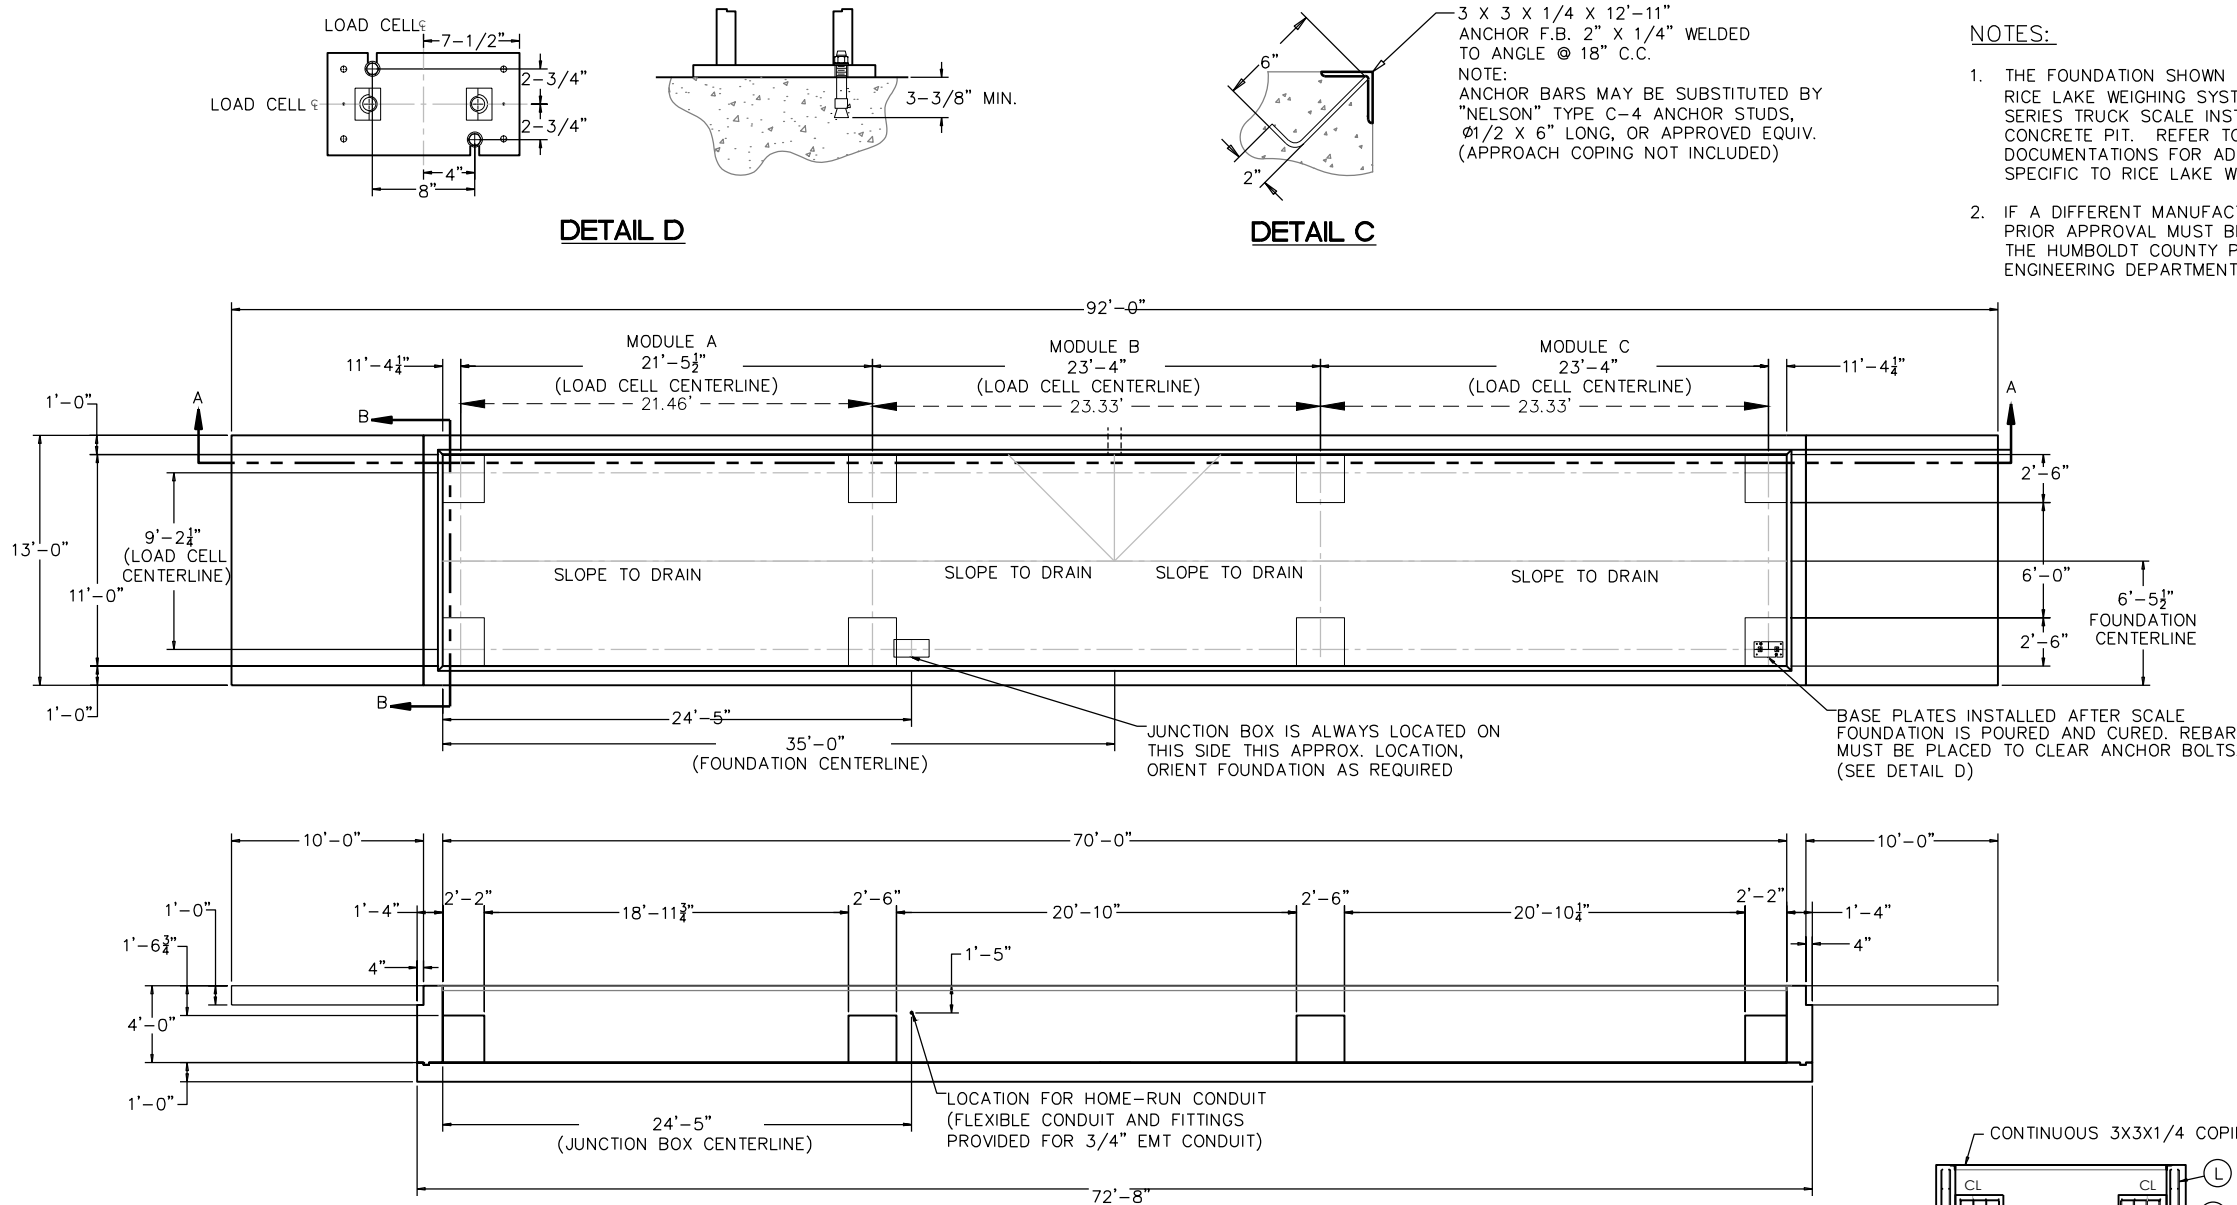

- NOTES:**
1. THE FOUNDATION SHOWN IS DESIGNED FOR THE RICE LAKE WEIGHING SYSTEMS 70' X 11' OTR SERIES TRUCK SCALE INSTALLED IN A CONCRETE PIT. REFER TO THE SUPPLEMENTAL DOCUMENTATIONS FOR ADDITIONAL DETAILS SPECIFIC TO RICE LAKE WEIGHING SYSTEMS.
 2. IF A DIFFERENT MANUFACTURER IS SELECTED, PRIOR APPROVAL MUST BE OBTAINED FROM THE HUMBOLDT COUNTY PUBLIC WORKS ENGINEERING DEPARTMENT.


- NOTES:**
- 1) CONCRETE: $f'_c = 3500$ PSI @ 28 DAYS.
 - 2) REINFORCING STEEL: DEFORMED BARS ASTM A615 GRADE 60.
 - 3) STATE AND LOCAL AGENCIES MAY HAVE VARIOUS REQUIREMENTS FOR APPROACH RAMP LENGTH, PITCH, AND FOR CLEAN OUT HEIGHT. PLEASE CHECK WITH ALL AGENCIES PRIOR TO CONSTRUCTION.
 - 4) MONOLITHIC POUR OF SLAB AND PIERS IS ALLOWED AT CONTRACTOR'S DISCRETION.
 - 5) DEVELOP AND MAINTAIN SITE GRADES WHICH WILL RAPIDLY DRAIN SURFACE AND ROOF RUN-OFF AWAY FROM FOUNDATION.
 - 6) FOOTINGS HAVE BEEN DESIGNED FOR A MINIMUM SOIL PRESSURE OF 3000 PSF, IT WILL BE THE RESPONSIBILITY OF OTHERS TO VERIFY THIS VALUE.
 - 7) WHERE REINFORCING BARS ARE SHOWN CONTINUOUS, LAP SPLICE BARS 40 DIAMETERS.
 - 8) APPROACHES TO BE A COMMON PLANE WITHIN 1/4".
 - 9) IF FROST CAN PENETRATE BELOW FOUNDATION, AT LEAST 18 INCHES OF WELL DRAINED, COMPACTED BASE MATERIAL MUST BE PROVIDED UNDER FOUNDATION




ROAD NAME: CONSERVATION CAMP RD		HUMCO	
ROAD NO:	MILE POST:	DESIGNED BY: ENGR	
PROJECT NO: 438005		DRAWN BY: PBS	
DRAWING FILE NAME: RTS_CONSTRUCTION DETAILS		REVIEWED BY: JAB	
PLOT DATE: 08/19/2025	REVISION DATE:	APPROVED BY: TRS	

SHEET
23
OF
58


COUNTY OF HUMBOLDT
DEPARTMENT OF PUBLIC WORKS
REDWAY TRANSFER STATION
**MANUFACTURES WEIGH SCALE
FOUNDATION PLAN**

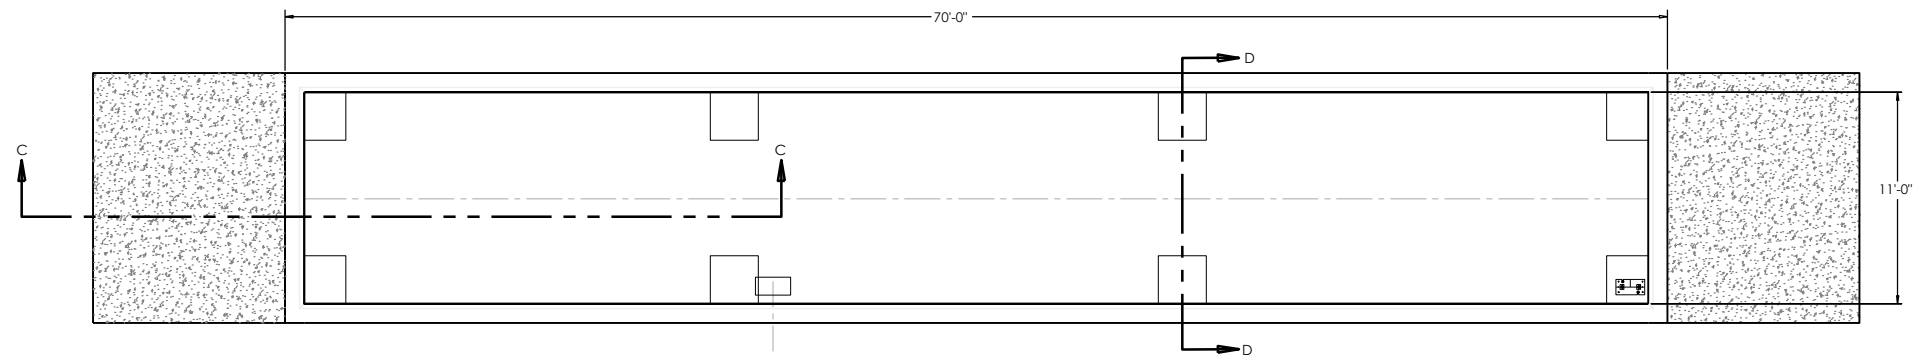


TRUCK SCALE PLAN VIEW
SCALE: 1"=5'

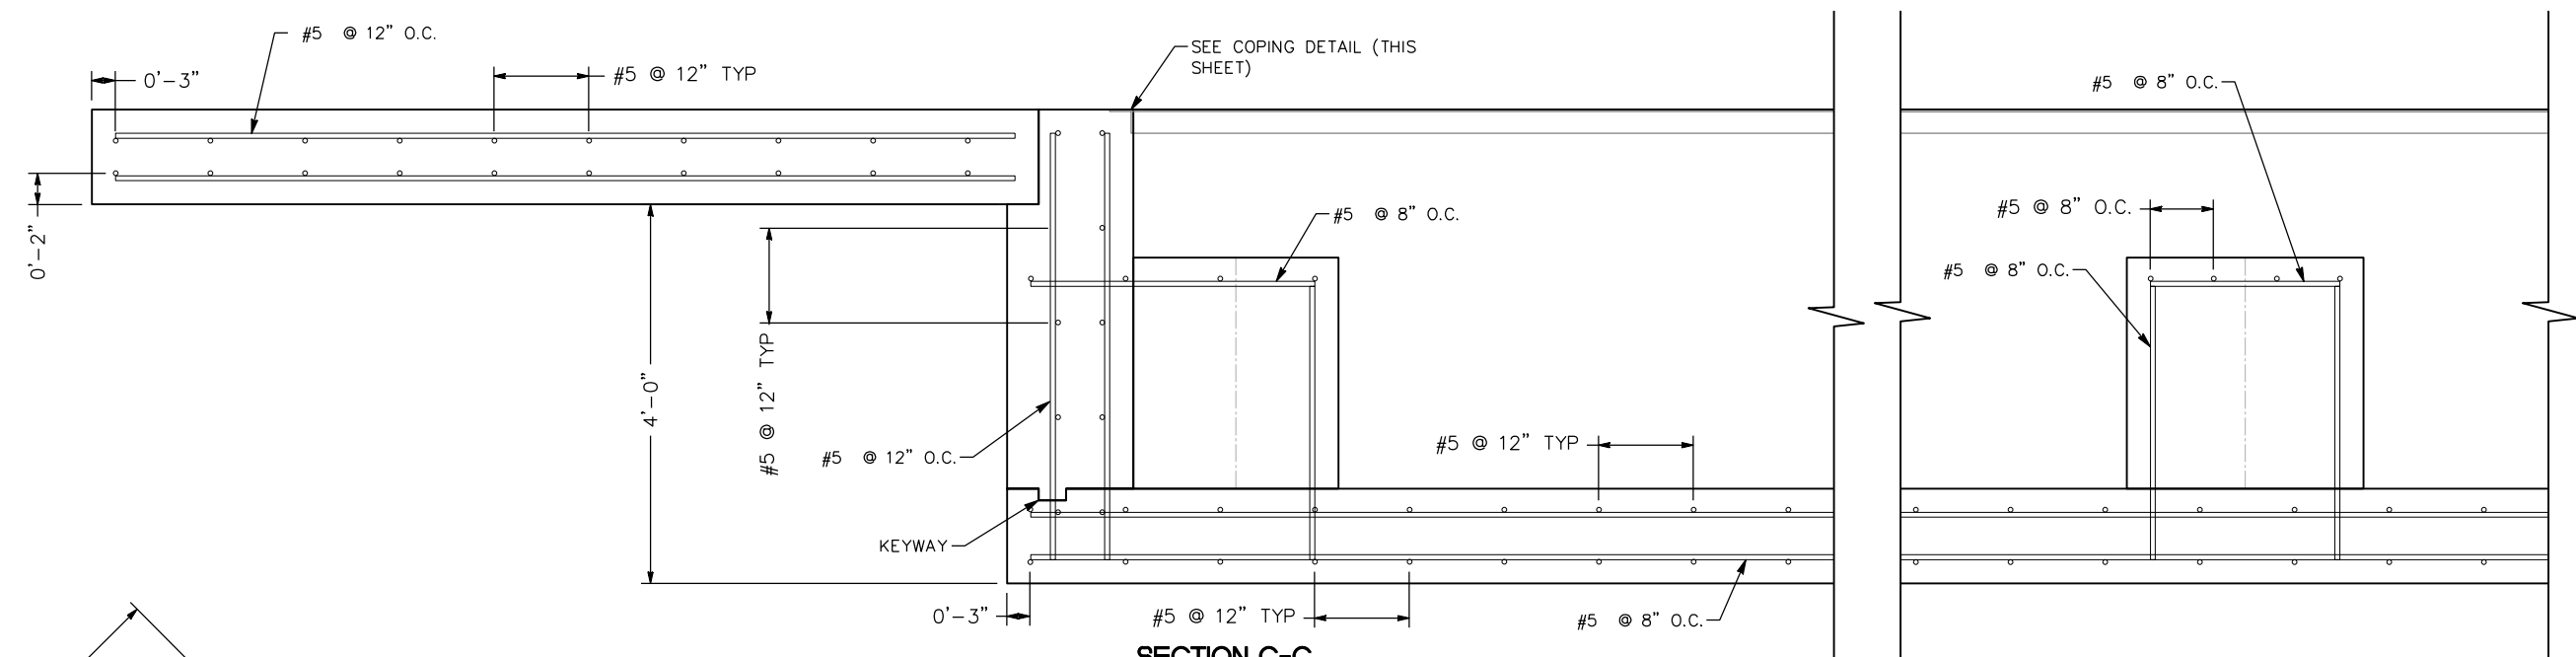

SECTION C-C
NOT TO SCALE

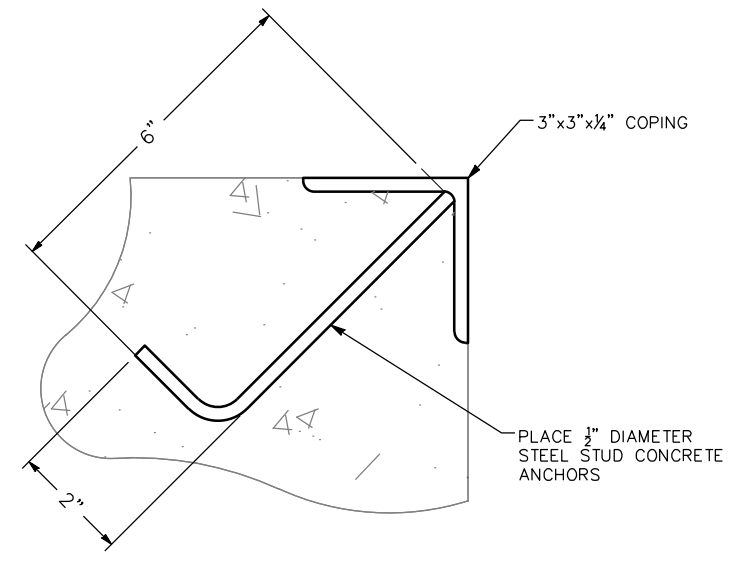

DETAIL A
NOT TO SCALE

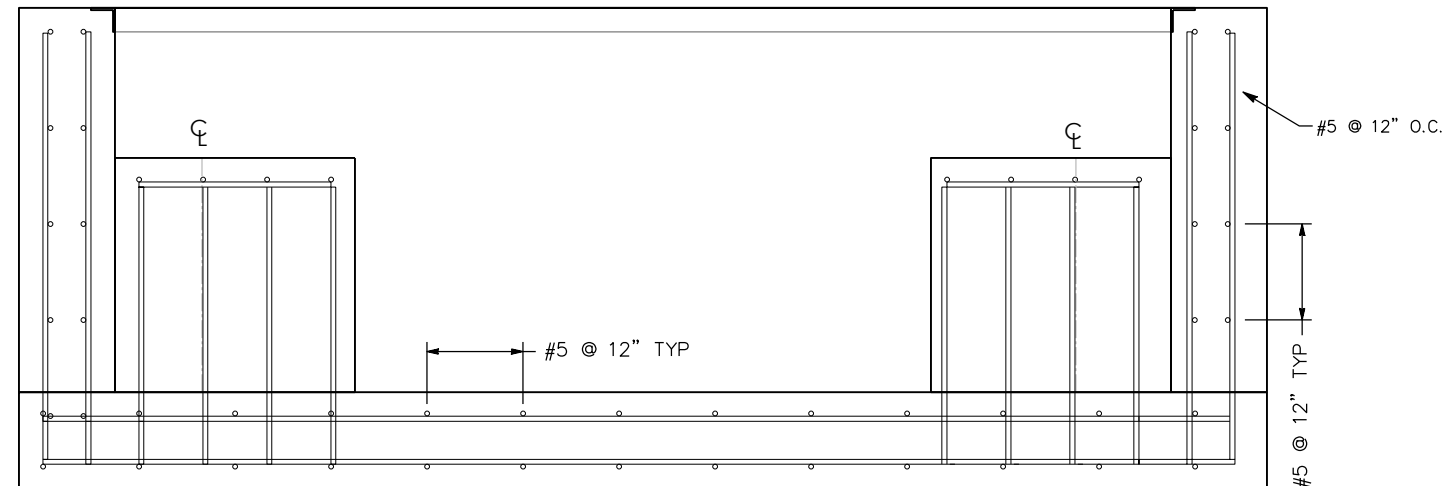

SECTION D-D
NOT TO SCALE

GENERAL NOTES:

- GENERAL
 - ALL WORK SHALL COMPLY WITH LOCAL CODES, CALTRANS 2024 STANDARDS AND SPECIFICATION, AND APPLICABLE ASTM STANDARDS.
 - FENCE INSTALLATION TO BE COMPLETED PER MANUFACTURER'S RECOMMENDATIONS AND STANDARD INDUSTRY PRACTICES.
 - CONTRACTOR TO VERIFY ALL FENCE LOCATIONS AND PROPERTY BOUNDARIES PRIOR TO INSTALLATION.
- ANY DISCREPANCIES SHALL BE REPORTED TO THE RESIDENT ENGINEER.


GATE NOTES:

- FRAME MATERIAL GRADE AS PER WRITTEN SPECIFICATIONS. PIPE SECTIONS FOR POSTS, BRACES, AND GATES SHALL BE SCHEDULE 40 GALVANIZED PIPE.
- ALL MATERIAL SHOWN SHALL BE NEW GALVANIZED STEEL UNLESS OTHERWISE NOTED.
- GATE DIMENSIONS AND POST LOCATIONS ARE NOMINAL AND ARE TO BE FIELD VERIFIED PRIOR TO INSTALLATION.
- SECURITY GATE, AND ALL NEW LENGTH OF FENCE, SHALL INCLUDE 3 STRANDS OF BARBED WIRE ON TOP.
- GALVANIZED BOLTS AND NUTS FOR ATTACHING BRACES AND STRAPS TO GALVANIZED DEVICES FOR HOLDING BARBED WIRE IN PLACE MUST BE COMMERCIAL QUALITY.
- CHAIN LINK GATE FRAMES SHALL BE A MINIMUM OF 1-7/8" PIPE WEIGHING 2.72 LBS/FT. MATERIAL AND CONSTRUCTION SHALL MEET CALTRANS 2024 STANDARD PLAN A85A AND A86, AT A MINIMUM, OR APPROVED EQUAL.




BAR IS ONE INCH ON ORIGINAL DRAWING IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY	ROAD NAME: CONSERVATION CAMP RD	HUMCO	COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS	SHEET 24 OF 58
	ROAD NO:	MILE POST:	DESIGNED BY: ENGR	
	PROJECT NO.: 438005		DRAWN BY: PBS	CONSTRUCTION DETAILS
	DRAWING FILE NAME: RTS_DETAILS AND CROSS SECTIONS		REVIEWED BY: JAB	
	PLOT DATE: 08/19/25		APPROVED BY: TRS	

GATE PLAN

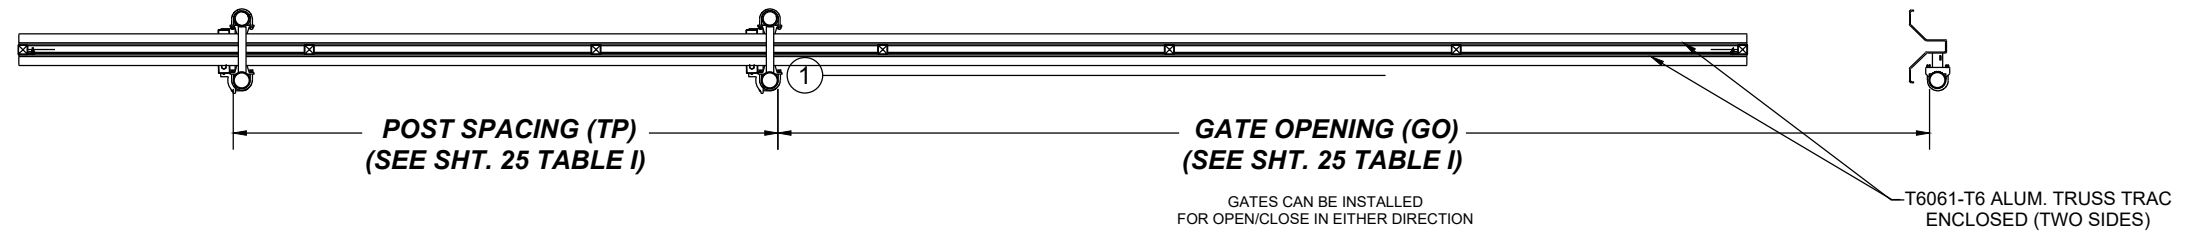

OVERALL GATE LENGTH
(REF. PAGE 24.1 TABLE I)

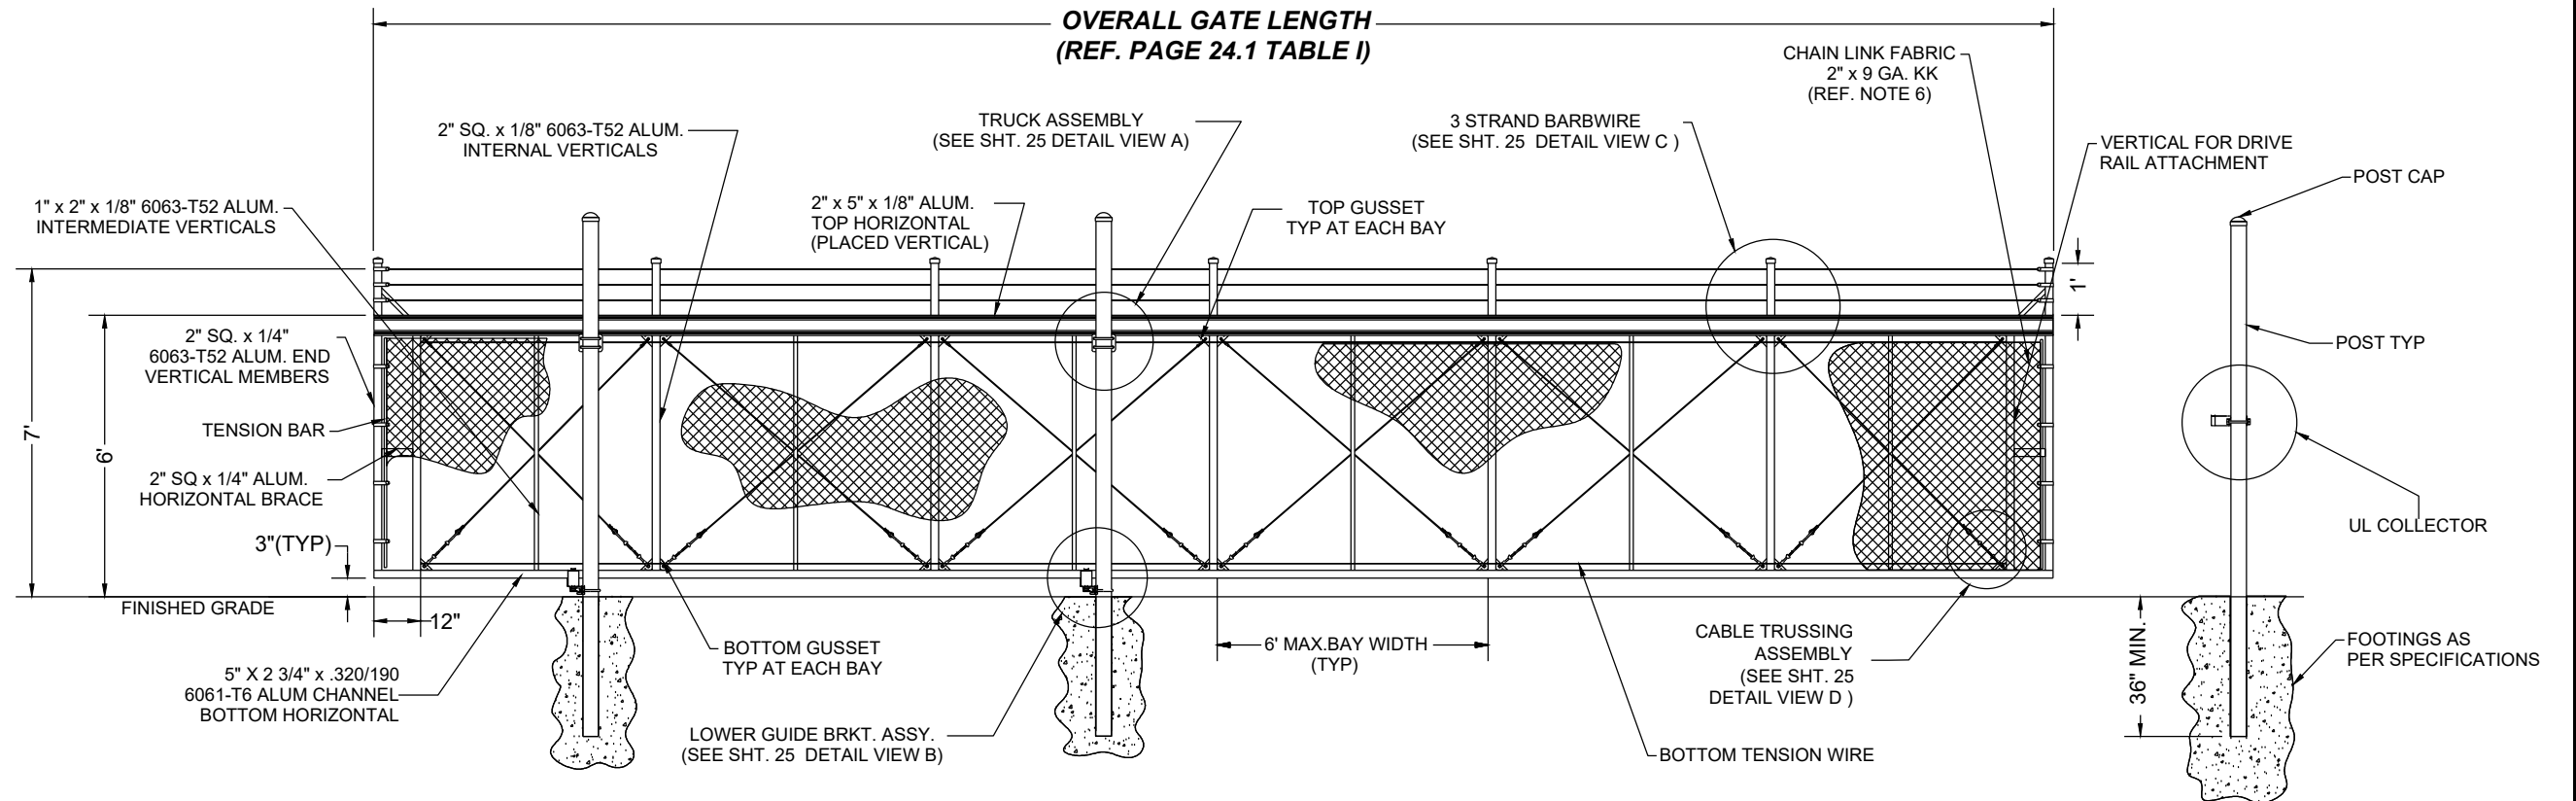

1 GATE ELEVATION


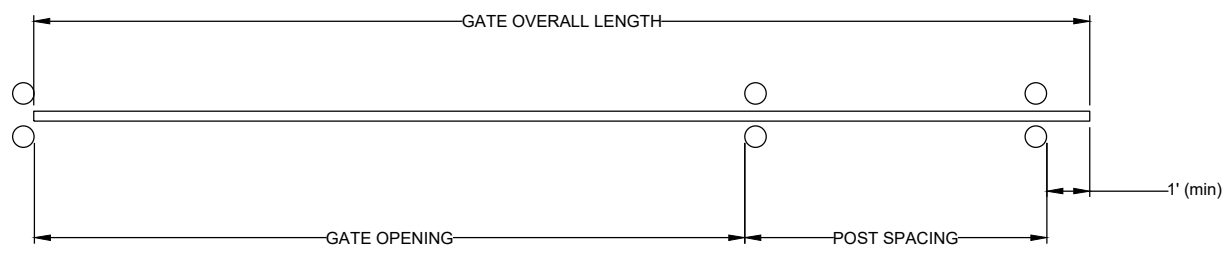



TABLE I: GATE OVERALL LENGTH AND POST SPACING CALCULATIONS

GATE OVERALL LENGTH = GATE OPENING x 1.5
POST SPACING = 1/2 GATE OPENING - 1 FT (min)

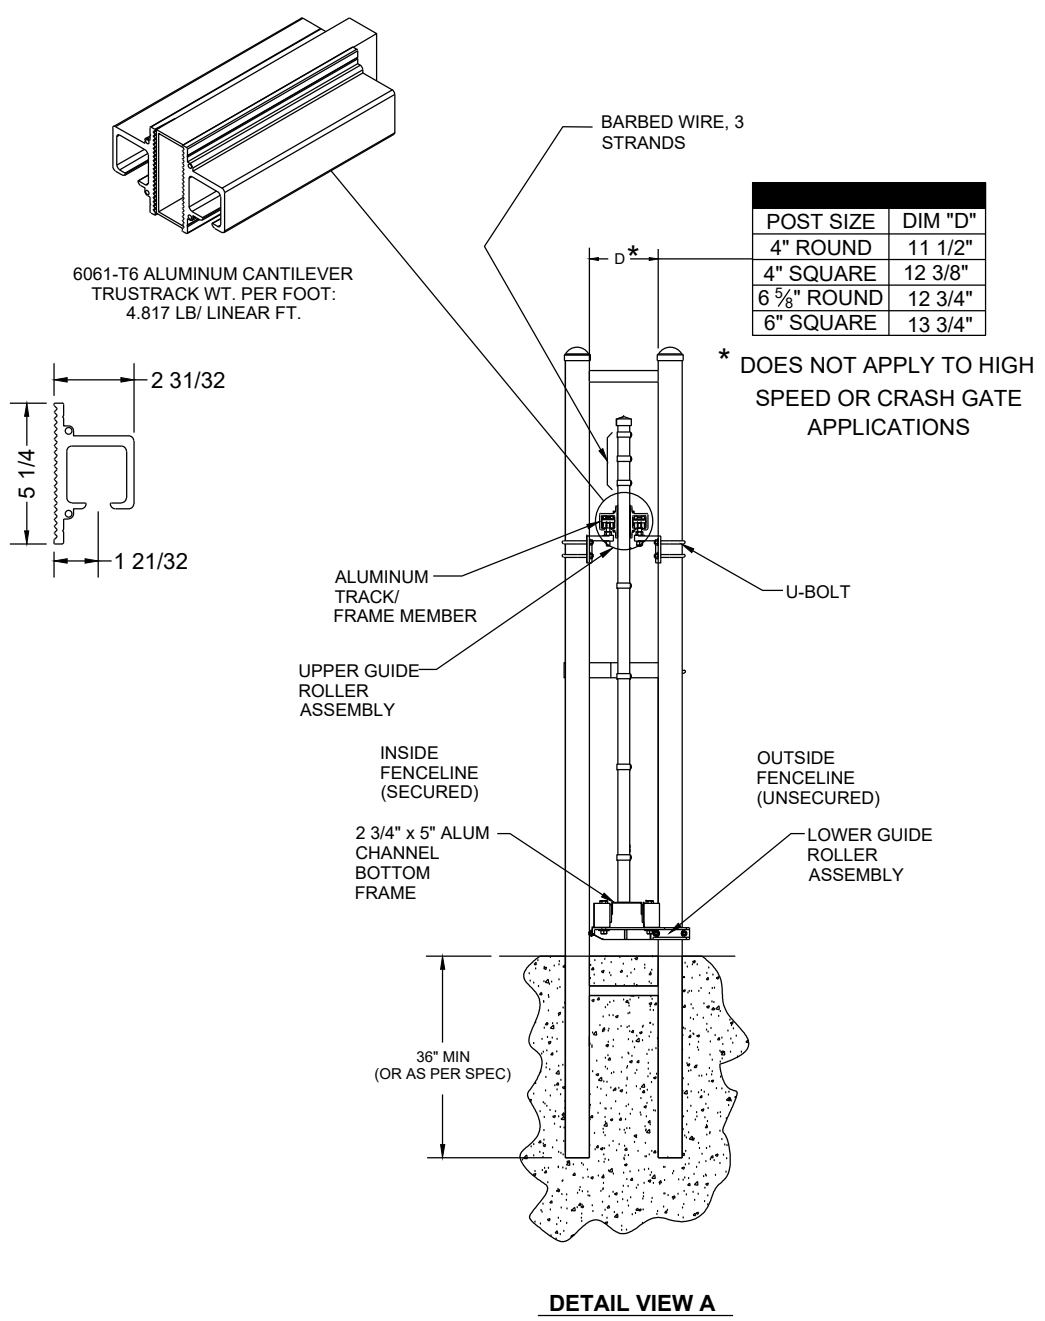

POST SIZE	DIM "D"
4" ROUND	11 1/2"
4" SQUARE	12 3/8"
6 5/8" ROUND	12 3/4"
6" SQUARE	13 3/4"

* DOES NOT APPLY TO HIGH SPEED OR CRASH GATE APPLICATIONS

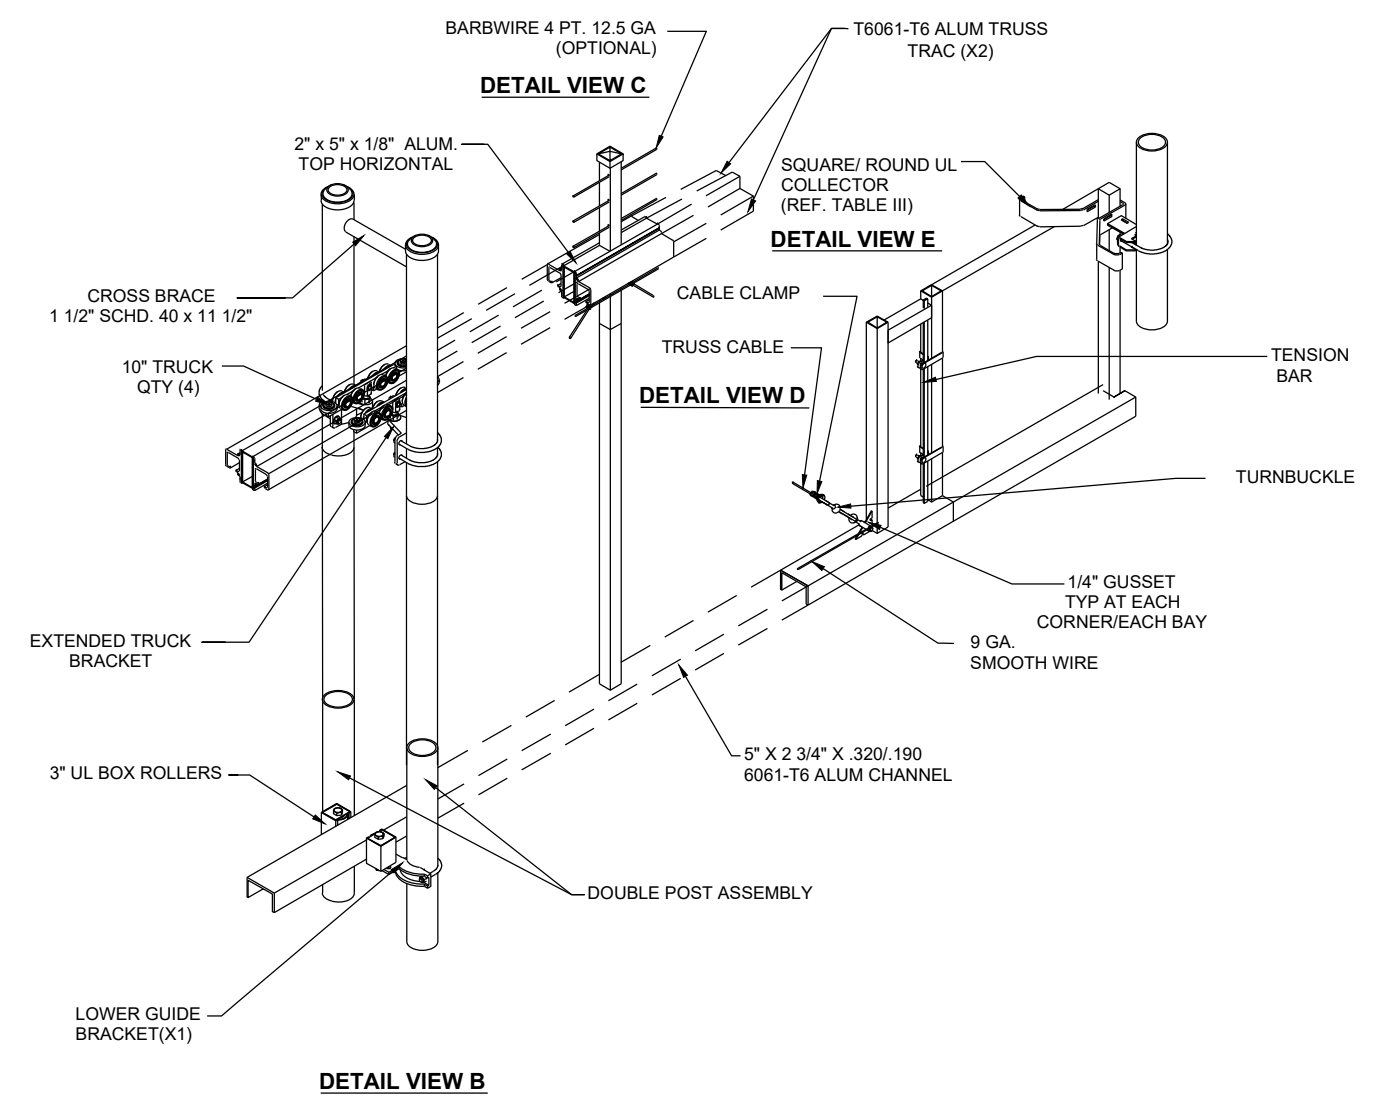

GENERAL NOTES:

- GENERAL
 - ALL WORK SHALL COMPLY WITH LOCAL CODES, CALTRANS 2024 STANDARDS AND SPECIFICATION, AND APPLICABLE ASTM STANDARDS.
 - FENCE INSTALLATION TO BE COMPLETED PER MANUFACTURER'S RECOMMENDATIONS AND STANDARD INDUSTRY PRACTICES.
 - CONTRACTOR TO VERIFY ALL FENCE LOCATIONS AND PROPERTY BOUNDARIES PRIOR TO INSTALLATION.
- ANY DISCREPANCIES SHALL BE REPORTED TO THE RESIDENT ENGINEER OR HUMBOLDT COUNTY PUBLIC WORKS PERSONNEL

CHAIN LINK SECURITY FENCE NOTES:


- PIPE SECTIONS FOR POSTS, RAILS, BRACES AND GATES SHALL BE SCHEDULE 40 GALVANIZED PIPE MANUFACTURED IN CONFORMANCE WITH ASTM F 1083.
- CHAIN LINK GATE FRAMES SHALL BE A MINIMUM OF 1-7/8" PIPE WEIGHING 2.72 LBS/FT.
- DIMENSIONS SHOWN ARE NOMINAL.
- BARBED WIRE FOR SECURITY FENCING SHALL HAVE FOUR POINTS BARBS AND IN CONFORMANCE WITH ASTM A 121.
- BARBED WIRE SHALL BE COMMERCIAL QUALITY CLASS 1 12-1/2 GAGE, CLASS 2 13-1/2 GAGE, OR CLASS 3 12-1/2 GAGE.
- GALVANIZED BOLTS AND NUTS FOR ATTACHING BRACES AND STRAPS TO GALVANIZED DEVICES FOR HOLDING BARBED WIRE IN POSITION MUST BE COMMERCIAL QUALITY.
- LINE AND CORNER POSTS SHALL INCLUDE 3 STRANDS OF BARBED WIRE FOR THE LENGTH OF THE FENCE.

METAL T-POST FENCE NOTES:


- FENCE TYPE
 - FENCE TO CONSIST OF COMMERCIAL-GRADE METAL T-POSTS WITH THREE STRANDS OF TWO POINT BARBED WIRE SPACED AT 10" APART AND ONE SMOOTH WIRE AT THE BOTTOM AT 14" FROM FINISH GROUND.
 - WIRE TYPE: STANDARD DOUBLE STRAND BARBED WIRE.
 - MINIMUM WIRE SIZE: 12-1/2 GAUGE WITH 14 GAUGE OR HEAVIER TWO-POINT BARBS SPACED NOT MORE THAN 5 INCHES APART.
 - MINIMUM PROTECTIVE COATING: CLASS I GALVANIZED COATING PER ASTM A121.
 - STRAND-BREAKING STRENGTH: MINIMUM 850 POUNDS OR 60,000 PSI TENSILE STRENGTH.
 - BOTTOM WIRE: 12.5-GAUGE GALVANIZED SMOOTH WIRE FOR ANIMAL SAFETY OR PER PROJECT REQUIREMENTS.
 - TOTAL FENCE HEIGHT: [INSERT HEIGHT, E.G., 5 FEET] ABOVE FINISHED GRADE.
- POST INSTALLATION
 - T-POSTS SHALL BE SPACED AT A MAXIMUM OF 10 FEET ON CENTER UNLESS NOTED OTHERWISE.
 - T-POSTS SHALL BE DRIVEN TO A MINIMUM DEPTH OF 2.5 FEET, OR AS REQUIRED FOR STRUCTURAL STABILITY.
 - ALL TERMINAL AND CORNER POSTS SHALL BE GALVANIZED SCHEDULE 40 STEEL PIPE SET IN CONCRETE FOOTINGS.
 - BRACING ASSEMBLIES (H-BRACES OR DIAGONAL TENSION BRACING) TO BE PROVIDED AT CORNERS AND END POSTS.
- WIRE INSTALLATION
 - THREE STRANDS OF WIRE SHALL BE EVENLY SPACED BETWEEN THE TOP AND BOTTOM OF THE FOURTH STRAND.
 - BOTTOM STRAND SHALL CONSIST OF SMOOTH WIRE TO REDUCE INJURY RISK FOR ANIMALS OR PERSONNEL.
 - WIRE SHALL BE PULLED TAUT, FREE OF SLACK, AND ATTACHED TO EACH POST USING GALVANIZED CLIPS, PRE-FORMED WIRE TIES, OR SIMILAR FASTENERS APPROVED BY THE MANUFACTURER.
 - BARBS SHALL FACE OUTWARD FROM THE SECURED AREA UNLESS OTHERWISE DIRECTED BY THE RESIDENT ENGINEER OR HUMBOLDT COUNTY PUBLIC WORKS PERSONNEL.
- CLEARING & GRADING
 - CLEAR FENCE LINE OF ALL VEGETATION, ROCKS, AND OBSTRUCTIONS TO A MINIMUM WIDTH OF 3 FEET.
 - GRADE MINOR RISES AND DEPRESSIONS TO ALLOW FENCE WIRE TO CLOSELY FOLLOW TERRAIN WITHOUT EXCESSIVE GAPS.
- FINISH & PROTECTION
 - ALL WIRE AND METAL COMPONENTS SHALL HAVE CORROSION-RESISTANT COATINGS.
 - FIELD REPAIRS TO COATINGS MUST BE MADE USING COLD GALVANIZING COMPOUND OR MANUFACTURER-APPROVED PAINT.




BAR IS ONE INCH ON ORIGINAL DRAWING IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY	ROAD NAME: CONSERVATION CAMP RD	HUMCO	COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS	SHEET 26 OF 58
	ROAD NO:	MILE POST:	DESIGNED BY: ENGR	
	PROJECT NO: 438005		DRAWN BY: PBS	REDWAY TRANSFER STATION CONSTRUCTION DETAILS
	DRAWING FILE NAME:		REVIEWED BY: JAB	
	PLOT DATE: 08/19/25		APPROVED BY: TRS	

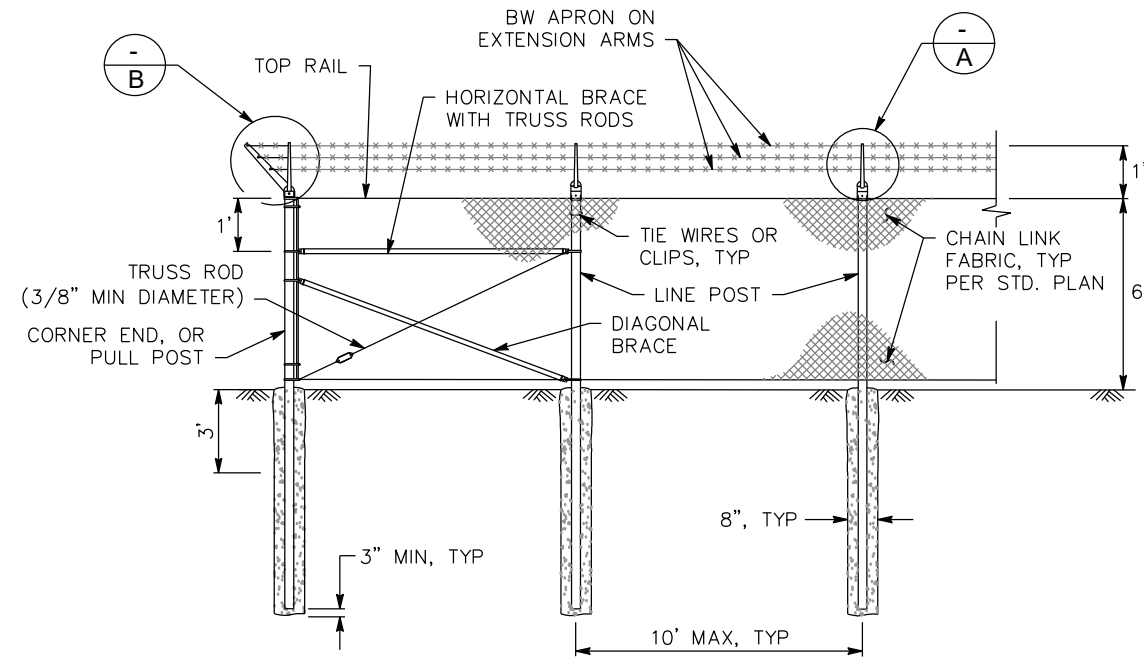

2 CHAIN LINK SECURITY FENCE, TYPICAL DETAIL
NOT TO SCALE

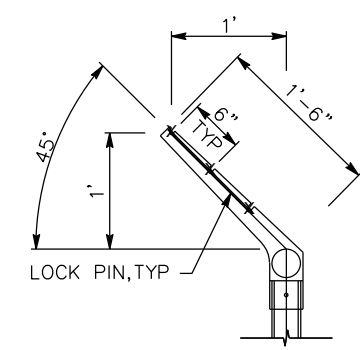


LINE POST
A

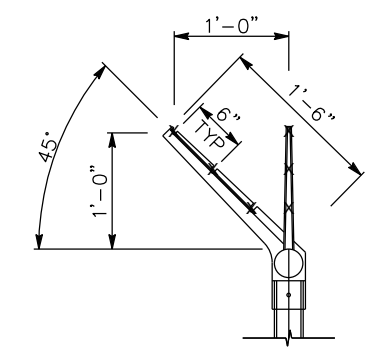

CORNER POST
B

3 BARBED WIRE (POST TOP)
NOT TO SCALE

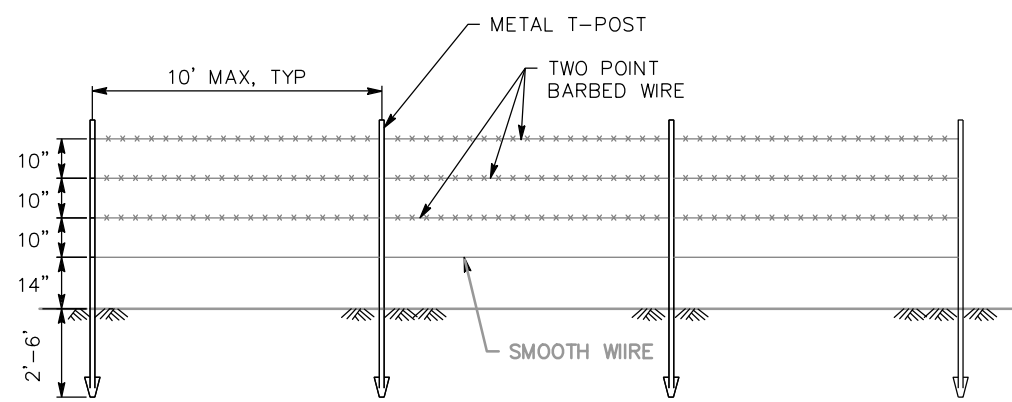


4 METAL T-POST FENCE, TYPICAL DETAIL
SCALE: NTS

NOTES:


- SP = 2024 CALTRANS STANDARD PLANS
SS = 2024 CALTRANS STANDARD SPECIFICATION
- THE CEMENTITIOUS MATERIAL CONTENT TO CONFORM WITH SECTION 90-2.01D OF STATE OF CALIFORNIA DEPARTMENT OF TRANSPORTATION 2024 STANDARD SPECIFICATIONS.




ROAD NAME: CONSERVATION CAMP RD		HUMCO		COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS		SHEET 27 OF 58
ROAD NO:	MILE POST:	DESIGNED BY: ENGR	REDWAY TRANSFER STATION			
PROJECT NO: 438005		DRAWN BY: PBS	CONSTRUCTION DETAILS			
DRAWING FILE NAME:		REVIEWED BY: JAB				
PLOT DATE: 08/19/25		APPROVED BY: TRS				

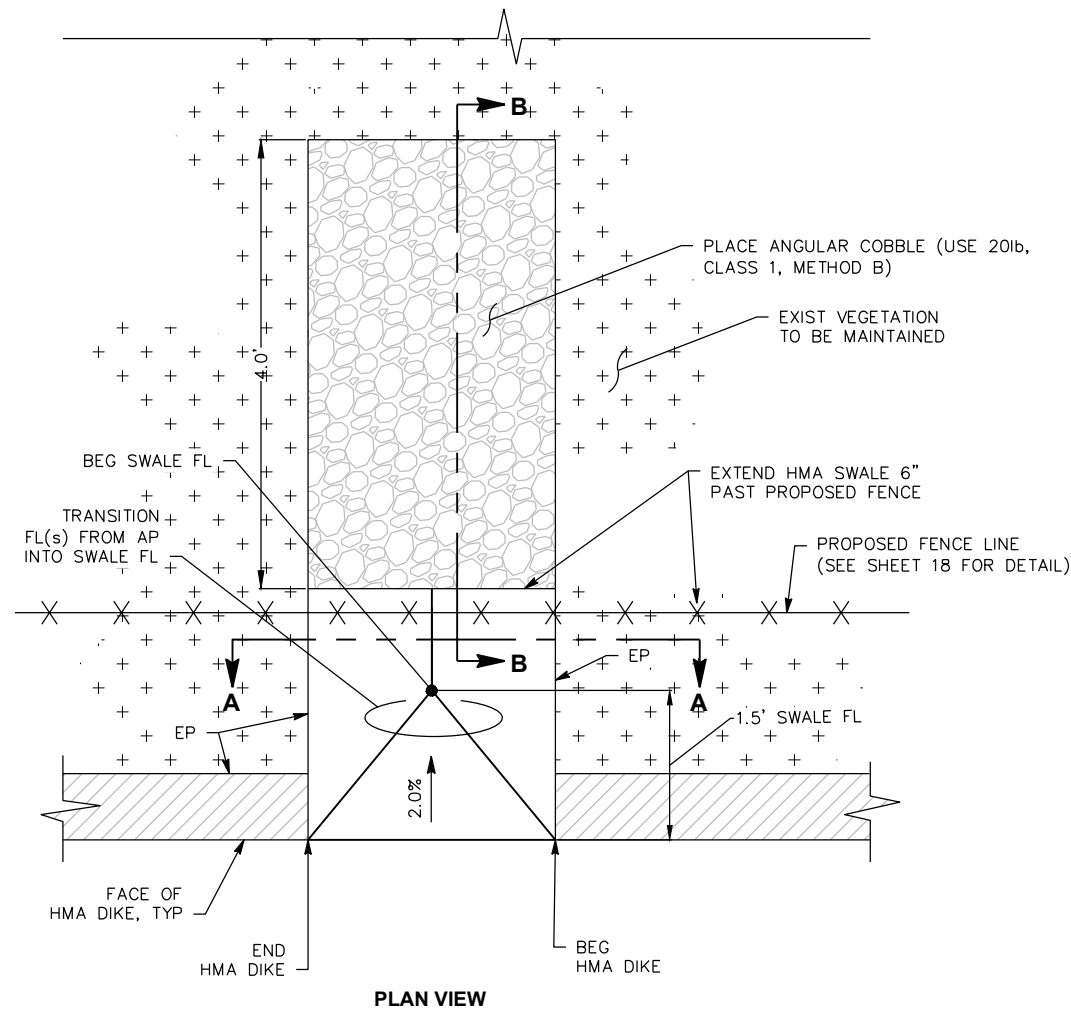


6 HMA SWALE FL TRANSITION AND ROCK DISSIPATOR
NOT TO SCALE

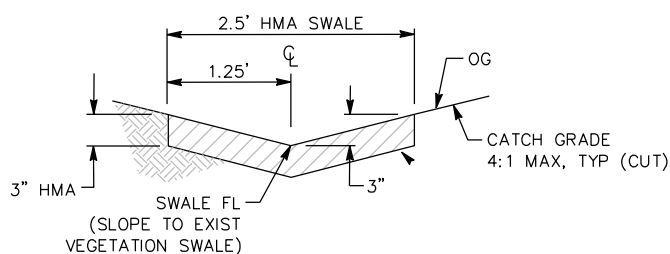


SECTION A-A
NOT TO SCALE

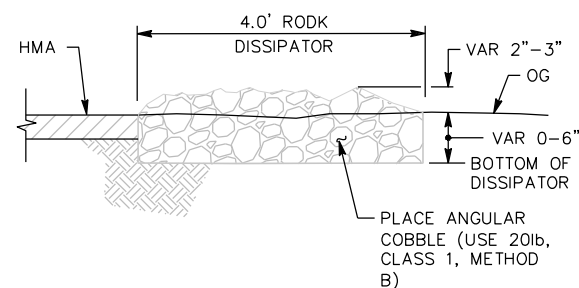


SECTION B-B
NOT TO SCALE

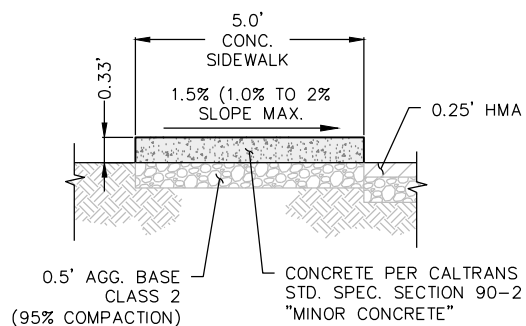

7 TYPICAL SIDEWALK
NOT TO SCALE

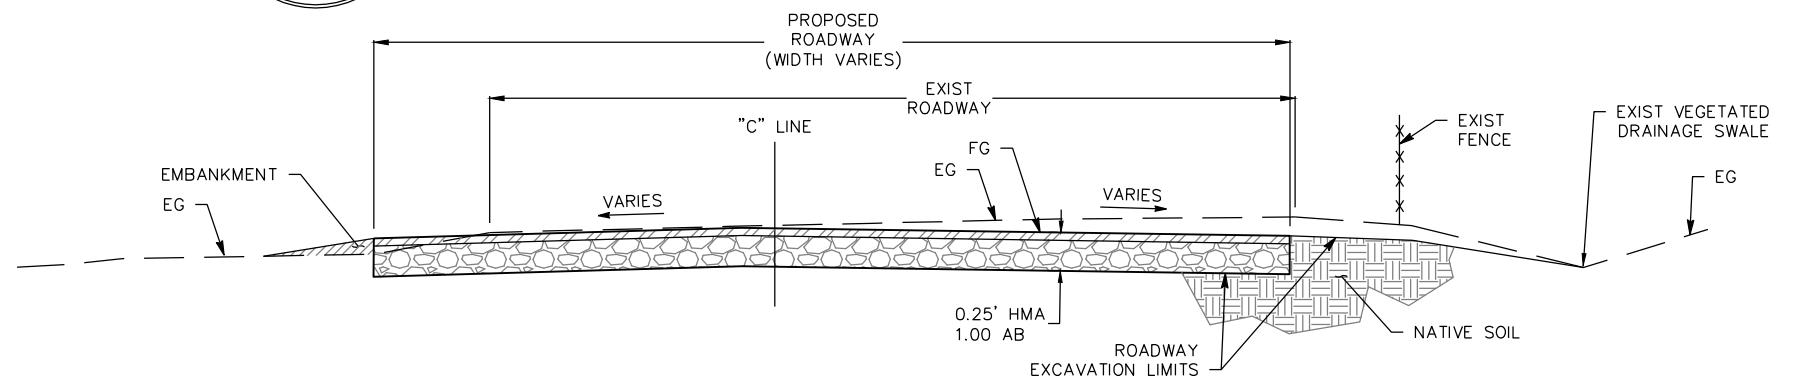


8 TYPICAL ROADWAY SECTION
NOT TO SCALE

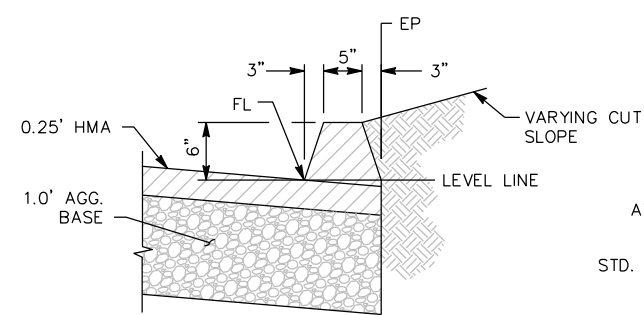


9 HMA DIKE (TYPE A) 11\"/> NOT TO SCALE

EXTEND FINAL/TOP LIFT OF HMA FROM DRIVE AISLE UNDER THE DIKE WITH NO JOINT AT THE EP/FL.

NOTE: DETAIL SHOWN DEFINES HMA AREAS OUTSIDE PARKING STALLS, WITH FLOW TOWARDS THE EP/FL. PARKING STALL HMA (AND PCC-NOT SHOWN IN DETAIL) AREAS WOULD VARY, WITH DRAINAGE FLOWING AWAY FROM MOST EP LOCATIONS.

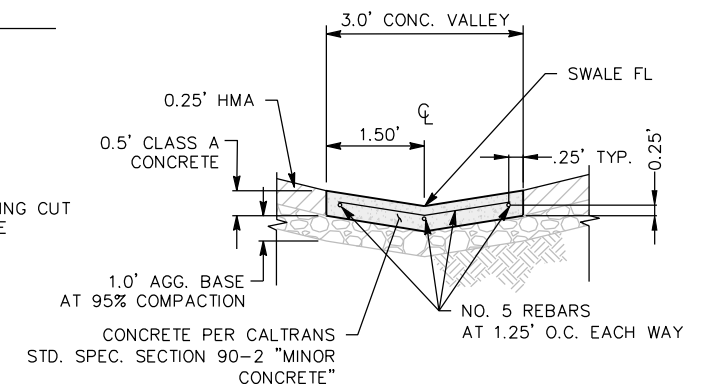

10 CONCRETE VALLEY GUTTER
NOT TO SCALE

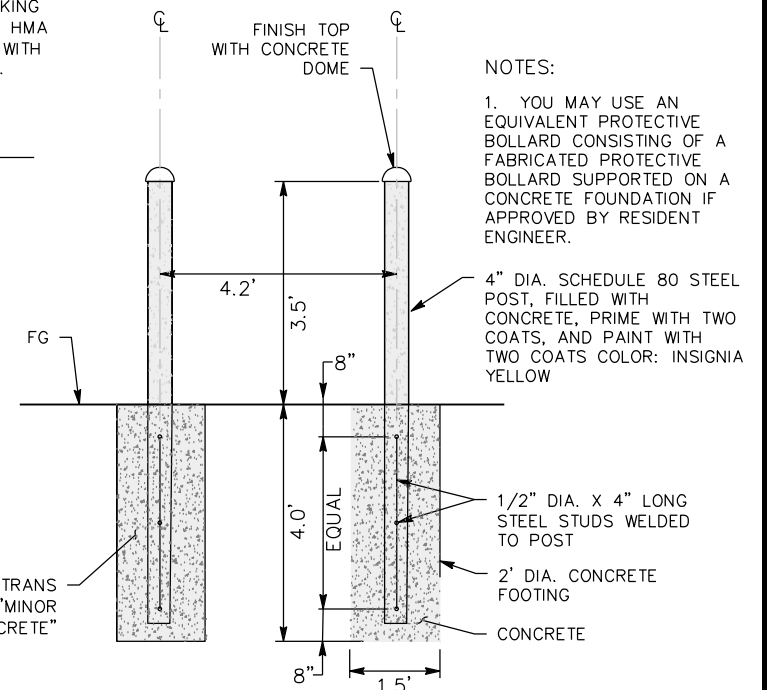


5 PROTECTIVE BOLLARD
NOT TO SCALE

NOTES:

- YOU MAY USE AN EQUIVALENT PROTECTIVE BOLLARD CONSISTING OF A FABRICATED PROTECTIVE BOLLARD SUPPORTED ON A CONCRETE FOUNDATION IF APPROVED BY RESIDENT ENGINEER.




BAR IS ONE INCH ON ORIGINAL DRAWING IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY	ROAD NAME: CONSERVATION CAMP RD.	DESIGN SECTION	COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS REDWAY TRANSFER STATION WEIGH STATION BUILDING ELEVATION PLAN	SHEET 28 OF 56
	PROJECT NO.: 438005	MILE POST:		
	DRAWING FILE NAME: RTS_WEIGHT SHACK	DESIGNED BY: ENGR		
	PLOT DATE: 08/19/2025	DRAWN BY: PBS		
		REVIEWED BY: TRS		
		APPROVED BY: JAB		

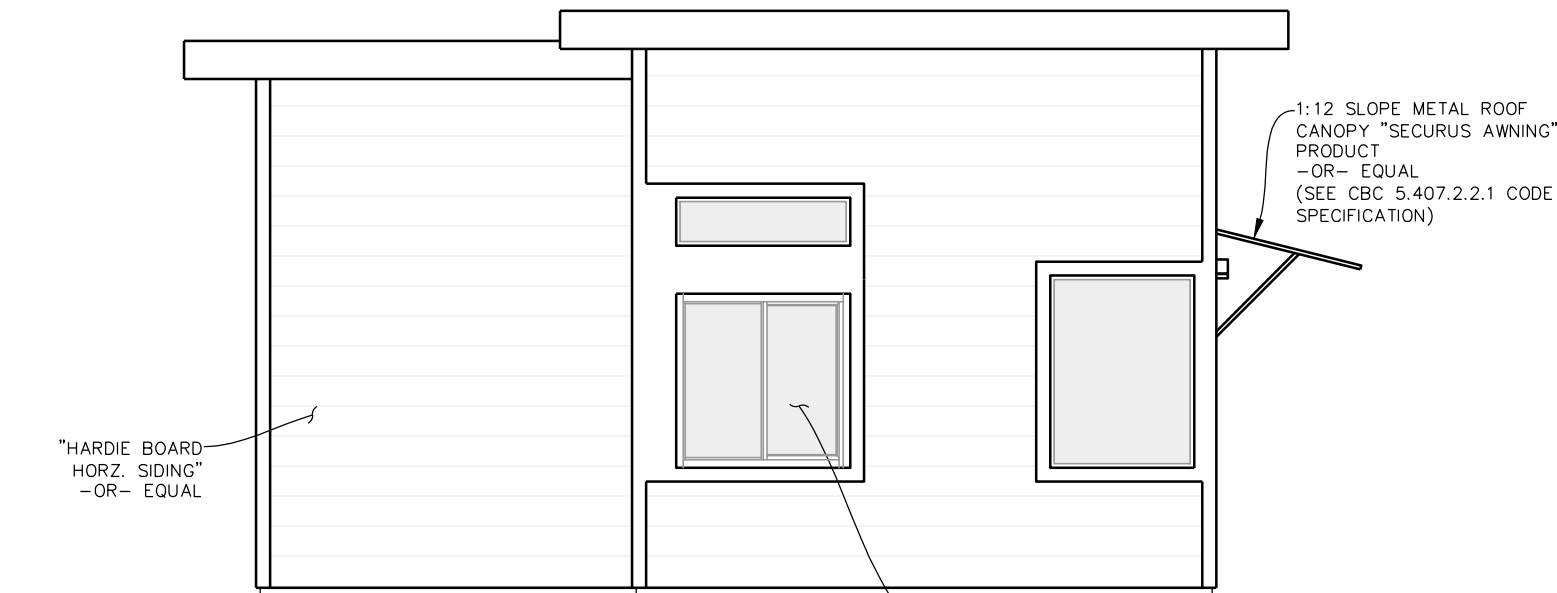

NORTH ELEVATION


SCALE: 1/2" = 1'

SECURITY WINDOW: "READY ACCESS, INC. " PART # 275 LOW PROFILE SINGLE PANEL SLIDER (ADA COMPLIANT) -OR- APPROVED EQUIVALENT BY ENGINEER PASS THROUGH ADA WINDOW

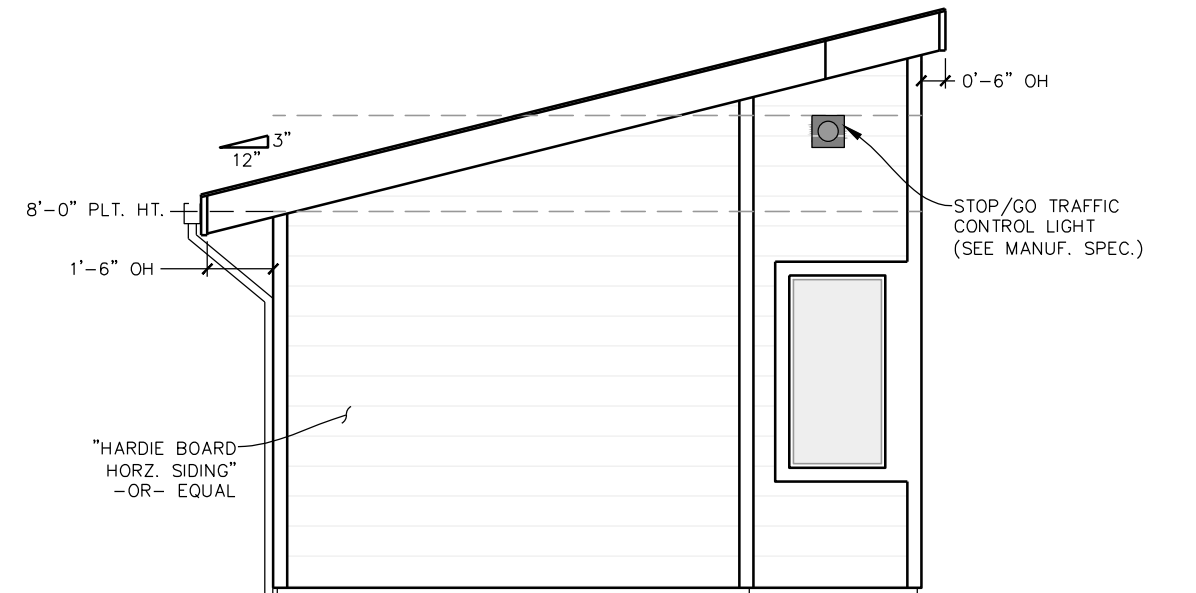


EAST ELEVATION

SCALE: 1/2" = 1'

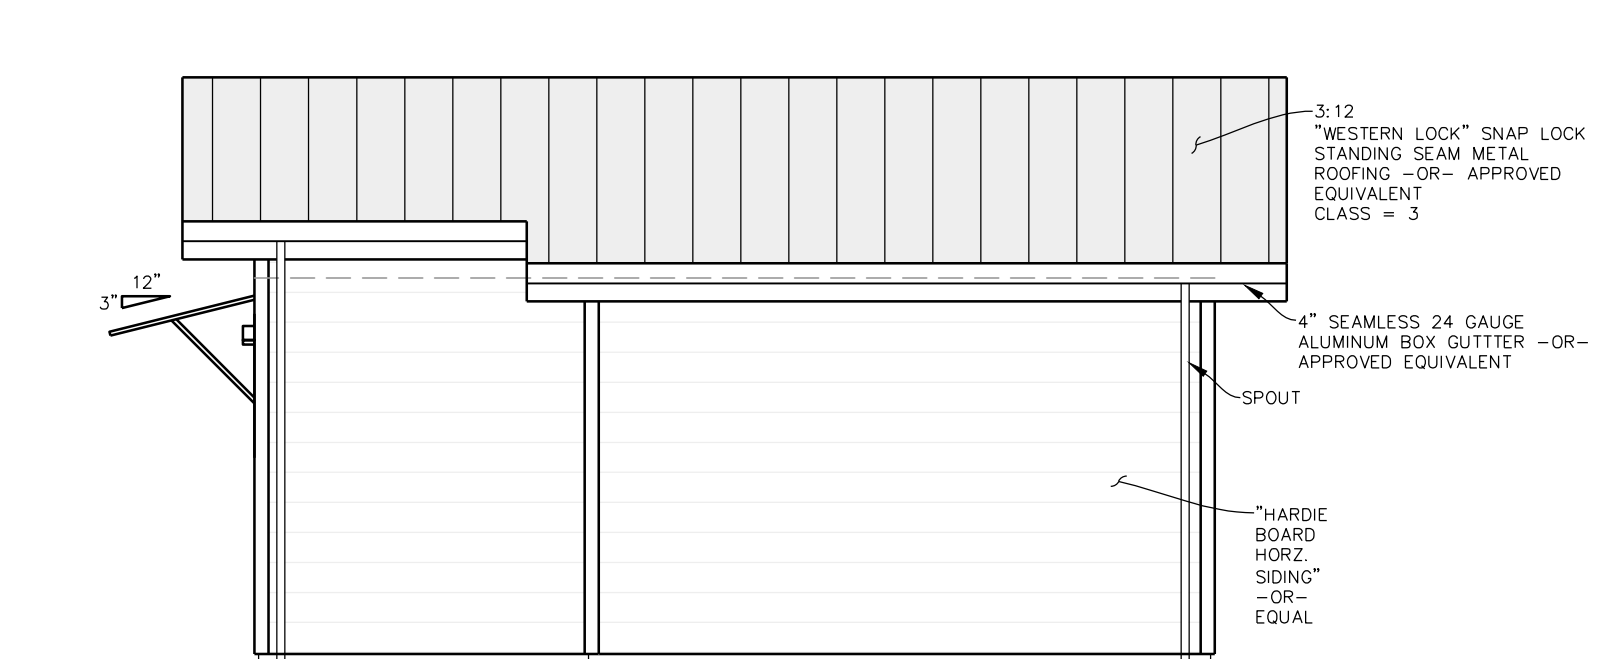

SOUTH ELEVATION

SCALE: 1/2" = 1'

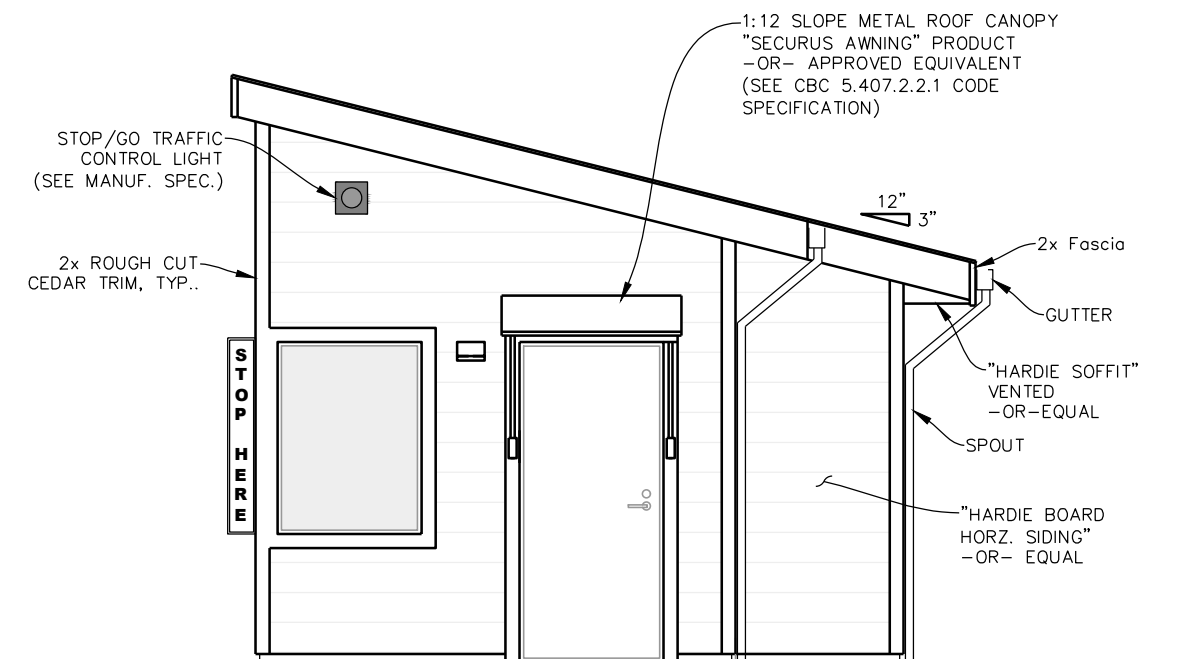

WEST ELEVATION

SCALE: 1/2" = 1'




BAR IS ONE INCH ON ORIGINAL DRAWING IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY	ROAD NAME: CONSERVATION CAMP RD.	DESIGN SECTION: ENGINEERING	COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS REDWAY TRANSFER STATION WEIGH STATION BUILDING FLOOR PLAN	SHEET 29 OF 56	
	PROJECT NO.: 438005	MILE POST:			DESIGNED BY: ENGR
	DRAWING FILE NAME: RTS_WEIGHT SHACK				DRAWN BY: PBS
	PLOT DATE: 08/19/2025				REVIEWED BY: TRS APPROVED BY: JAB



SCALE 1" = 1'

FIRE SAFE NOTES (CBC CHAPTER 7A):

- DEFENSIBLE SPACE MUST BE SIGNED OFF PRIOR TO SHEET ROCK INSPECTION (5', 30', AND 100' DEFENSIBLE SPACES AROUND STRUCTURES PER CALFIRE).
- ROOF ASSEMBLY TO BE CLASS A RATED TO MEET FIRE SAFE REGULATIONS.
- ROOF GUTTERS SHALL BE PROVIDED WITH A MEANS TO PREVENT THE ACCUMULATION OF LEAVES AND DEBRIS.
- EXTERIOR VENTS (FOR ENCLOSED ATTICS, GABLE ENDS, RIDGE ENDS, UNDER EAVES AND CORNICES, ENCLOSED EAVE SOFFIT SPACES, ENCLOSED RAFTER SPACES FORMED WHERE CEILINGS ARE APPLIED DIRECTLY TO THE UNDERSIDE OF ROOF RAFTERS, UNDERFLOOR VENTILATION, FOUNDATIONS AND CRAWL SPACES) SHALL BE SCREENED WITH CORROSION RESISTANT, NON-COMBUSTIBLE WIRE MESH WITH 1/16"-1/8" OPENINGS OR ITS EQUIVALENT. ALL VENTS MUST BE FIRE RATED TO PRECLUDE EMBER AND FLAME ENTRANCE PER CBC 706A. CONTRACTOR TO PROVIDE BUILDING INSPECTOR WITH APPROVED PRODUCT LISTINGS. PROVIDE VULCAN, EMBERS OUT, BRANDGUARD VENTS, OR O'HAGIN VENT MODELS OR EQV.
- UNDERSIDE OF EAVES OR SOFFIT TO BE IGNITION RESISTANT OR NON-COMBUSTIBLE PER ONE OF THE FOLLOWING:
 - OPEN EAVES WITH EXPOSED RAFTERS: MIN 2X RAFTER TAILS WITH MIN 2X BLOCKING BETWEEN THEM WITH APPROVED WUI VENTS AS NOTED ABOVE WITH EXPOSED FIRE RATED ROOF SHTG LISTED FOR WUI UNDER EAVE APPLICATION OR EQV.
 - BOXED SOFFIT WITH APPROVED WUI UNDER EAVE LISTED PRODUCT WITH APPROVED WUI VENTS AS NOTED ABOVE.
- EXTERIOR SIDING TO BE CONSTRUCTED WITH NONCOMBUSTIBLE MATERIAL, FIRE-RETARDANT-TREATED WOOD, OR IGNITION-RESISTANT MATERIAL, OR HEAVY TIMBER EXTERIOR WALL ASSEMBLY, A WALL ASSEMBLY THAT MEETS SFM STANDARD 12-7A-1.
- ALL EXTERIOR DOORS SHALL BE OF NON-COMBUSTIBLE, OR 1-3/8" SOLID CORE, OR 20-MINUTE FIRE RATED.
- ALL WINDOWS SHALL BE OF TEMPERED GLASS, OR 20-MINUTE FIRE RATED.

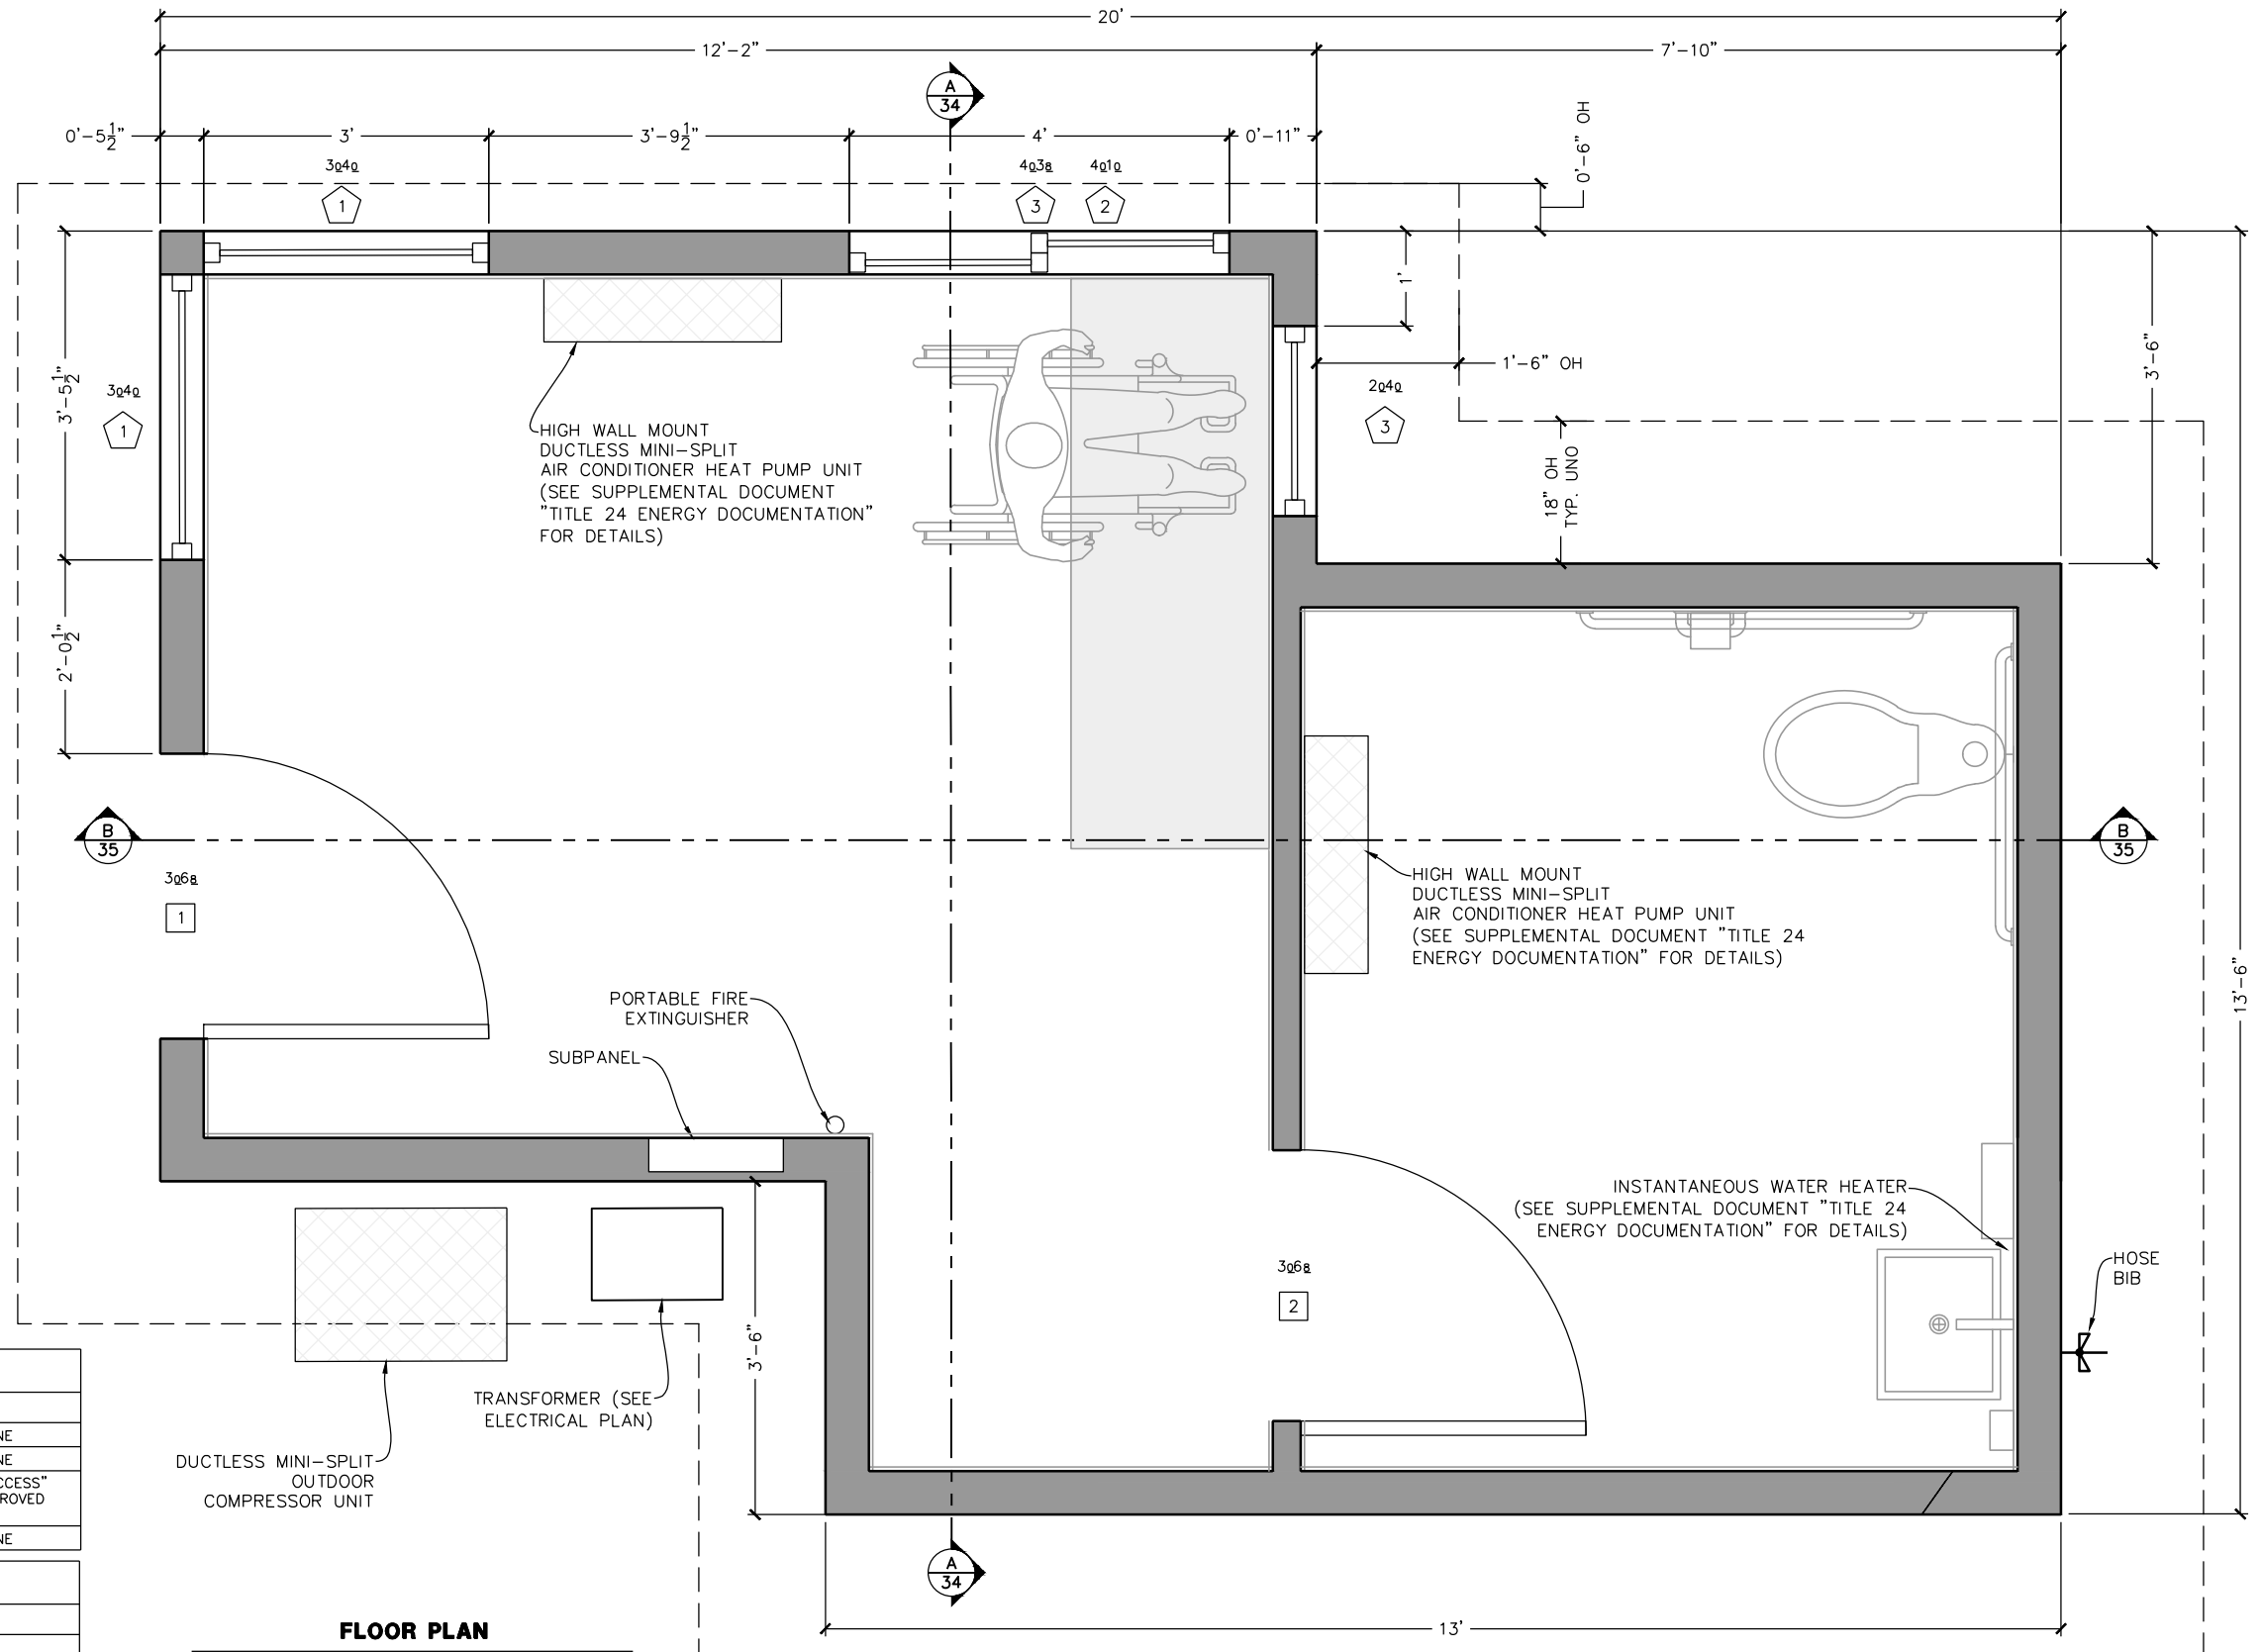

WINDOW SCHEDULE				
#	QTY	TYPE	SIZE	OTHER
1	2	FIX	3'-0" X 4'-0"	"MILGARD" V250 STYLE LINE
2	1	FIX	4'-0 X 1'-0"	"MILGARD" V250 STYLE LINE
3	1	ADA SLIDER	3'-11 1/2 X 3'-7 1/2"	SECURITY WINDOW, "READY ACCESS" 275-LOW PROFILE -OR- APPROVED EQUIVALENT
4	1	FIX	2'-0" X 4'-0"	"MILGARD" V250 STYLE LINE

DOOR SCHEDULE				
#	QTY	TYPE	SIZE	OTHER
1	1	EXTERIOR	3'-0 X 6'-8"	
2	1	INTERIOR ADA COMPLIANT	3'-0 X 6'-8"	

FLOOR PLAN

SCALE: 1" = 1'



BAR IS ONE INCH ON ORIGINAL DRAWING IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY	ROAD NAME: CONSERVATION CAMP RD.	DESIGN SECTION	COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS REDWAY TRANSFER STATION WEIGH STATION BUILDING ELECTRICAL PLAN	SHEET 30 OF 56
	PROJECT NO.: 438005	MILE POST:		
	DRAWING FILE NAME: RTS_WEIGHT SHACK	DESIGNED BY: ENGR		
	PLOT DATE: 08/19/2025	DRAWN BY: PBS		
		REVIEWED BY: TRS		
		APPROVED BY: JAB		

LIGHTING NOTES:

1. ALL LIGHTING FIXTURES NOTED, OR EQUIVALENT, ARE TO BE INSTALLED PER SPECIFICATIONS BY THE MANUFACTURER.
2. LIGHTING PLAN IS DIAGRAMMATIC IN NATURE AND REQUIRES COORDINATION AMONG TRADES.
3. VERIFY EXACT EQUIPMENT AND FIXTURES WITH OWNER PRIOR TO INSTALLATION.
4. SEE ELECTRICAL PLAN FOR LUMINAIRE SCHEDULE.




SCALE 1" = 1'

ELECTRICAL LEGEND:

- CKT # DUPLEX CONVENIENCE OUTLET MOUNTED +18" OR SPECIFIED ABOVE FINISH FLOOR TO BOX CENTER UNO. 120 VOLT UNLESS SPECIFIED. SUBSCRIPTS:
 GFCI - GROUND FAULT CIRCUIT INTERRUPTER
 WP - WEATHER PROOF
 IG - ISOLATED GROUND
 a - SMALL-CASE LETTER FOR SWITCHED OUTLETS "TIED" TO SWITCHED LIGHTING.
 BLANK OR "u" IS UNSWITCHED.
 240V - 240 VOLT.
 WIRE RECEPT. TO CKT # SHOWN USING #12 CONDUCTORS.
- DOUBLE DUPLEX RECEPTACLE
- RECESSED CAN LIGHT
- S=SMOKE ALARM, SEE LFS.
- SMOKE & CARBON MONOXIDE ALARM-SEE LFS
- EXHAUST FAN
- CEILING MOUNT MOTION DETECTOR - SEE LS
 F - FAN LIGHT
- TELEPHONE OUTLET -- MOUNT +18" AFF UNO BOX BOX AND BLANK PLATE ONLY WITH 3/4" CONDUIT STUB TO ACCESSIBLE LOCATION ABOVE CEILING OR BELOW FLOOR, OR AS SHOWN ON PLANS.
- DATA OUTLET -- BOX AND CONDUIT AS ABOVE
- PH & DATA -- BOX AND CONDUIT AS ABOVE
- EXTERIOR MOTION SENSOR LIGHT
- EXTERIOR WALL MOUNT FIXTURE - SEE LFS
- WALL SWITCH--MOUNT +42" AFF TO BOX CENTER SUBSCRIPTS:
 1 = SINGLE POLE D = DIMMER
 3 = THREE WAY K = KEY OPERATED
 4 = FOUR WAY P = PILOT
 WP = WEATHERPROOF MS = MOTION SENSOR
 a, b, ETC. = SWITCH OPERATES ALL FIXTURES WITH SAME SUBSCRIPT

ELECTRICAL RUN

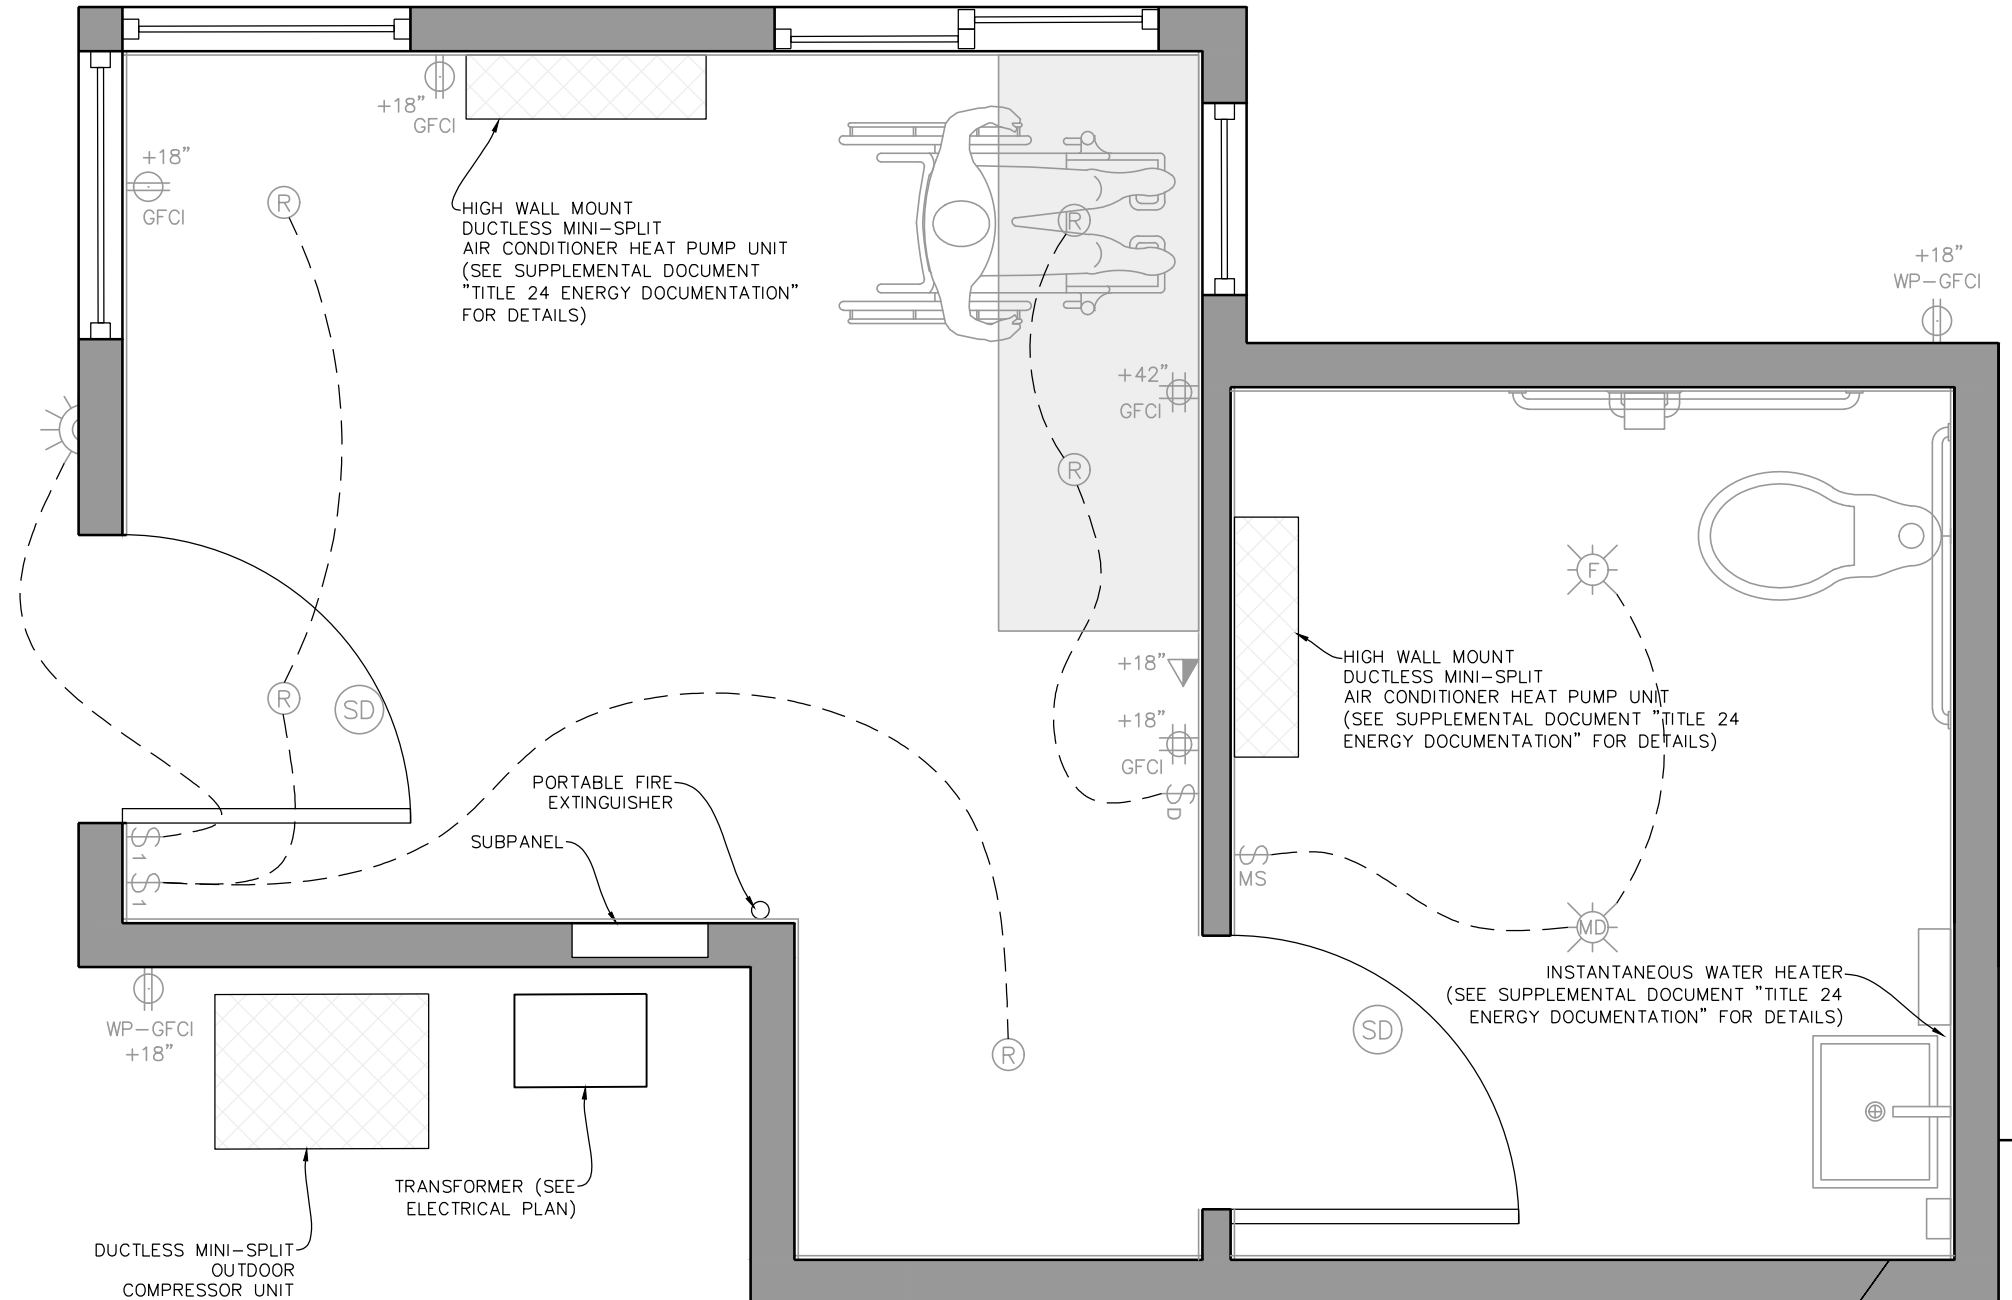

ELECTRICAL PLAN

SCALE: 1" = 1'



BAR IS ONE INCH ON ORIGINAL DRAWING IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY	ROAD NAME: CONSERVATION CAMP RD. ROAD NO.: PROJECT NO.: 438005	DESIGN SECTION ENGINEERING DESIGNED BY: ENGR DRAWN BY: PBS REVIEWED BY: TRS APPROVED BY: JAB	COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS REDWAY TRANSFER STATION WEIGH STATION BUILDING ADA DETAILS	SHEET 31 OF 56
	DRAWING FILE NAME: RTS_WEIGHT SHACK PLOT DATE: 08/19/2025			

ADA LAVATORY (SINK) NOTES:

1. ACCESSIBLE LAVATORIES SHALL BE A MINIMUM 17" IN HORIZONTAL DEPTH AND MOUNTED WITH THE RIM OR COUNTER EDGE NO HIGHER THAN 34" ABOVE FINISH FLOOR.
2. CLEAR SPACE IN FRONT OF ACCESSIBLE LAVATORIES SHALL BE A MINIMUM 30" WIDE AND 48" DEEP, AND MAY EXTEND A MAXIMUM OF 19" INTO VERTICAL KNEE AND TOE CLEARANCES AS DESCRIBED BELOW.
3. VERTICAL KNEE CLEARANCE UNDER ACCESSIBLE LAVATORIES SHALL BE 29" AT THE FRONT EDGE OF THE LAVATORY, REDUCING TO 27" AT A POINT 8" BACK FROM THE FRONT EDGE.
4. VERTICAL TOE CLEARANCE UNDER ACCESSIBLE LAVATORIES SHALL BE A MINIMUM 9" EXTENDING FROM THE FRONT EDGE OF THE LAVATORY TO A DISTANCE NO MORE THAN 6" FROM THE BACK WALL.
5. HOT WATER AND DRAINPIPES UNDER ACCESSIBLE LAVATORIES SHALL BE INSULATED OR OTHERWISE COVERED. THERE SHALL BE NO SHARP OR ABRASIVE SURFACES UNDER LAVATORIES.
6. FAUCET CONTROLS FOR LAVATORIES SHALL BE LEVER TYPE, PUSH TYPE, OR ELECTRONICALLY CONTROLLED MECHANISMS. SELF-CLOSING VALVES MUST MAINTAIN A MINIMUM 10 SECONDS OF OPEN FLOW. REFER TO 'ADA BATHROOM NOTES' FOR ADDITIONAL FAUCET CONTROL REQUIREMENTS.


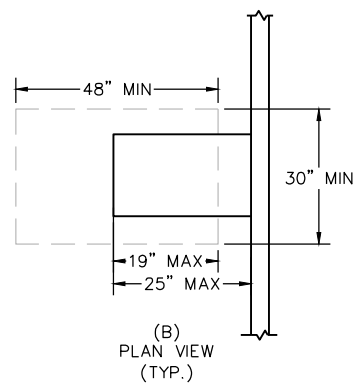


FIGURE 11B-306.3
KNEE AND TOE CLEARANCE

*NOTE:
PROVIDE 19" MIN AT WORK SURFACES

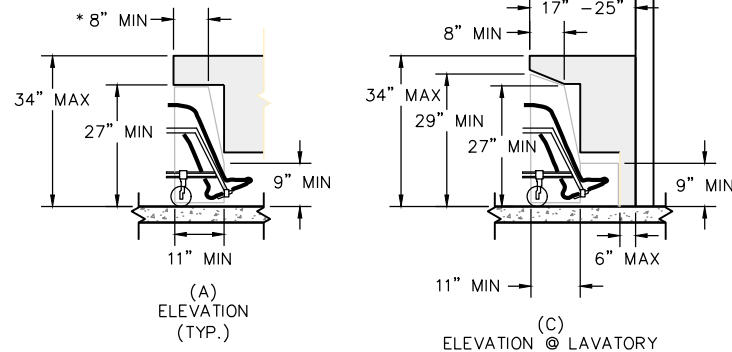

ADA BATHROOM NOTES:

1. THE BATHROOM DOOR SHALL HAVE A PRIVACY LATCH.
2. BATHROOM WALL SURFACES SHALL BE SMOOTH, HARD AND NON-ABSORBENT TO 48" IN HEIGHT, AND SHALL NOT BE ADVERSELY AFFECTED BY MOISTURE.
3. BATHROOM FLOOR SURFACES SHALL BE SMOOTH, HARD AND NON-ABSORBENT, EXTENDING UPWARD A MINIMUM 5" ONTO WALLS.
4. FLUSH VALVES FOR ACCESSIBLE TOILETS AND URINALS SHALL BE LOCATED A MAXIMUM 44" ABOVE FINISH FLOOR. OPERABLE PARTS FOR ALL OTHER TOILET ROOM FIXTURES AND ACCESSORIES SHALL BE LOCATED A MAXIMUM 40" ABOVE FINISH FLOOR.
5. FLUSH VALVES FOR ACCESSIBLE TOILETS AND URINALS, FAUCET CONTROLS, AND ANY OTHER TOILET ROOM CONTROLS OR OPERATING MECHANISMS SHALL BE OPERABLE WITH ONE HAND WITH NO TIGHT GRASPING, PINCHING, OR TWISTING.
6. MAXIMUM PRESSURE TO OPERATE FLUSH VALVES, FAUCET CONTROLS, AND ANY OTHER TOILET ROOM CONTROLS OR OPERATING MECHANISMS SHALL NOT EXCEED 5 POUNDS-FORCE.
7. MIRRORS LOCATED ABOVE LAVATORIES SHALL BE INSTALLED WITH THE BOTTOM EDGE A MAXIMUM 40" ABOVE FINISHED FLOOR. MIRRORS NOT LOCATED ABOVE LAVATORIES SHALL BE INSTALLED WITH THE BOTTOM EDGE 35" ABOVE FINISHED FLOOR.


ADA LAVATORY AND WORK COUNTER ELEVATION / PLAN VIEW (SCALE N.T.S.)

ADA TOILET NOTES:

1. ACCESSIBLE TOILETS SHALL BE POSITIONED BETWEEN 17" AND 18" FROM THE SIDE WALL OR PARTITION.
2. ACCESSIBLE TOILETS SHALL HAVE AN ELONGATED BOWL WITH A SEAT HEIGHT BETWEEN 17" AND 19" ABOVE FINISH FLOOR.
3. CLEAR SPACE IN FRONT OF ACCESSIBLE TOILETS SHALL BE MINIMUM 60" WIDE AND 48" DEEP.
4. FLUSH VALVES FOR ACCESSIBLE TOILETS SHALL BE LOCATED ON THE WIDE SIDE OF THE TOILET AREA. REFER TO 'ADA BATHROOM NOTES' FOR ADDITIONAL FLUSH VALVE REQUIREMENTS.
5. TOILET PAPER DISPENSERS SHALL BE MOUNTED A MINIMUM OF 1-1/2" CLEAR UNDER THE SIDE GRAB BAR AND A MINIMUM OF 19" ABOVE FINISH FLOOR TO CL OF DISPENSER AND HORIZONTALLY BETWEEN 7" AND 9" FROM THE FRONT EDGE OF THE TOILET SEAT TO THE CL OF THE DISPENSER.
6. GRAB BARS SHALL BE PROVIDED IN ACCESSIBLE TOILET COMPARTMENTS ON THE SIDE WALL CLOSEST TO THE TOILET AND ON THE REAR WALL.
7. SIDE GRAB BARS IN TOILET COMPARTMENTS SHALL BE MINIMUM 42" IN LENGTH, AND SHALL BEGIN A MAXIMUM 12" FROM THE REAR WALL. THE FRONT END OF A SIDE GRAB BAR SHALL BE POSITIONED A MINIMUM 24" IN FRONT OF THE TOILET AND 54" FROM THE REAR WALL.
8. REAR GRAB BARS IN TOILET COMPARTMENTS SHALL BE MINIMUM 36" IN LENGTH, SHALL EXTEND A MINIMUM 12" FROM THE CENTERLINE OF THE TOILET ON THE WALL SIDE AND A MINIMUM OF 24" FROM CENTERLINE ON THE OTHER SIDE. THE SPACE BETWEEN THE REAR GRAB BAR AND THE TOP OF THE TOILET TANK SHALL BE A MINIMUM OF 1-1/2"

ADA GRAB BAR NOTES:

1. THE DIAMETER OR WIDTH OF CIRCULAR GRAB BAR GRIPPING SURFACES SHALL BE 1-1/4" TO 2". ALL GRAB BARS SHALL BE CAPABLE OF SUPPORTING A 250-POUND POINT LOAD, AND SHALL NOT ROTATE WITHIN THEIR FITTINGS.
2. ALL GRAB BARS SHALL HAVE 1-1/2" OF CLEARANCE BETWEEN THE BAR & WALL, SHALL HAVE 12" OF CLEARANCE BETWEEN THE BAR AND ANY PROJECTING OBJECT ABOVE THE BAR, SHALL HAVE 1-1/2" OF CLEARANCE BETWEEN THE BAR AND ANY PROJECTING OBJECT BELOW THE BAR, AND SHALL BE MOUNTED BETWEEN 33" AND 36" ABOVE FINISH FLOOR MEASURED TO THE TOP OF THE GRIPPING SURFACE.

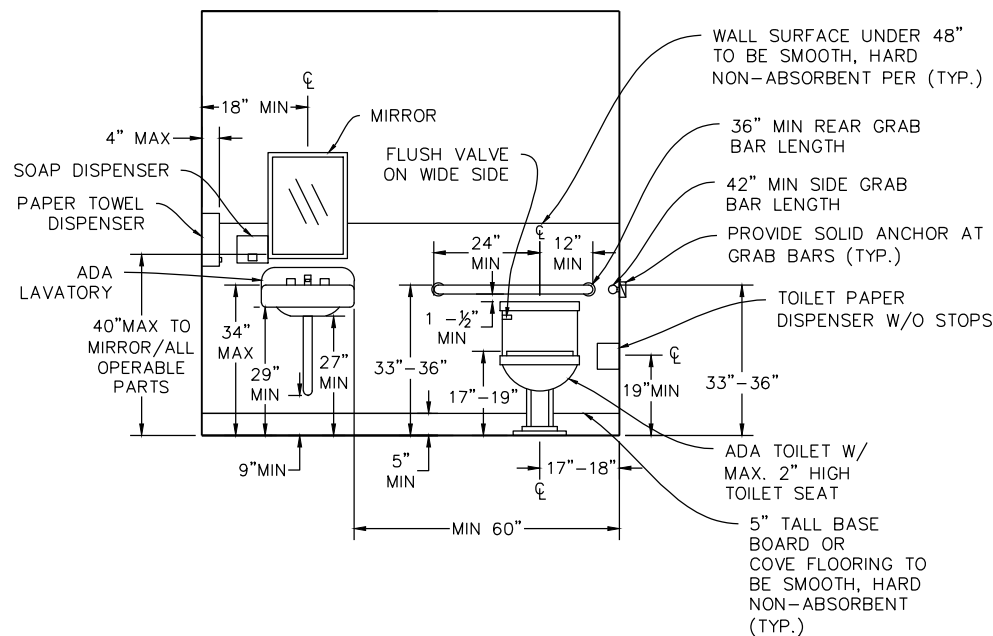

ADA BATHROOM ELEVATION (SCALE N.T.S.)


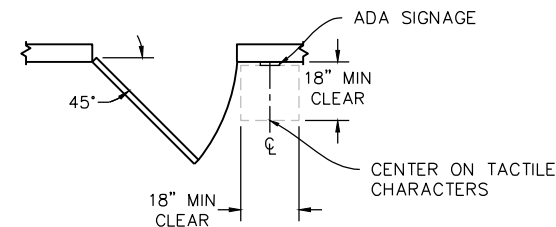


FIGURE 11B-703.4.2
LOCATION OF TACTILE SIGNS AT DOORS

ADA DOOR DETAIL (SCALE N.T.S.)

ADA SIGNAGE NOTES:



1. DOOR MOUNTED SIGNS SHALL BE CENTERED ON THE DOOR AND LOCATED BETWEEN 58" AND 60" IN HEIGHT, MEASURED FROM THE FINISHED FLOOR TO THE CENTERLINE OF THE SIGN.
2. WALL MOUNTED SIGNS SHALL BE LOCATED 48 INCHES MINIMUM ABOVE THE FINISH FLOOR OR GROUND SURFACE, MEASURED FROM THE BASELINE OF THE LOWEST BRAILLE CELLS AND 60 INCHES MAXIMUM ABOVE THE FINISH FLOOR OR GROUND SURFACE, MEASURED FROM THE BASELINE OF THE HIGHEST LINE OF RAISED CHARACTERS (TEXT).
3. UNISEX SANITARY FACILITIES SHALL BE IDENTIFIED BY A 12" DIAMETER CIRCLE LOCATED ON THE DOOR THAT IS 1/4" THICK WITH A 1/4" THICK TRIANGLE SUPERIMPOSED WITHIN THE CIRCLE. THE TRIANGLE SYMBOL SHALL CONTRAST WITH THE CIRCLE SYMBOL AND THE CIRCLE SYMBOL SHALL CONTRAST WITH THE DOOR, EITHER LIGHT ON A DARK BACKGROUND OR DARK ON A LIGHT BACKGROUND.
4. MEN'S RESTROOM FACILITIES SHALL BE IDENTIFIED BY AN EQUILATERAL TRIANGLE LOCATED ON THE DOOR THAT IS 1/4" THICK WITH EDGES 12" LONG AND VERTEX POINTING UPWARD. THE TRIANGLE SYMBOL SHALL BE MOUNTED CENTERED ON THE DOOR, AND SHALL CONTRAST WITH THE DOOR, EITHER LIGHT ON A DARK BACKGROUND OR DARK ON A LIGHT BACKGROUND.
5. WOMEN'S RESTROOM FACILITIES SHALL BE IDENTIFIED BY A CIRCLE LOCATED ON THE DOOR THAT IS 1/4" THICK AND 12" IN DIAMETER. THE CIRCLE SYMBOL SHALL BE MOUNTED CENTERED ON THE DOOR, AND SHALL CONTRAST WITH THE DOOR, EITHER LIGHT ON A DARK BACKGROUND OR DARK ON A LIGHT BACKGROUND.
6. ACCESSIBLE RESTROOM, SHOWER, AND CHANGING ROOM FACILITIES SHALL BE IDENTIFIED BY THE INTERNATIONAL SYMBOL OF ACCESSIBILITY. THE SYMBOL CONSISTS OF A WHITE FIGURE ON A BLUE BACKGROUND OR ANY LIGHT COLOR ON A DARK BACKGROUND OR DARK COLOR ON A LIGHT BACKGROUND AS APPROVED BY THE BUILDING DEPARTMENT.
7. RESTROOM, SHOWER, AND CHANGING ROOM IDENTIFICATION SIGNAGE (I.E., MEN'S, WOMEN'S, ETC.) SHALL BE LOCATED ON THE WALL ADJACENT TO THE LATCH SIDE OF THE DOOR AT A LOCATION THAT ALLOWS A PERSON TO APPROACH WITHIN 3" OF THE SIGNAGE WITHOUT ENCOUNTERING PROTRUDING OBJECTS OR STANDING WITHIN THE SWING OF THE DOOR. THIS CLEAR FLOOR AREA SHALL BE MINIMUM 18" WIDE AND MINIMUM 18" DEEP. WHERE THERE IS NO WALL SPACE AT THE LATCH SIDE OF A SINGLE DOOR OR AT THE RIGHT SIDE OF DOUBLE DOORS, SIGNS SHALL BE LOCATED ON THE NEAREST ADJACENT WALL.
8. LETTERS AND NUMERALS SHALL BE SANS-SERIF UPPERCASE CHARACTERS, RAISED 1/32", AND SHALL BE ACCOMPANIED BY GRADE 2 BRAILLE. CHARACTERS SHALL BE A MINIMUM 5/8" HIGH AND A MAXIMUM OF 2" HIGH. BRAILLE DOTS SHALL BE DOMED OR ROUNDED.
9. PICTORIAL SYMBOL SIGNS (I.E., PICTOGRAMS), IF UTILIZED IN CONJUNCTION WITH TEXT IDENTIFICATION, SHALL BE LOCATED DIRECTLY ABOVE TEXT DESCRIPTIONS. PICTOGRAM BORDERS SHALL BE A MINIMUM 6" HIGH.
10. THE CHARACTERS AND BACKGROUND ON WALL MOUNTED SIGNS SHALL BE EGGSHELL, MATTE, OR OTHER NON-GLARE FINISH, AND THE COLOR AND CONTRAST OF SIGNS SHALL DISTINCTIVELY CONTRAST WITH THE COLOR AND CONTRAST OF THE WALLS UPON WHICH THE SIGNS ARE MOUNTED.

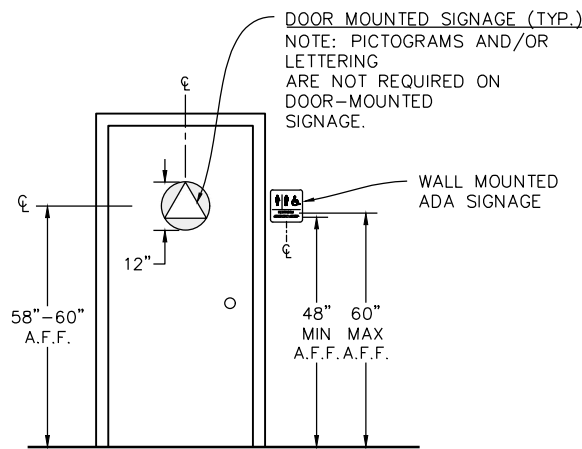

BAR IS ONE INCH ON ORIGINAL DRAWING IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY	ROAD NAME: CONSERVATION CAMP RD.	DESIGN SECTION	COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS REDWAY TRANSFER STATION WEIGH STATION BUILDING ADA DETAILS	SHEET 32 OF 56
	PROJECT NO.: 438005	ENGINEERING		
	DRAWING FILE NAME: RTS_WEIGH_SHACK	DESIGNED BY: ENGR		
	PLOT DATE: 08/19/2025	DRAWN BY: PBS		
		REVIEWED BY: TRS		
		APPROVED BY: JAB		

ADA DOOR/GATE NOTES:


1. MANEUVERING CLEARANCE AND LEVEL AREA IN THE DIRECTION OF THE DOOR SWING SHALL BE A MINIMUM OF 60" IN LENGTH.
2. MANEUVERING CLEARANCE AND LEVEL AREA IN THE OPPOSITE DIRECTION OF THE DOOR SWING SHALL BE A MINIMUM OF 48" IN LENGTH.
3. SURFACE SLOPES OF LEVEL AREAS SHALL NOT EXCEED A 1:48 OR 2% GRADIENT.
4. DOORWAYS SHALL HAVE A MIN. CLEAR OPENING OF 32".
5. EXIT DOORS SHALL BE CAPABLE OF OPENING A MINIMUM OF 90 DEGREES.
6. LEVEL AREAS ON EITHER SIDE OF DOORS SHALL NOT BE MORE THAN 1/2 INCH LOWER THAN THE THRESHOLD OF THE DOORWAY. CHANGE IN LEVEL BETWEEN 1/4 INCH AND 1/2 INCH SHALL BE BEVELED WITH A SLOPE NO GREATER THAN 1 UNIT VERTICAL TO 2 UNITS HORIZONTAL.
7. BOTTOM 10 INCHES OF DOOR SHALL HAVE A SMOOTH UNINTERRUPTED SURFACE THAT ALLOWS THE DOOR TO BE OPENED BY A WHEELCHAIR FOOTREST WITHOUT CREATING A TRAP OR HAZARDOUS CONDITION.
8. EFFORT TO OPERATE INTERIOR & EXTERIOR DOORS SHALL BE WITHIN 5 POUNDS MAX. PRESSURE AS MEASURED TO THE DOOR FACE AT THE DOOR OPENING HARDWARE OR 30 INCHES FROM THE HINGED SIDE, WHICHEVER IS FARTHER FROM THE HINGE. REQUIRED FIRE DOORS SHALL NO EXCEED 15 POUNDS MAX. PRESSURE.
9. HANDLES, PULL LATCHES, LOCKS AND OTHER OPERATING DEVICES ON ACCESSIBLE DOORS SHALL HAVE A SHAPE THAT IS EASY TO GRASP WITH ONE HAND AND DOES NOT REQUIRE TIGHT GRASPING, TIGHT PINCHING OR TWISTING OF THE WRIST TO OPERATE.
10. LATCHING AND LOCKING DOORS THAT ARE HAND OPERATED AND WHICH ARE IN A PATH OF TRAVEL SHALL BE OPERABLE WITH A SINGLE EFFORT BY LEVER TYPE, PANIC BARS, PUSH-PULL ACTIVATING BARS OR OTHER HARDWARE DESIGNED TO PROVIDE PASSAGE.
11. OPENING HARDWARE SHALL BE 34" MINIMUM AND 44" MAXIMUM ABOVE THE FINISHED FLOOR OR GROUND.
12. DOOR AND GATE CLOSERS, IF PRESENT, SHALL BE ADJUSTED SO THAT FROM THE OPEN POSITION OF 90 DEGREES, THE TIME REQUIRED TO MOVE THE DOOR TO A POSITION OF 12 DEGREES FROM THE LATCH IS 5 SECONDS MINIMUM.
13. DOOR AND GATE SPRING HINGES, IF PRESENT, SHALL BE ADJUSTED SO THAT FROM THE OPEN POSITION OF 70 DEGREES, THE DOOR OR GATE SHALL MOVE TO THE CLOSED POSITION IN 1.5 SECONDS MINIMUM.
14. RECESSED DOORMATS SHALL BE ADEQUATELY ANCHORED TO PREVENT INTERFERENCE WITH WHEELCHAIR TRAFFIC.
15. CARPET OR TILES ADJACENT TO DOORWAY THRESHOLDS SHALL BE SECURELY ATTACHED TO THE FLOOR SURFACE.

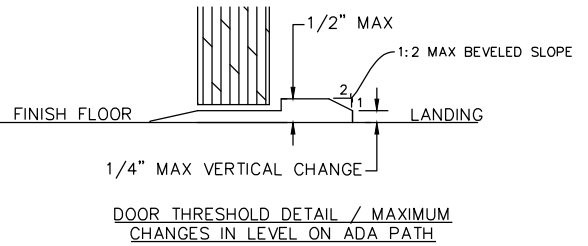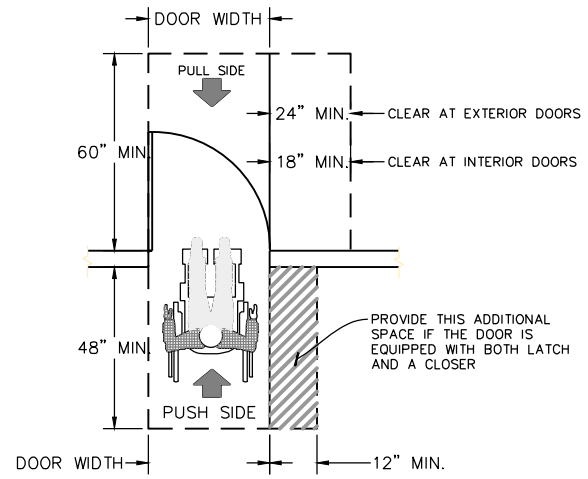

ADA DOOR PLAN - TYPICAL (SCALE N.T.S.)

ADA UNOBSTRUCTED SIDE REACH:


1. WHERE A CLEAR FLOOR OR GROUND SPACE ALLOWS A PARALLEL APPROACH TO AN ELEMENT AND THE SIDE REACH IS UNOBSTRUCTED, THE HIGH SIDE REACH SHALL BE 48 INCHES MAXIMUM AND THE LOW SIDE REACH SHALL BE 15 INCHES MINIMUM ABOVE THE FINISH FLOOR OR GROUND.
- EXCEPTIONS: 1. AN OBSTRUCTION SHALL BE PERMITTED BETWEEN THE CLEAR FLOOR OR GROUND SPACE AND THE ELEMENT WHERE THE DEPTH OF THE OBSTRUCTION IS 10 INCHES MAXIMUM.

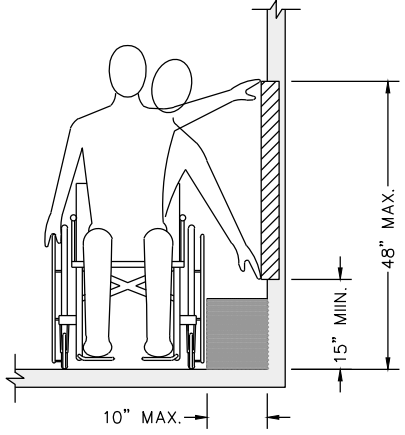

ADA UNOBSTRUCTED SIDE REACH

ADA OBSTRUCTED HIGH FORWARD REACH:


1. WHERE A HIGH FORWARD REACH IS OVER AN OBSTRUCTION, THE CLEAR FLOOR SPACE COMPLYING WITH SECTION 305 AND KNEE AND TOE CLEARANCE COMPLYING WITH SECTION 306 SHALL EXTEND BENEATH THE ELEMENT FOR A DISTANCE NOT LESS THAN THE REQUIRED REACH DEPTH OVER THE OBSTRUCTION. THE HIGH FORWARD REACH SHALL BE 48 INCHES MAXIMUM ABOVE THE FLOOR WHERE THE REACH DEPTH OVER THE OBSTRUCTION IS 20 INCHES MAXIMUM. THE HIGH FORWARD REACH SHALL BE 44 INCHES MAXIMUM ABOVE THE FLOOR WHERE THE REACH DEPTH OVER THE OBSTRUCTION IS GREATER THAN 20 INCHES AND NOT MORE THAN 25 INCHES MAXIMUM.

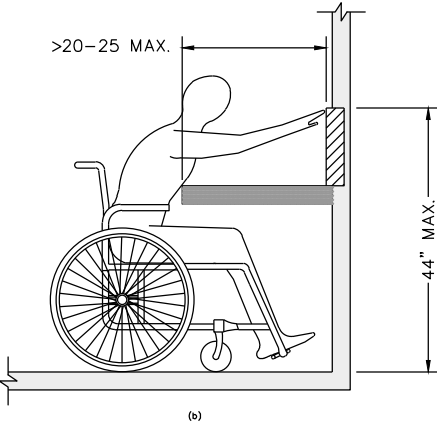

ADA OBSTRUCTED HIGH FORWARD REACH



BAR IS ONE INCH ON ORIGINAL DRAWING IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY	ROAD NAME: CONSERVATION CAMP RD.	DESIGN SECTION	COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS REDWAY TRANSFER STATION WEIGH STATION BUILDING ADA DETAILS	SHEET 33 OF 56
	PROJECT NO.: 438005	MILE POST:		
	DRAWING FILE NAME: RTS_WEIGHT SHACK	DESIGNED BY: ENGR		
	PLOT DATE: 08/19/2025	DRAWN BY: PBS		
		REVIEWED BY: TRS		
		APPROVED BY: JAB		

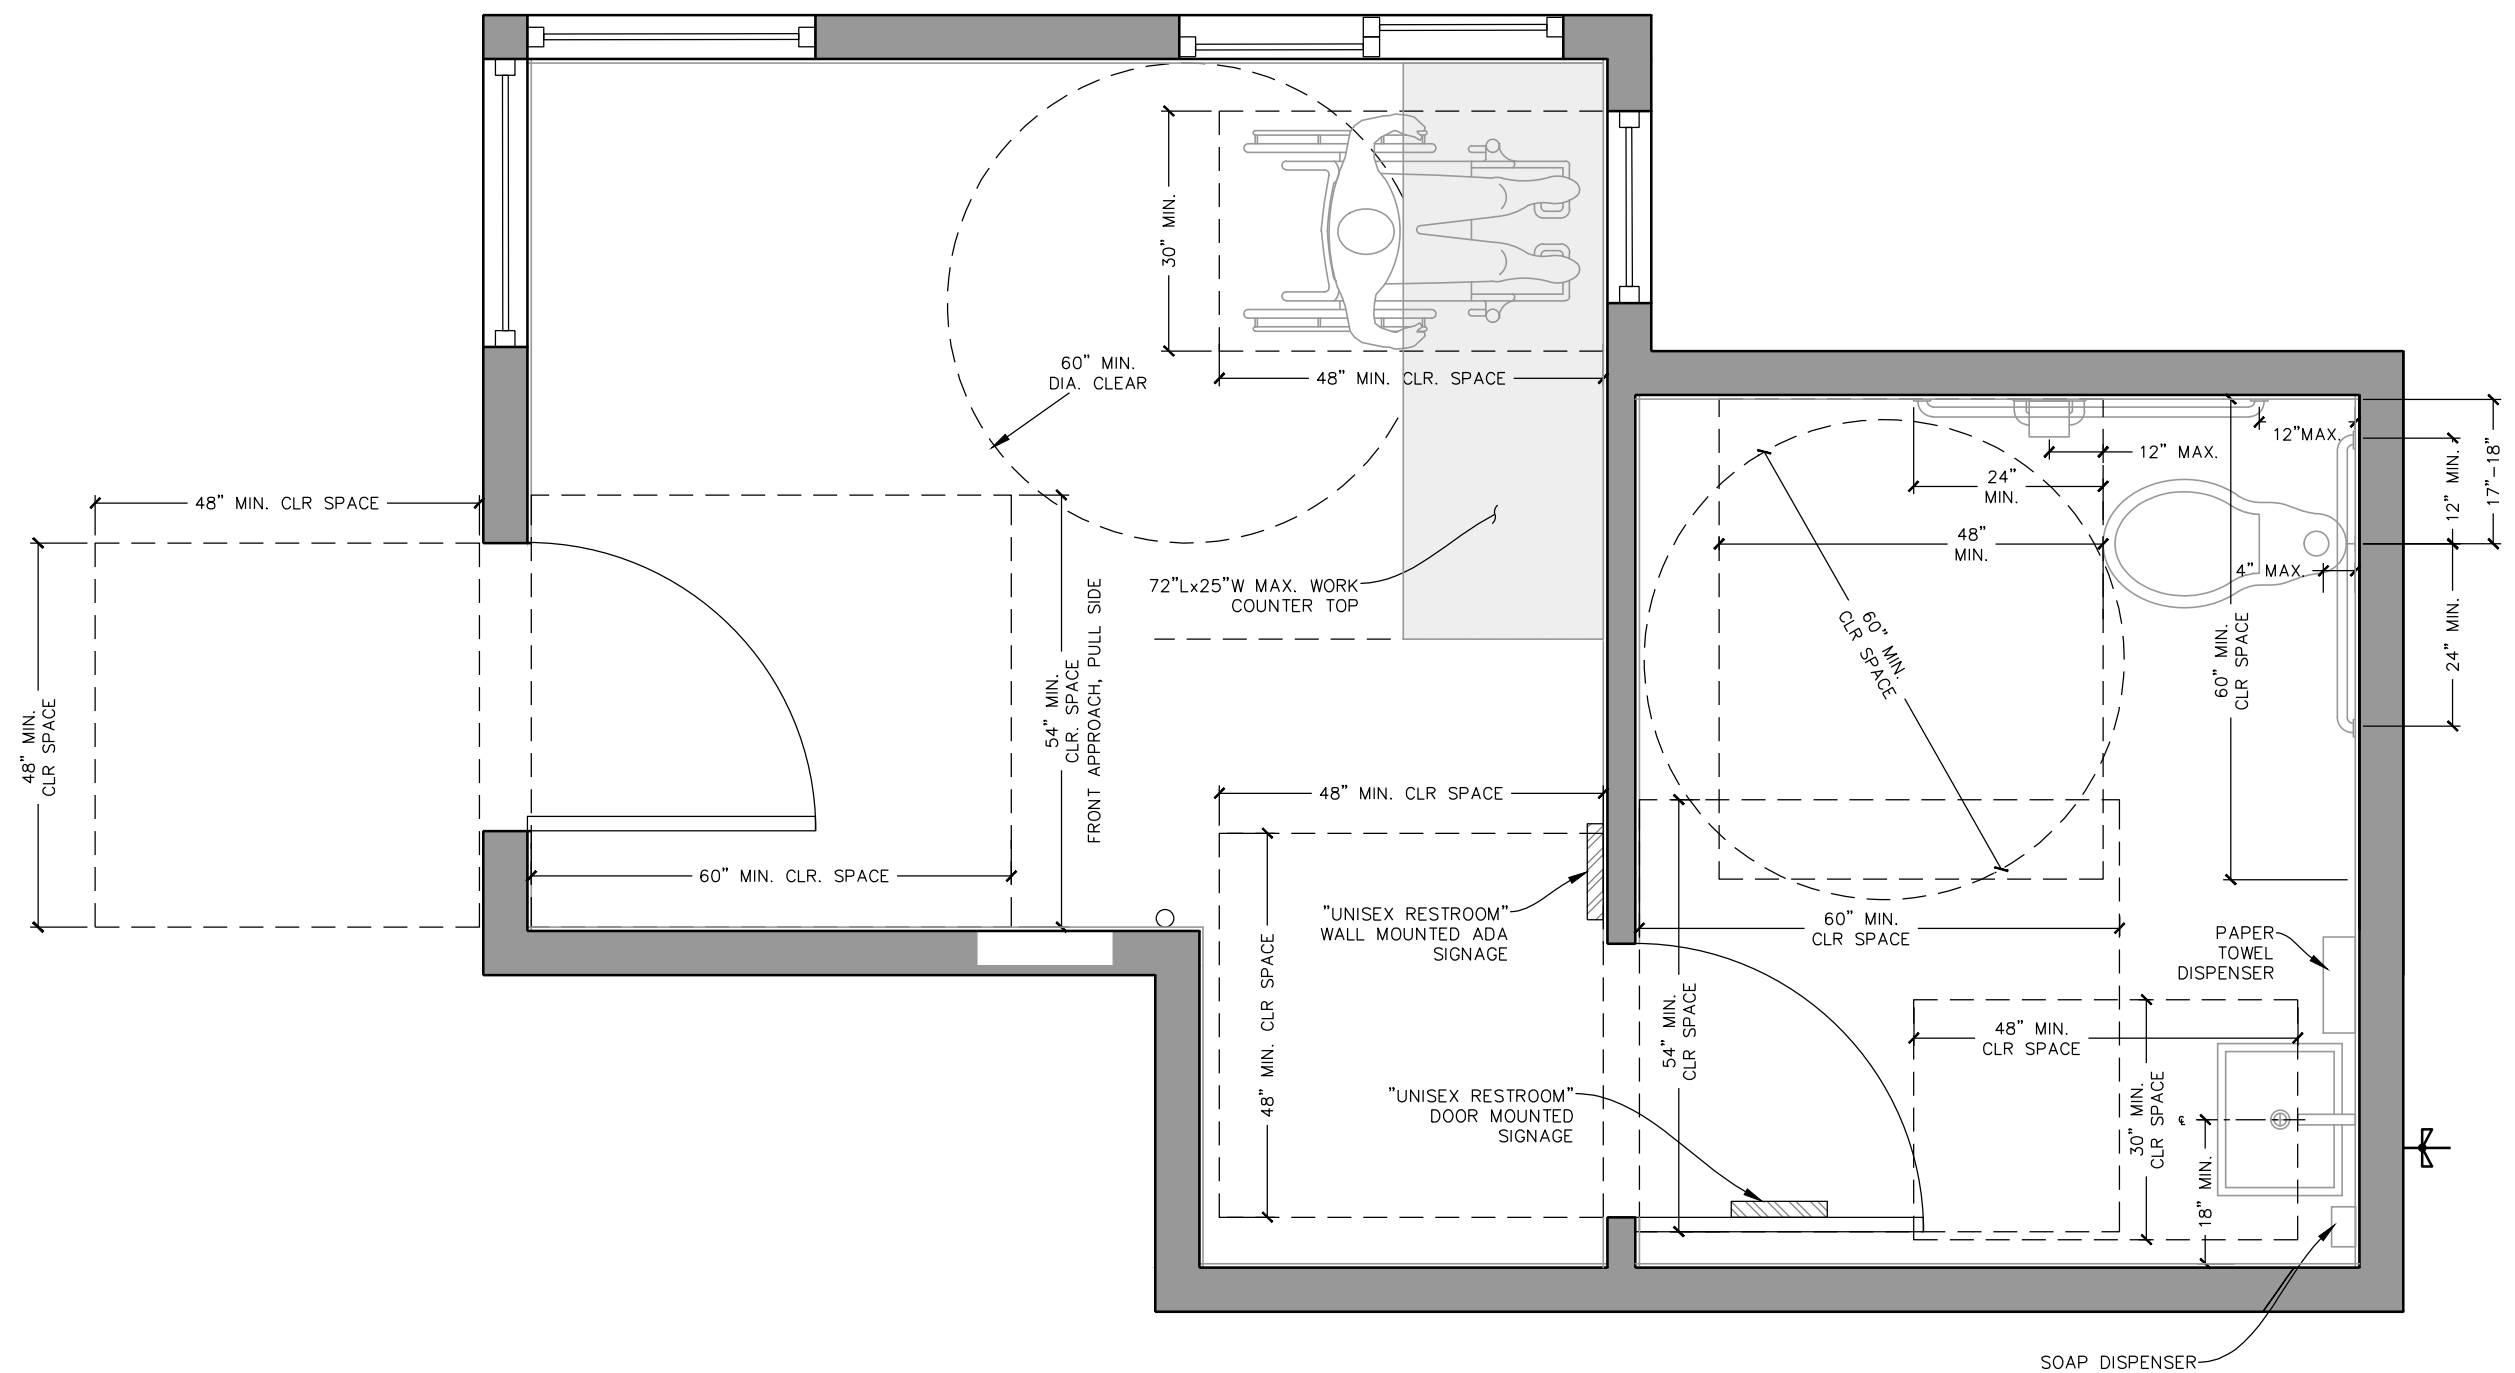


ADA FLOOR PLAN DETAILS
 SCALE: 1" = 1'



BAR IS ONE INCH ON ORIGINAL DRAWING IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY	ROAD NAME: CONSERVATION CAMP RD.	DESIGN SECTION	COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS REDWAY TRANSFER STATION WEIGH STATION BUILDING SECTION A-A	SHEET 34 OF 56
	PROJECT NO.: 438005	MILE POST:		
	DRAWING FILE NAME: RTS_WEIGHT SHACK	DESIGNED BY: ENGR		
	PLOT DATE: 08/19/2025	DRAWN BY: PBS		
		REVIEWED BY: TRS		
		APPROVED BY: JAB		

NOTE:

1. FOLLOW ALL MANUFACTURES INSTALLATION AND RECOMMENDATIONS

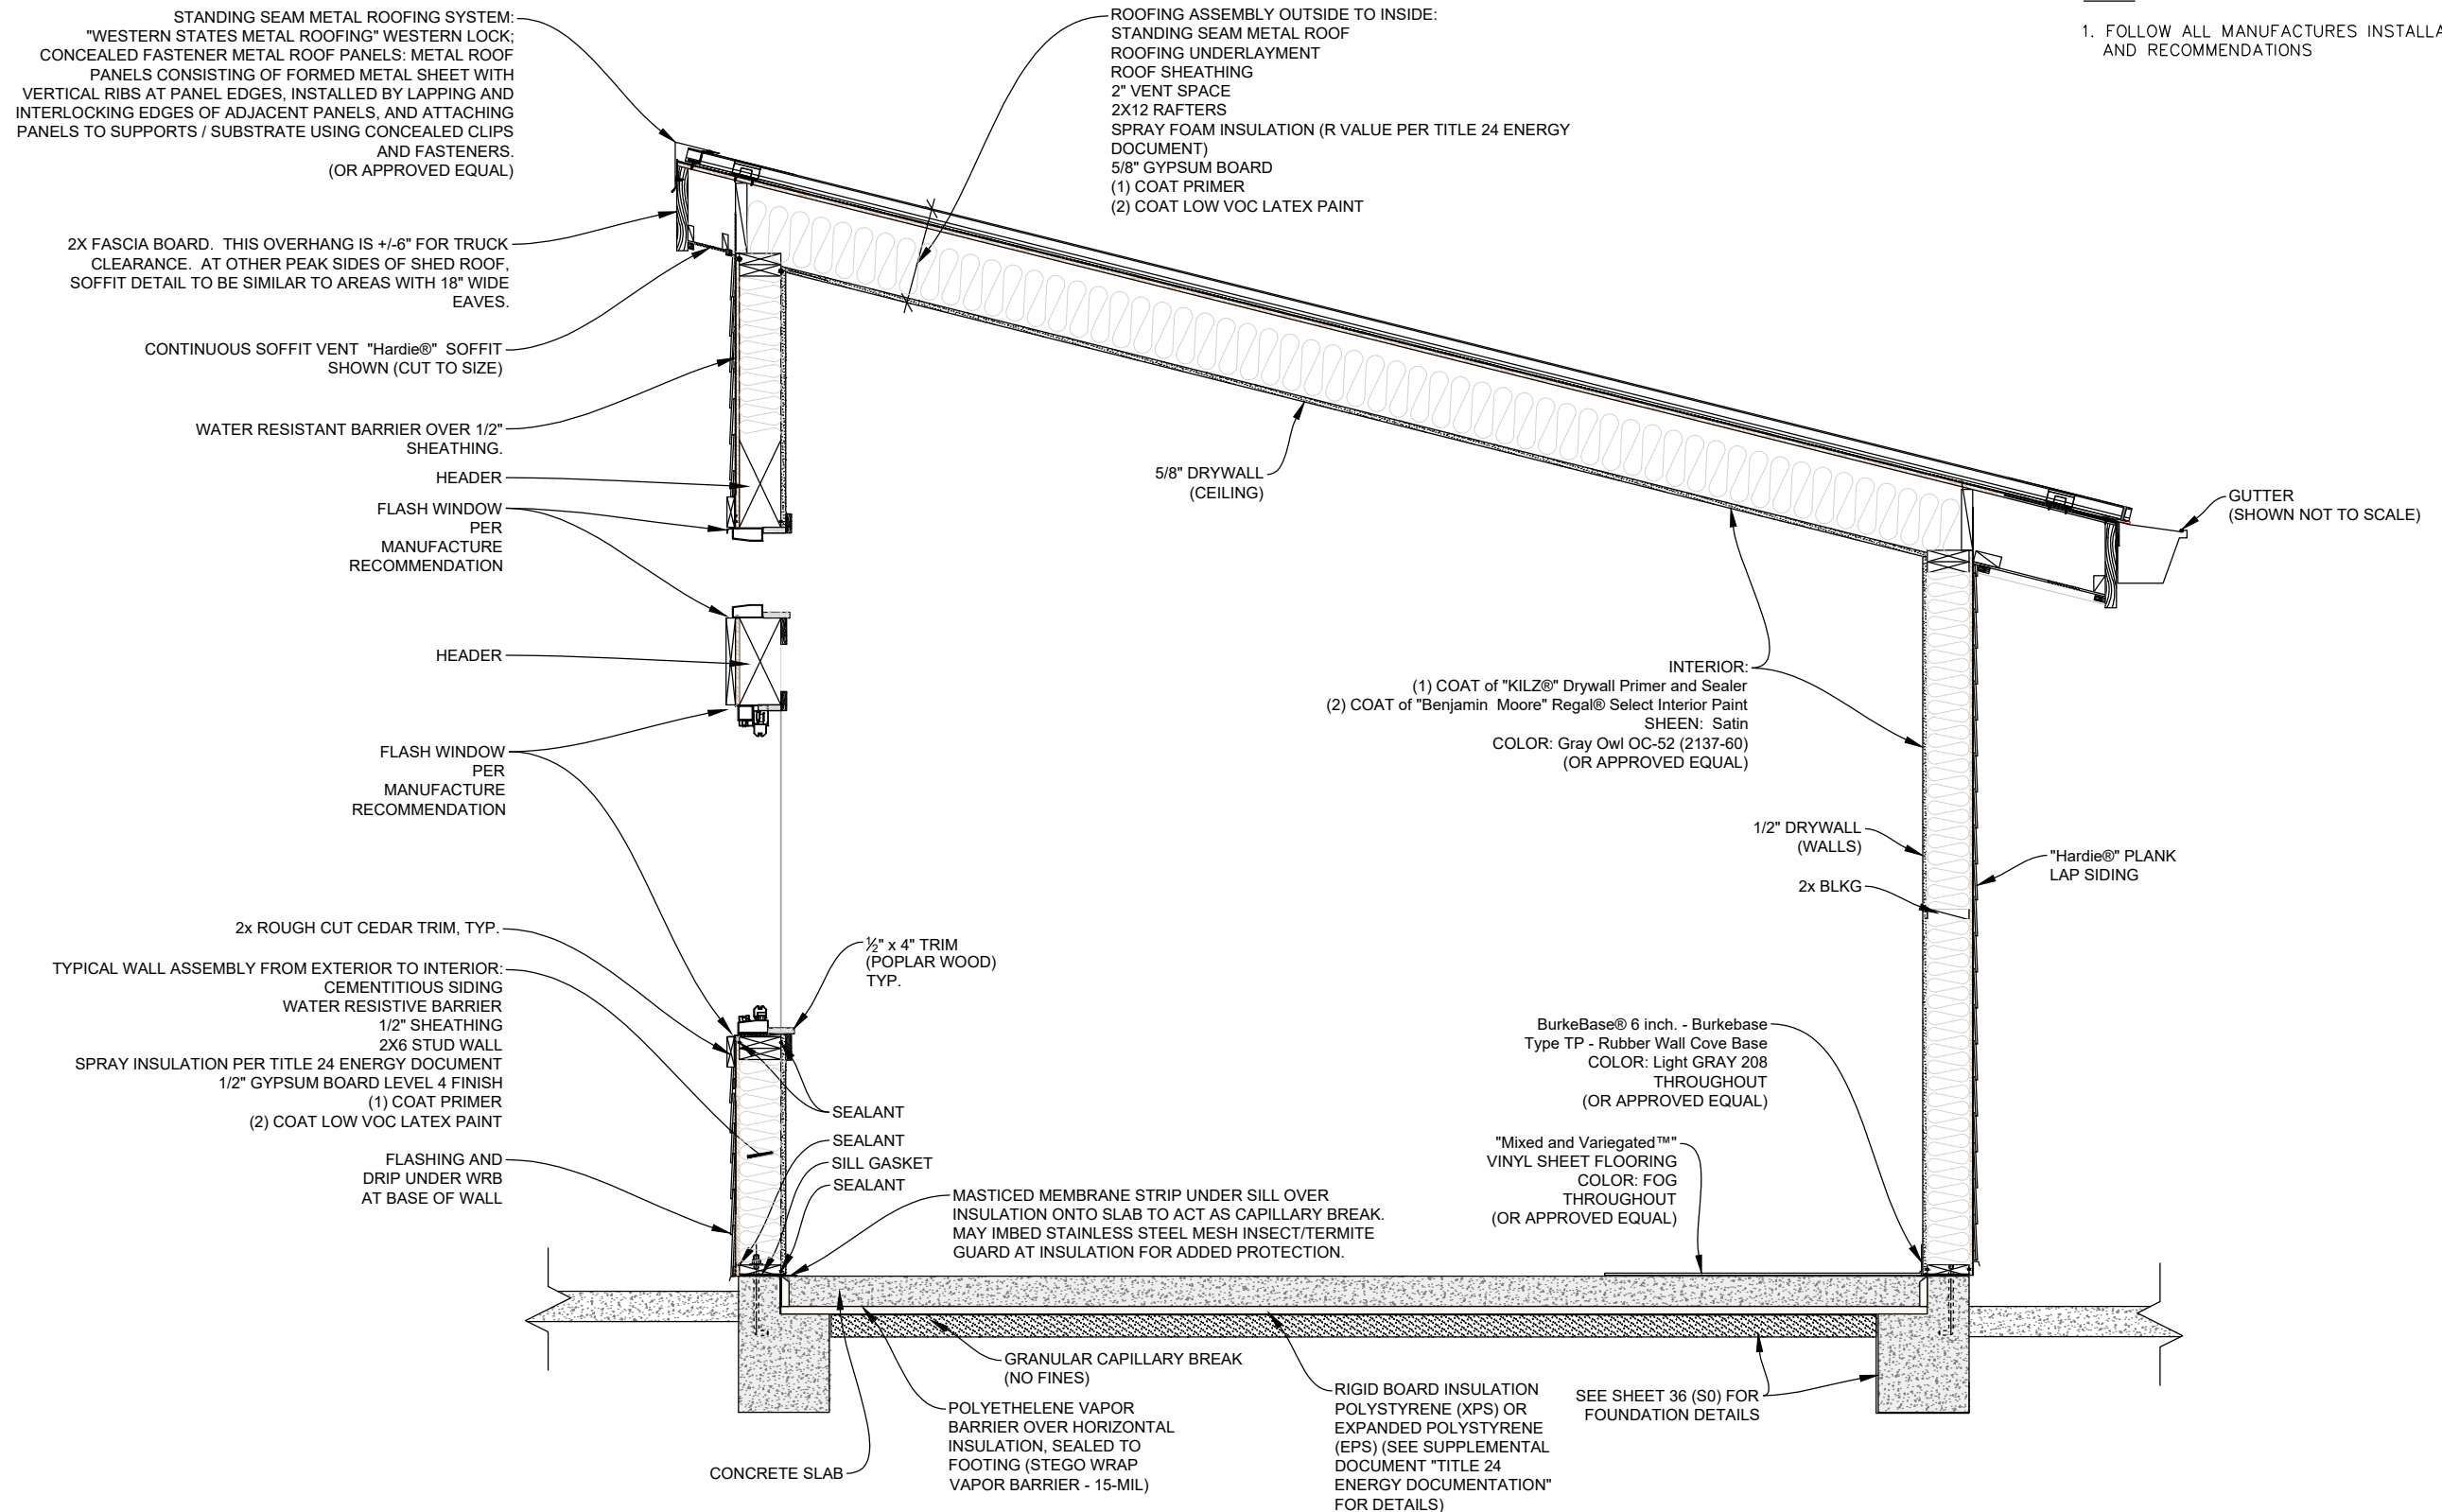


SECTION A-A

SCALE: 1" = 1'



BAR IS ONE INCH ON ORIGINAL DRAWING IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY	ROAD NAME: CONSERVATION CAMP RD.	DESIGN SECTION	COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS REDWAY TRANSFER STATION WEIGH STATION BUILDING SECTION B-B	SHEET 35 OF 56
	PROJECT NO.: 438005	MILE POST:		
	DRAWING FILE NAME: RTS_WEIGHT SHACK	DESIGNED BY: ENGR		
	PLOT DATE: 08/19/2025	DRAWN BY: PBS		
		REVIEWED BY: TRS		
		APPROVED BY: JAB		

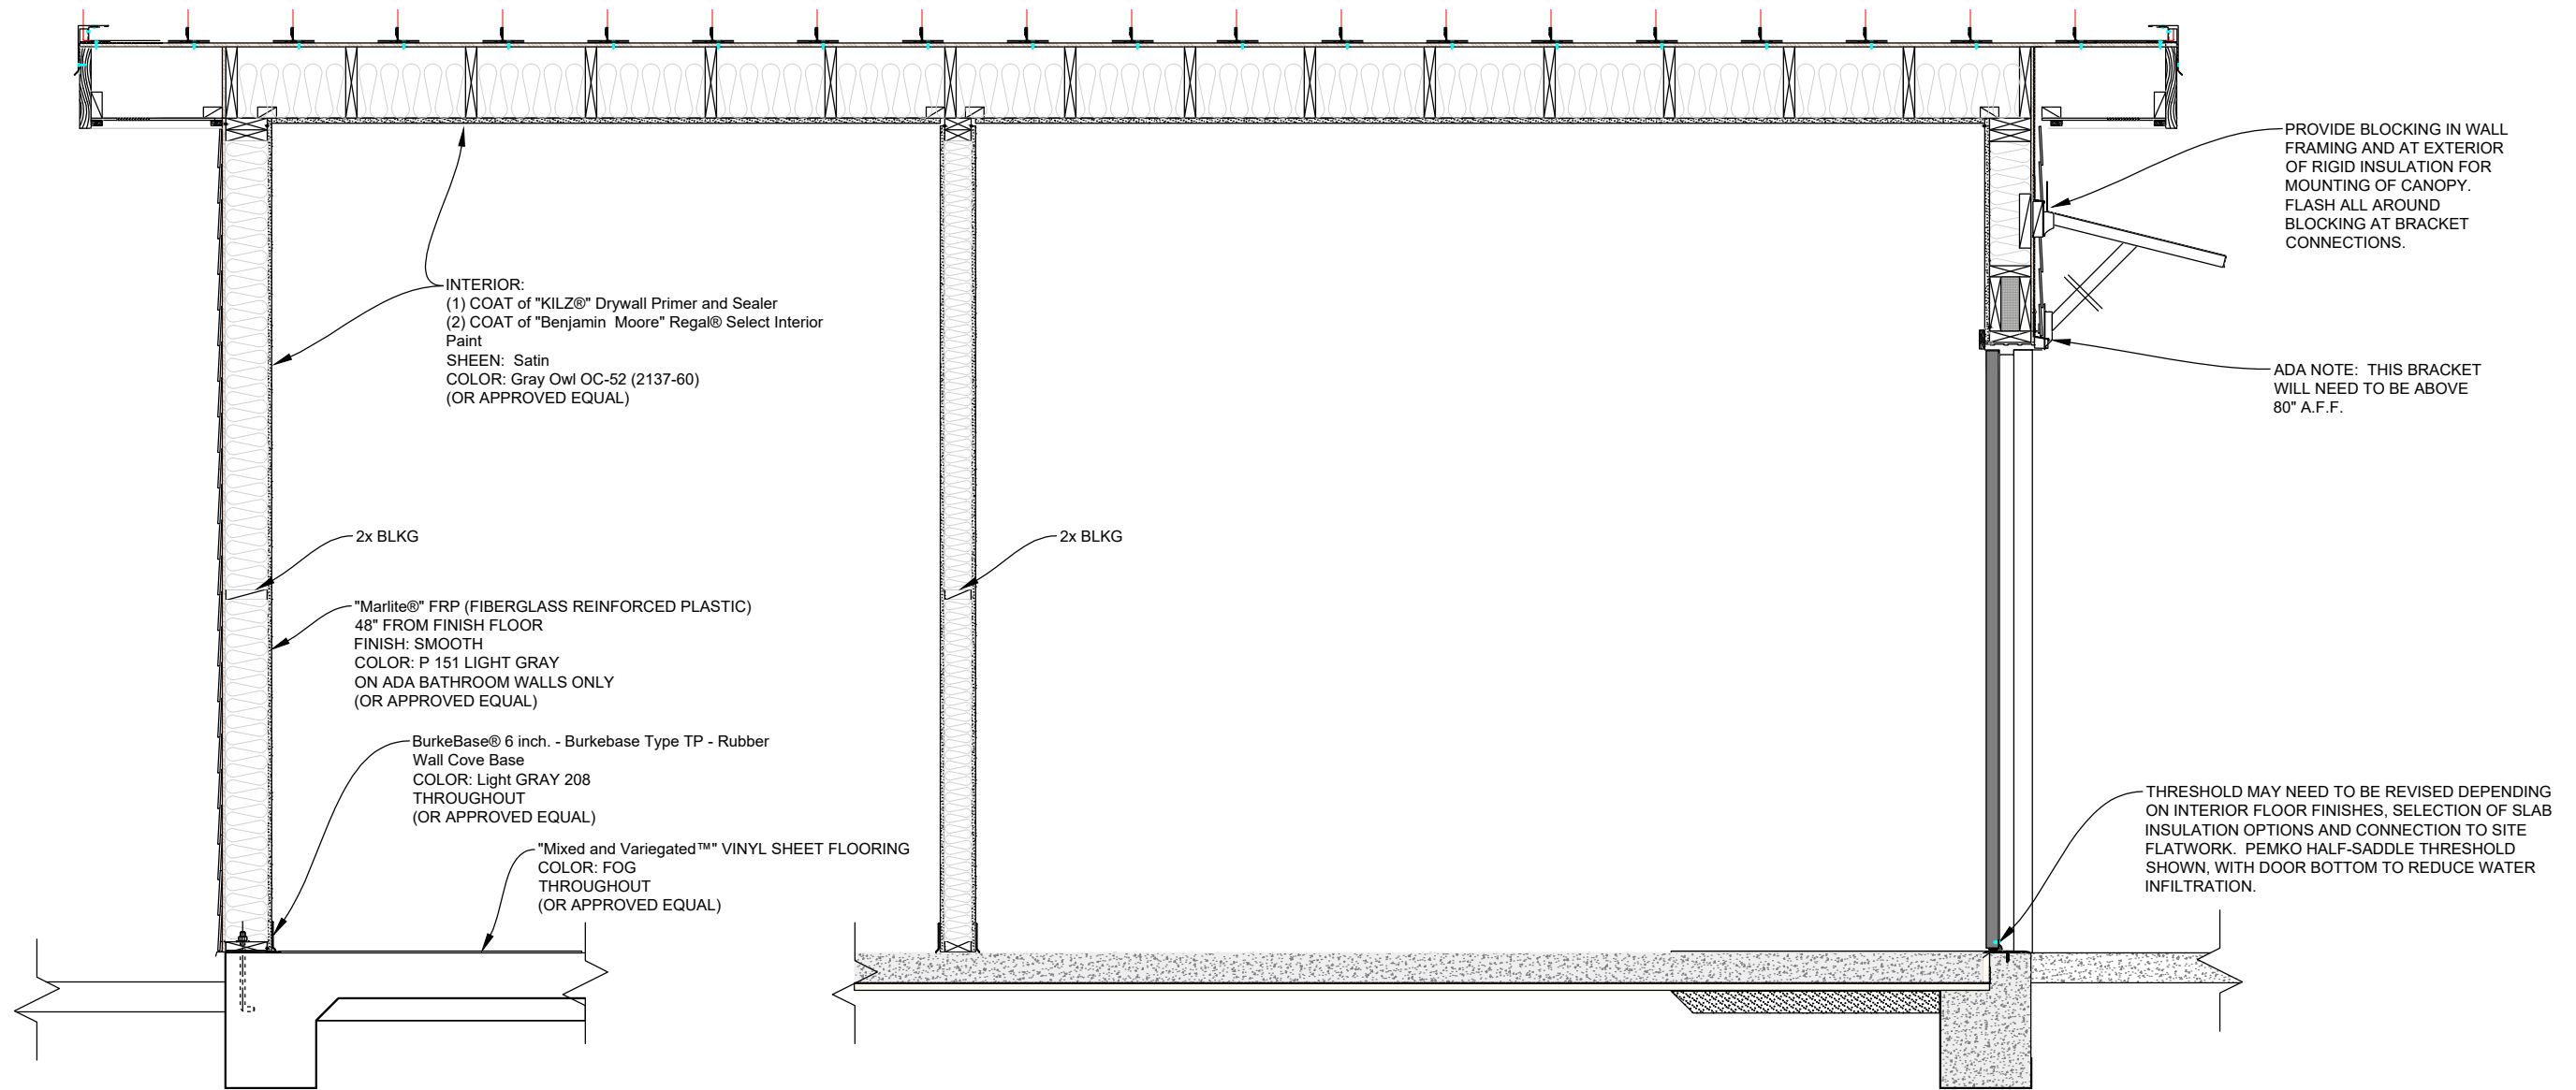

SECTION B-B

SCALE: 1" = 1'

SPECIFICATIONS

GENERAL

- THESE STANDARD DETAIL DRAWINGS ARE DEVELOPED TO SHOW OUR REQUIREMENTS FOR COMMON CONSTRUCTION DETAILS AND TO AID IN THE INTERPRETATION OF OUR STANDARD SCHEDULES. DIFFERENCES IN DIMENSIONS OR ARRANGEMENTS ARE SHOWN ON PLANS OR SPECIFIC DETAILS. IT IS UP TO THE BUILDER TO INTERPRET THESE STANDARD DETAILS AS THEY APPLY TO CONDITIONS WHICH ARE SIMILAR AND NOT DETAILED SEPARATELY.
- SIZES OF MEMBERS AND DIMENSIONS ARE TYPICALLY SHOWN ON PLANS, BUT ANY LARGER SIZES WHICH MAY BE SHOWN ON A DETAIL CONTROL. IF NO SIZE OF A MEMBER IS GIVEN, C.B.C. CONVENTIONAL CONSTRUCTION PROVISIONS SHALL APPLY TO THAT MEMBER. THE ONLY CERTAIN WAY TO RESOLVE A VAGUE OR CONFLICTING SPECIFICATION IS TO CONTACT THE ENGINEER.
- OUR DESIGN IS BASED ON THE ASSUMPTION THAT THE INDIVIDUAL RESPONSIBLE FOR EXECUTING THIS CONSTRUCTION IS EXPERIENCED AND CAPABLE IN THE BUILDING PRACTICES INVOLVED IN THIS DESIGN. THIS INDIVIDUAL IS HEREAFTER REFERRED TO AS THE "CONTRACTOR."

LUMBER

- ALL STRUCTURAL LUMBER SHALL BE DOUGLAS FIR-LARCH OF THE FOLLOWING GRADES U.N.O.
 - STUDS, PLATES, BLOCKING (SUPPORTING ONLY ROOF & LESS THAN 8' LONG), . . . CONST. OR BTR.
 - STUDS, PLATES, BLOCKING (SUPPORTING FLOOR OR MORE THAN 8' LONG), . . . #2 OR BTR.
 - JOISTS AND PLANKS (2X AND 4X), . . . #2 OR BTR.
 - POSTS AND TIMBERS, BEAMS AND STRINGERS (4X, 6X AND LARGER), . . . #1 OR BTR.
- WOOD IN CONTACT WITH CONCRETE OR MASONRY SHALL BE PRESSURE TREATED DOUGLAS FIR-LARCH OR FOUNDATION GRADE REDWOOD. ALL CUTS IN P.T. D.F. MEMBERS SHALL BE TREATED WITH APPROVED COMPOUND. JOISTS, GIRDERS, OR STUDS WHICH ARE NOT P.T. D.F. NOR FOUNDATION GRADE REDWOOD SHALL BE SEPARATED FROM CONCRETE OR MASONRY BY A MINIMUM OF 1/2" AIRSPACE, OR BY GALVANIZED SHEET METAL PROTECTED FROM WEATHER.
- ALL STRUCTURAL LUMBER SHALL BE MARKED, DRESSED, AND GRADED IN ACCORDANCE WITH A.S.T.M. (D-245-70 & D-255-70), HANDBOOK NO. 72 OF THE U.S.D.A. AND VOLUNTARY PRODUCT STANDARD OF THE US DEPARTMENT OF COMMERCE.
- ALL STRUCTURAL PLYWOOD SHALL BE C-D TYPE OR BETTER WITH EXTERIOR GLUE. FLOOR PLYWOOD SHALL BE OF PANEL INDEX OF 32/16 OR BETTER U.N.O., AND SHALL BE GLEUED TO JOISTS WITH AN APPROVED ADHESIVE.
- 2X OR WIDER SOLID BLOCKING SHALL BE PLACED BETWEEN JOISTS OR RAFTERS AT ALL SUPPORTS UNLESS SUCH MEMBERS ARE IN HANGERS AND SHOWN TO HAVE NO BLOCKING, AND AT 8' MAX. ON CENTER FOR 2X FRAMING MEMBERS AND DEEPER FOR TRUSSES. SEE PLANS FOR BLOCKING REQUIREMENTS FOR TRUSSES. WHENEVER BLOCKING IMPEDES REQUIRED VENTILATION, IT SHALL BE DRILLED WITH CIRCULAR OPENINGS LESS THAN 1/2 THE BLOCK WIDTH IN DIAMETER TO PROVIDE VENTILATION U.N.O. BLOCKS WHICH ARE UNSOUND SHALL NOT BE USED. WALLS SHALL HAVE FIRE BLOCKING AT 10' O.C. MAX.
- STRUCTURAL MEMBERS SHALL NOT BE CUT FOR PLUMBING AND ELECTRICAL UNLESS SPECIFICALLY NOTED OR DETAILED. 2x STUDS LESS THAN 8' LONG AND 2x STUDS LESS THAN 10' LONG MAY BE NOTCHED OR BORED PER C.B.C. "KING" STUDS OR MULLIONS (AT EDGES OF OPENINGS AND CONTINUOUS FROM PLATE TO PLATE) SHALL NOT BE NOTCHED.
- ALL GLU-LAM MEMBERS SHALL BE GRADE 24F-V4 DF/DF, U.N.O.
- ALL 1/2" PLYWOOD SHALL BE APA RATED 5 PLY, MINIMUM.

STRUCTURAL HARDWARE

- ALL CONCEALED BOLTS AND OR NUTS SHALL BE RE-TIGHTENED PRIOR TO APPLYING COVERINGS.
- HARDWARE SIZE, EMBEDMENT, FASTENERS, AND MEMBERS RECEIVING FASTENERS SHALL MEET THE MOST STRINGENT OF THE SPECIFICATION OR THE STANDARD OR SPECIFIC DETAIL. WHERE INTERSECTIONS OF HARDWARE ASSEMBLIES APPEAR TO CONFLICT WITH THE REQUIREMENTS OF ANY INDIVIDUAL STRUCTURAL DETAIL OR INTERFERE WITH STRUCTURAL CONTINUITY, OR UNCERTAINTIES ABOUT INSTALLATION OF THE HARDWARE EXIST, CONTACT THE ENGINEER BEFORE CONTINUING THIS WORK.
- ALL MANUFACTURED METAL CONNECTORS INDICATED IN DRAWINGS ARE "SIMPSON STEEL" UNLESS OTHERWISE SPECIFIED. SUBSTITUTIONS MAY BE MADE WITH HARDWARE I.C.C. RATED TO PERFORM EQUAL OR BETTER THAN THE SPECIFIC SIMPSON HARDWARE. CONTRACTOR SHALL TAKE RISK FOR THE SUITABILITY OF ANY SUBSTITUTION HARDWARE NOT SPECIFICALLY AUTHORIZED BY ENGINEER.
- ALL STEEL PLATES SHALL BE OF A36 STEEL OR BETTER U.N.O.. ALL ROD AND BOLT STEEL SHALL BE OF A307, C1008 OF AMERICAN MANUFACTURE, OR EQUIVALENT, OR BETTER, U.N.O.. ALL WELDING ROD SHALL BE E70XX, U.N.O.
- SHOP DRAWINGS OF ANY CUSTOM FABRICATED HARDWARE OR STRUCTURAL MEMBER SHALL BE PROVIDED FOR THE ENGINEER'S AND CONTRACTOR'S REVIEW. CONTRACTOR SHALL TAKE RESPONSIBILITY FOR DIMENSIONS AND FIT OF SUCH ITEMS, AND PRIOR TO MANUFACTURE, SHALL NOTIFY THE ENGINEER OF ANY UNSUITABILITY OR REQUIRED CHANGE WHICH AFFECTS THE STRUCTURAL STRENGTH OF SUCH ITEMS.
- ALL NAILS AND OTHER FASTENERS FOR P.T. WOOD OR EXPOSED TO WEATHER SHALL BE STAINLESS STEEL, HOT DIPPED GALVANIZED, ZINC-COATED (Z-MAX) OR EQUAL AS DICTATED BY COMPATIBILITY WITH THE METHOD OF PRESSURE TREATMENT.


REINFORCING STEEL AND ANCHOR HARDWARE (R.S.A.H.)

- REINFORCING STEEL IN CONCRETE SHALL IN EVERY MANNER CONFORM TO A.C.I. SPECIFICATIONS.
- R.S.A.H. SHALL BE ACCURATELY PLACED AND SECURED SO THAT IT WILL NOT BE DISPLACED DURING CONCRETE PLACEMENT.
- R.S.A.H. SHALL BE FREE OF OIL, MUD, OR ANY OTHER COATING WHICH WILL ADVERSELY AFFECT BONDING TO CONCRETE. TIGHT GRAIN OXIDATION IS ACCEPTABLE.
- SPLICES IN REINFORCING STEEL SHALL BE A MINIMUM LENGTH OF 50 BAR DIAMETERS IN MASONRY GROUT AND 40 BAR DIAMETERS IN CONCRETE U.N.O. OR SHALL BE SHOWN TO CONFORM TO A.C.I. SPECIFICATIONS AS A MINIMUM.
- REINFORCING STEEL SHALL BE DEFORMED BILLET-STEEL BARS CONFORMING TO A.S.T.M. (A615-68) OF GRADE 40 KSI, U.N.O.
- PROVIDE R.S.A.H. THE FOLLOWING MINIMUM PROTECTIVE CLEAR COVERING OF CONCRETE:
 - CAST AGAINST AND PERMANENTLY EXPOSED TO EARTH 3"
 - FORMED SURFACES EXPOSED TO WEATHER OR IN CONTACT WITH THE EARTH
 - #6 BAR & LARGER 2"
 - #5 BAR & SMALLER 1 1/2"
 - INTERIOR SLABS, WALLS, AND JOISTS 3/4"
 - INTERIOR BEAMS, GIRDERS, COLUMNS 1 1/2"
- DO NOT EXCEED VERTICAL COVER REQUIREMENTS OF TOP BARS AND BOTTOM BARS OF FOOTINGS OR GRADE BEAMS BY MORE THAN 1/2" UNLESS FOOTING OR GRADE BEAM TOTAL VERTICAL DIMENSION IS INCREASED ACCORDINGLY.

SCHEDULES

HOLDOWN SCHEDULE

HOLDOWN SIZE	HFSH02	HDU2	HDU4	HDU5	HDU5	HDU11	HDU14
ROD DIAMETER	--	5/8"	5/8"	5/8"	7/8"	1"	1"
MIN. ROD EMBEDMENT	--	12.58"	16.58"	20.58"	24.78"	24"	24"
# OF 16d IN DBL. STUD	--	24	30	38	--	--	--
MIN. DBL. STUD LENGTH	--	96"	108"	120"	--	--	--
STAB ANCHOR	--	SSTB16	SSTB20	SSTB24	SSTB28	SBH30	SBH30

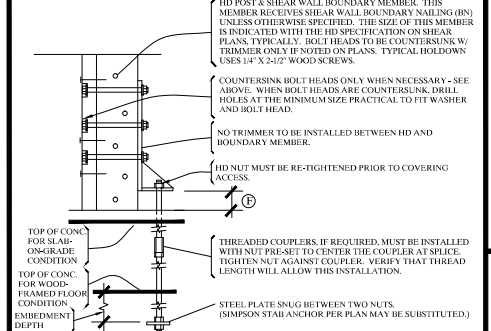

- ### NOTES
- INSTALLATION MUST BE IN ACCORDANCE WITH SIMPSON SPECIFICATIONS.
 - ROD TO BE A307 STEEL, C1008 STEEL, OR EQUIVALENT, OR BETTER. SIMPSON STAB ANCHOR AS SPECIFIED MAY BE SUBSTITUTED.
 - REFER TO STRUCTURAL DETAILS ALSO. ROD EMBEDMENT MAY BE SPECIFIED DIFFERENTLY. THESE DEPTHS ARE FOR 2500 PSI CONCRETE.
 - THIS NAILING APPLIES WHERE 2X-2NS ARE BEING USED TO ACT AS A 3" MEMBER. NAILING IS FOR BOX NAILS IN 2X. USE POST AS NOTED ON PLANS.
 - THIS IS FOR TWO ROWS OF 16d NAILING WITH 6"-8" BETWEEN NAILS AND 4" END DISTANCES. LONGER LENGTHS AND SPACING PREFERRED.
 - DISTANCE FROM TOP OF PLATE TO TOP OF HD SHOE. CONSULT SIMPSON.
 - APPLIES TO MONO POUR CONDITION AND IF NO HOLDOWN IS SPECIFIED ON THE PLAN, IF SLAB IS TO BE POURED SEPARATELY BETWEEN HOLDOWN SILL PLATE AND STEM WALL, USE NEXT LONGEST STAB/ROD (+4"). USE 1" LONG STAB ANCHORS (SSTB1) AT 3X SOLLS PLATE.

SHEAR WALL SCHEDULE

SYM	SHEAR VALUE	PANEL MATERIAL	PLYWOOD FASTENERS/SPACING				LOAD TRANSFER		NOTES			
			NAIL	FWN	FWPL	FWNS	16d	A35		5/8" A.H.		
250	1/2	CDX PLY	8d	6"	1 1/2"	16 GA.	4"	6"	6"	16"	48"	
350	1/2	CDX PLY	8d	4"	1 1/2"	16 GA.	3"	6"	4"	16"	32"	
490	1/2	CDX PLY	8d	3"	1 1/2"	16 GA.	2"	6"	3"	12"	24"	
640	1/2	CDX PLY	8d	2"	1 1/2"	16 GA.	3"	6"	2"	8"	16"	
390	5/8	T-1-1	8d	6"	1 1/2"	16 GA.	4"	6"	6"	16"	48"	
350	5/8	T-1-1	8d	4"	1 1/2"	16 GA.	3"	6"	4"	16"	32"	
490	5/8	T-1-1	8d	3"	1 1/2"	16 GA.	2"	6"	3"	12"	24"	
640	5/8	T-1-1	8d	2"	1 1/2"	16 GA.	3"	6"	2"	8"	16"	
290	3/8	CDX PLY	8d	6"	1 1/2"	16 GA.	4"	6"	6"	16"	48"	
350	3/8	CDX PLY	8d	4"	1 1/2"	16 GA.	3"	6"	4"	16"	32"	
490	3/8	CDX PLY	8d	3"	1 1/2"	16 GA.	2"	6"	3"	12"	24"	
640	3/8	CDX PLY	8d	2"	1 1/2"	16 GA.	3"	6"	2"	8"	16"	
310	1/2	CDX PLY	10d	6"	1 1/2"	16 GA.	4"	6"	4"	16"	32"	
460	1/2	CDX PLY	10d	4"	1 1/2"	16 GA.	3"	6"	3"	12"	24"	
600	1/2	CDX PLY	10d	3"	1 1/2"	16 GA.	2"	6"	2"	8"	24"	
770	1/2	CDX PLY	10d	2"	1 1/2"	16 GA.	--	--	--	6"	16"	
870	1/2	STRUCT 1	10d	2"	1 1/2"	16 GA.	--	--	--	6"	16"	

- ### NOTES
- ALL ANCHOR BOLTS AND HOLDOWN BOLTS ARE TO BE IN PLACE PRIOR TO PLACING CONCRETE.
 - DOUBLE-SIDED SHEAR WALLS REQUIRE DOUBLE THE AMOUNT OF ANCHOR BOLTS, OR PLATE NAILING, STAGGER ANCHOR BOLTS OR NAILING IN DOUBLE-SIDED SHEAR WALLS.
 - PLYWOOD NAILS ARE COMMON OR GALVANIZED BOX WITH FULL HEADS, WHETHER PNEUMATIC OR HAND-DRIVEN. ALL FIELD NAILING SHALL BE 12" O.C. MAXIMUM U.N.O.
 - ANCHOR BOLTS ARE TO BE EMBEDDED AT LEAST 7" INTO THE CONCRETE OR MASONRY AND ARE TO BE SPACED PER THE SHEAR SCHEDULE ON ALL WALLS WITH ONE ANCHOR BOLT A MAXIMUM OF 12" FROM THE END OF EACH SILL PLATE AND NO CLOSER THAN 5" FROM THE END OF EACH SILL PLATE. TWO ANCHOR BOLTS PER SILL. ALL ANCHOR BOLTS ARE TO HAVE A #3x0.225 STEEL PLATE WASHER.
 - SHEAR NAILING CALLED OUT ON STRUCTURAL PLANS WHERE SHEAR WALL SYMBOLS ARE NOT SHOWN TAKE PRECEDENCE OVER THOSE ON THIS SCHEDULE.
 - ALL EDGE NAILS MUST BE SET IN BOTH INNER AND OUTER LAP OF PANEL EDGES. NAILS MUST BE ON THE FULL THICKNESS OF THE PLYWOOD AND NOT IN THE LAP JOINT.
 - STUDS @ 16" O.C. MAXIMUM OR PLYWOOD NAILED WITH FACE GRAIN ACROSS STUDS
 - FOUNDATION SILL PLATES AND ALL FRAMING MEMBERS RECEIVING EDGE NAILING FROM ADJUTING PANELS SHALL NOT BE LESS THAN A 3X NOMINAL MEMBER AND FOUNDATION SILL PLATES SHALL NOT BE LESS THAN A SINGLE 3X P.T. FRAMING MEMBER. ALL PANEL EDGES SHALL BE BLOCKED W/3X BLOCKING OR 2X BLOCKING LAID VERTICAL.
 - 16d NAILS MAY BE UNGALVANIZED BOX NAILS. 16d & A35 SPACINGS ARE TO TRANSFER SHEAR WHERE PLYWOOD IS NOT CONTINUOUS.
 - O.S.B. (ORIENTED STRAND BOARD) SHALL BE CONSIDERED EQUIVALENT TO CDX PLYWOOD.

NAILING SCHEDULE

1. JOIST TO SILL, TOP PLATE, OR GIRDER: TOE NAIL	3-8d
2. BRIDGING TO JOISTS, RAFTER, OR TRUSSES: TOE NAIL EACH END	2-8d
3. 16d OR SMALLER SUBFLOOR TO EACH JOIST: FACE NAIL	2-8d
4. WIDER THAN 16d SUBFLOOR TO EACH JOIST: FACE NAIL	3-8d
5. 2x SUBFLOOR TO JOIST OR GIRDER: FACE NAIL	2-16d
6. SCOTCH BLOCK TO JOIST OR GIRDER: FACE NAIL	1-16d @ 8" O.C.
7. SOLE PLATE TO JOIST OR BLOCKING @ BRACED WALL PANELS	2-16d @ 16" O.C.
8. TOP & BOT PLATE TO STUD: END NAIL	2-16d @ 16" O.C.
9. STUD TO TOP & BOT PLATE	4-8d TOE NAIL OR 2-16d END NAIL
10. DOUBLED STUDS: FACE NAIL	16d @ 24" O.C.
11. DOUBLE TOP PLATES: FACE NAIL	16d @ 16" O.C.
12. DOUBLE TOP PLATES, SPLICE: FACE NAIL	9-16d
13. BLOCKING JOISTS OR RAFTERS TO TOP PLATE: TOE NAIL	3-8d
14. RIM JOIST TO TOP PLATE: TOE NAIL	8d @ 6" O.C.
15. TOP PLATES, LAPS & INTERSECTIONS: FACE NAIL	2-16d
16. CONTINUOUS HEADER (2) PIECES: FACE NAIL ALONG EDGE	16d @ 16" O.C.
17. CEILING JOISTS TO RAFTERS: FACE NAIL	3-8d
18. CONTINUOUS HEADER TO STUD: TOE NAIL	4-8d
19. CEILING JOIST, LAPS OVER PARTITIONS: FACE NAIL	3-16d
20. CEILING JOISTS TO PARALLEL RAFTERS: FACE NAIL, MIN.	3-16d
21. RAFTER TO PLATE: TOE NAIL	3-8d
22. 1x DIAGONAL BRACE TO EACH STUD & PLATE: FACE NAIL	2-8d
23. 16d OR SMALLER SHEATHING TO EACH BEARING: FACE NAIL	3-8d
24. WIDER THAN 1x8 SHEATHING TO EACH BEARING: FACE NAIL	3-8d
25. BUILT-UP CORNER STUDS	16d @ 24" O.C.
26. BUILT-UP GIRDER & BEAM, MIN. FACE NAIL	2M T&B @ 32" O.C., STAGGERED EA. SIDE
27. 2x PLANKS: FACE NAIL	16d @ EACH BEARING
28. COLLAR TIE TO RAFTER: FACE NAIL	3-16d
29. JACK RAFTER TO HIP	3-16d TOE NAIL OR 2-16d FACE NAIL
30. ROOF RAFTER TO 2x RIDGE BOARD: TOE OR FACE NAIL	2-16d
31. JOIST TO BAND JOIST: FACE NAIL	3-16d
32. LEDGER STRIP: FACE NAIL	3-16d @ 16" O.C.


LIMITATION OF RESPONSIBILITY

- THE ENGINEER IS MAKING AN ANALYSIS, EVALUATION, AND DESIGN OF THE PROPOSED STRUCTURE AS INTERPRETED ON THE BASIS OF DRAWINGS AND INFORMATION PROVIDED BY OTHER PARTIES. NO EVALUATION IS MADE ABOUT THE SUITABILITY, CONSTRUCTION, WEATHER-PROOFING, INSECT-PROOFING, SAFETY, NOR ANY OTHER FEATURE OF THIS BUILDING PROJECT EXCEPT THE ACTUAL FINISHED STRUCTURE OCCUPIED AND SITED AS DESIGNED. THE ENGINEER SHALL NOT BE RESPONSIBLE FOR ENFORCING THE CONSTRUCTION OF THIS BUILDING TO PLANS. SPECIFICATIONAL, CONSTRUCTION PRACTICES DO NOT SEEM APPROPRIATE, NOTIFY THE ENGINEER BEFORE CONTINUING THIS WORK.
- WHERE A PARTICULAR STRUCTURAL DETAIL IS NOT SHOWN, THE ASSUMPTION IS TYPICALLY THAT THE DETAIL(S) OF THE MOST SIMILAR CONDITION(S) SHOWN IS (ARE) APPROPRIATE. WHERE NO DETAIL IS SHOWN OF ANY SIMILAR CONDITION, AND WHERE FUNCTIONAL CONSTRUCTION PRACTICES DO NOT SEEM APPROPRIATE, NOTIFY THE ENGINEER BEFORE CONTINUING THIS WORK.
- THE CONTRACTOR SHALL TAKE FULL RESPONSIBILITY FOR CONSTRUCTION SAFETY, EXCAVATION SAFETY, PROTECTION OF ADJACENT STRUCTURES, TREES AND THEIR ROOTS, AND UTILITY LINES.
- IF PRESENT OR FUTURE SITE CONDITIONS INTERFERE WITH OR REQUIRE MODIFICATION TO STRUCTURE DESIGN, NOTIFY ENGINEER PROMPTLY.
- THE CONTRACTOR SHALL TAKE FULL RESPONSIBILITY FOR VERIFYING CORRECTNESS OF DIMENSIONS BEFORE CONSTRUCTION WHERE CONFLICTS OR OMISSIONS OCCUR.

ABBREVIATIONS


AB	ANCHOR BOLT	HT	HIGH/FT
AC	ASPHALTIC CONCRETE	INT	INTERIOR
ALT	ALTERNATE	LS	LAG SCREW
BDLG	BUILDING	MAX	MAXIMUM
BLKG	BLOCKING	MIN	MINIMUM
BN	BOUNDARY NAILING	NW	NEW
CMU	CONCRETE MASONRY UNIT	NTS	NOT TO SCALE
CLR	CLEAR	(P)	PROPOSED
COL	COLUMN	PL	PLATE
CONC	CONCRETE	RB	REBAR
CONT	CONTINUOUS	RDWD	REDWOOD
DF	DOUGLAS FIR	S	SLOPE =
DIA	DIAMETER	SAD	SEE ARCH. DRAWINGS
DBL	DOUBLE	SM	SIMILAR
(E)	SCAFFOLD	SQ	SQUARE
EA	EACH	STGR	STAGGERED
EF	EACH FACE	STIFF	STIFFENER
EL=	ELEVATION EQUALS	SW	SHEAR WALL
EN	EDGE NAILING	SW EN	SHEAR WALL EDGE NAILING
EW	EACH WAY	TOP & BOTTOM	TOP & BOTTOM
EXT	EXTERIOR	TOBM	TOP OF BEAM
FB	FACE OF BLOCK	TOP	TOP OF FRAMING
FC	FACE OF CONCRETE	TOP	TOP OF PLYWOOD
FD	FIELD NAILING	ON CENTERS	ON CENTERS
FS	FACE OF STUD	OH	OPPOSITE HAND
FTNG	FOOTING	T&G	TONGUE AND GROOVE
G	GRADE	TOC	TOP OF CURB
GW	Gypsum WALLBOARD	TYP	TYPICAL
H	HOLD	UNO	UNLESS NOTED OTHERWISE
HDB	HOT DIPPED GALVANIZED	WS	WOOD SCREW

STRUCTURAL PLAN SPECIFICATIONS TAKE PRECEDENCE OVER THESE SCHEDULES. SEE SHEAR PLAN & SHEAR WALL SCHEDULE FOR BOUNDARY NAILING (BN), PLATE AND ANCHOR BOLT REQUIREMENTS.

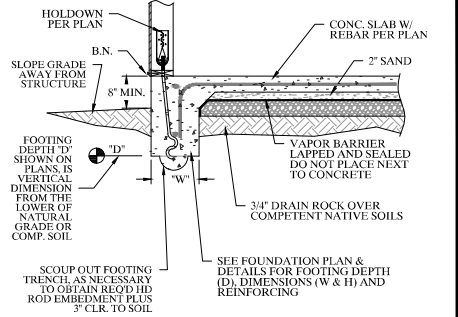


5 SECTION - FOOTING AT HOLDOWN

1 GABLE SHEAR CONNECTION

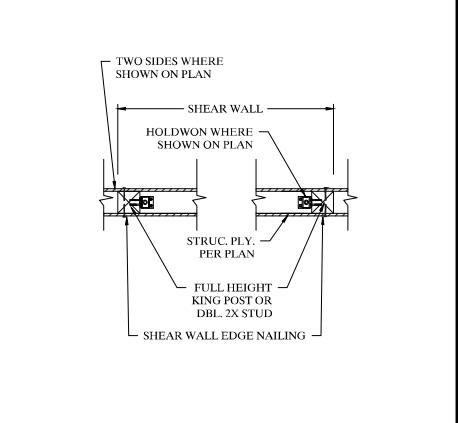


6 PLAN - SHEAR WALL & HOLDOWN

2 EAVE SHEAR CONNECTIONS

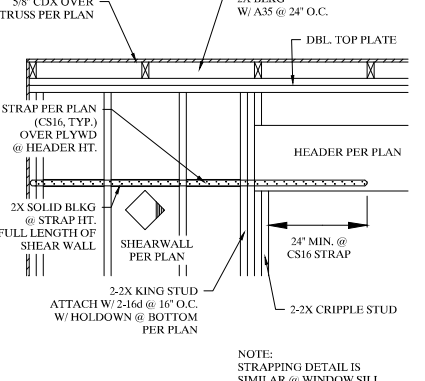

9 PIER WALL STRAPPING

3 TYP. REINFORCING STEEL BENDS

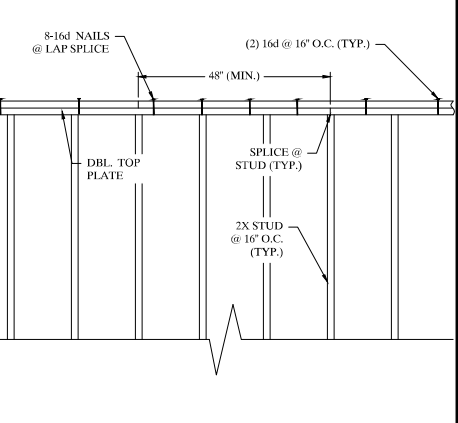

8 TOP PLATE SPLICE

4 ELEVATION - FOOTING AT HOLDOWN

SHEET 36 OF 58

ATLAS ENGINEERING

PO BOX 26
ALBERTA, CA 95116
(971) 822-2822 PH & FAX
WWW.ATLASENG.NET

9/20/2024

REGISTERED PROFESSIONAL ENGINEER
C 88893
EXPIRES 9-30-25
CIVIL
STATE OF CALIFORNIA

SPECIFICATIONS & TYP. DETAILS

REDWAY TRANSFER STATION
CONSERVATION CAMP RD., REDWAY, CA 95560
APN: 222-161-002

Date: _____

Revision No.: _____

Date: 9/20/2024

Project #: 24041

Drawn by: KIM

Scale: N.T.S.

Sheet No. **SO**

SPECIAL INSPECTIONS & STRUCTURAL OBSERVATION SCHEDULE ¹²³⁷

	VERIFICATION & INSPECTION	C	P	INSPECTED BY (SIGNATURE)	DATE
SOILS	1. VERIFY MATERIALS BELOW SHALLOW FOUNDATIONS ARE ADEQUATE TO ACHIEVE THE DESIGN BEARING CAPACITY.		X		
	2. VERIFY EXCAVATIONS ARE EXTENDED TO PROPER DEPTH AND HAVE REACHED PROPER MATERIAL.		X		
CONCRETE	1. INSPECT FORMWORK FOR SHAPE, LOCATION AND DIMENSIONS OF THE CONCRETE MEMBER BEING FORMED.		X		
	2. INSPECTION OF REINFORCING STEEL & PLACEMENT.		X		
	a. OBTAIN MILL CERTIFICATES FOR REINFORCING STEEL, VERIFY COMPLIANCE WITH APPROVED CONSTRUCTION DOCUMENTS, AND VERIFY STEEL SUPPLIED CORRESPONDS TO CERTIFICATE.	-	-		
	3. INSPECTION OF BOLTS TO BE INSTALLED IN CONCRETE PRIOR TO AND DURING PLACEMENT OF CONCRETE		X		
	4. INSPECTION OF ANCHORS INSTALLED/EPOXIED IN HARDENED CONCRETE.		X		
	5. VERIFY USE OF REQUIRED DESIGN MIX, 3000 PSI. SAMPLE AND SLUMP ONLY. ⁵ NOTE: (1) SAMPLE (4-6" CYLINDERS PER 150 CU. YD. OF CONCRETE. (1) SAMPLE PER DAY. (1) SAMPLE PER BATCH/TRUCK IF LESS THAN (5) BATCHES		X		
	6. INSPECTION OF CONCRETE PLACEMENT		X		
SEISMIC ² RESISTANCE	1. STRUCTURAL WOOD INSPECTION (NOT REQUIRED WHERE FASTENER SPACING OF THE SHEATHING IS MORE THAN 4" O.C.)				
	a. SHEARPLY NAILING				
	i. SHEAR WALLS		X		
	ii. FLOOR SHEATHING		X		
	iii. ROOF SHEATHING		X		
	b. HOLDOWN & ANCHOR BOLT INSTALLATIONS		X		
	c. LATERAL TIES, STRAPPING & MISC. SHEAR CONNECTORS (INCLUDING DRAG STRUTS & BRACES)		X		
	2. NON-STRUCTURAL SYSTEMS AND COMPONENTS				
	a. OBTAIN CERTIFICATE THAT NON-STRUCTURAL COMPONENTS AND DESIGNATED SEISMIC SYSTEMS HAVE BEEN TESTED PER SECTION 1708.5 OF 2010 CBC.	-	-		
	b. VERIFY THAT THE EQUIPMENT LABEL AND ANCHORAGE OR MOUNTING CONFORM TO THE CERTIFICATE OF COMPLIANCE WHEN MECHANICAL AND ELECTRICAL EQUIPMENT MUST BE SEISMICALLY QUALIFIED.		X		
	c. PIPING SYSTEMS AND MECHANICAL UNITS CONTAINING FLAMMABLE, COMBUSTIBLE OR TOXIC MATERIALS (NATURAL GAS)		X		
	d. ANCHORAGE OF ELECTRICAL EQUIPMENT FOR EMERGENCY OR STAND-BY POWER SYSTEMS.		X		
	e. ANCHORAGE OF NON-EMERGENCY ELECTRICAL EQUIPMENT		X		
f. ANCHORAGE OF STORAGE RACKS 8' OR GREATER IN HEIGHT (WHERE APPLICABLE).		X			
g. SUSPENDED CEILING AND ITS ANCHORAGE (WHERE APPLICABLE).		X			
GENERAL INSPECTIONS	1. PERIODIC STRUCTURAL OBSERVATION SHALL OCCUR DURING DEMOLITION AND ROUGH FRAMING PRIOR TO COVERING WALLS		X		

INSPECTION NOTES:

- 1) ALL SPECIAL INSPECTIONS SHALL BE PROVIDED BY ATLAS ENGINEERING, UNLESS OTHER ARRANGEMENTS ARE MADE PRIOR TO INSPECTION AND CONFIRMED WITH THE ENGINEER-OF-RECORD. SOILS/EXCAVATION INSPECTIONS SHALL BE PROVIDED BY "CRAWFORD & ASSOCIATES, INC.", (916) 952-6684.
- 2) 48 HOURS NOTICE IS REQUIRED PRIOR TO SPECIAL INSPECTION.
- 3) EACH CONTRACTOR RESPONSIBLE FOR THE CONSTRUCTION OF A MAIN WIND- OR SEISMIC-FORCE-RESISTING SYSTEM, DESIGNATED SEISMIC SYSTEM OR A WIND OR SEISMIC-RESISTING COMPONENT LISTED IN THE STATEMENT OF SPECIAL INSPECTIONS SHALL SUBMIT A WRITTEN STATEMENT OF RESPONSIBILITY TO THE BUILDING OFFICIAL AND THE OWNER PRIOR TO THE COMMENCEMENT OF WORK ON THE SYSTEM OR COMPONENT. THE CONTRACTOR'S STATEMENT OF RESPONSIBILITY SHALL CONTAIN ACKNOWLEDGEMENT OF AWARENESS OF THE SPECIAL REQUIREMENTS CONTAINED IN THE STATEMENT OF SPECIAL INSPECTION.
- 4) PROVIDE CONCRETE BATCH PLANT "RECIPE"/MIX DESIGN FOR REVIEW PRIOR TO PLACEMENT.
- 5) PROVIDE CERTIFICATE OF COMPLIANCE FOR ALL MATERIALS (USED FOR SEISMIC RESISTANCE) FOR REVIEW & APPROVAL PRIOR TO CONSTRUCTION.

EARTHQUAKE DESIGN DATA:

$I = 1.00$ (OCCUPANCY CATEGORY II)
 $S_s = 1.922$
 $S_1 = 0.776$
 SITE CLASS "D"
 $S_{DS} = 1.281$
 $S_{D1} = 0.776$
 SEISMIC DESIGN CATEGORY "E"
 BASIC SEISMIC-FORCE-RESISTING SYSTEM(S):
 A. BEARING WALL SYSTEMS:
 13) LIGHT-FRAMED WALLS SHEATHED WITH WOOD STRUCTURAL PANELS
 RATED FOR SHEAR RESISTANCE (R=6.5)
 SEISMIC RESPONSE COEFFICIENT, $C_s = 0.1077$ (ASD)
 EQUIVALENT LATERAL FORCE PROCEDURE

FOUNDATION DESIGN DATA:

ALLOWABLE BEARING PRESSURE = 1500 PSF (MIN.)



INSPECTION SCHEDULE
REDWAY TRANSFER STATION
CONSERVATION CAMP RD. REDWAY, CA 95560
APN: 222-161-002

Date:

Revision No.:

Date: 9/20/2024

Project #: 24041

Drawn by: KIM



Scale: N.T.S.

Sheet No.


S0.1

LEGEND:

C - CONTINUOUS
 P - PERIODIC

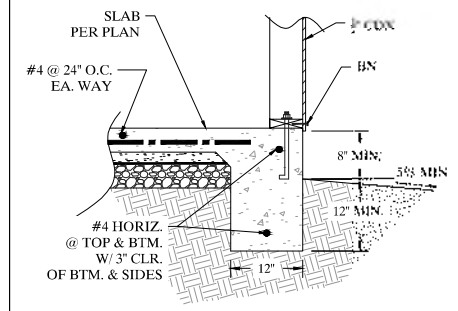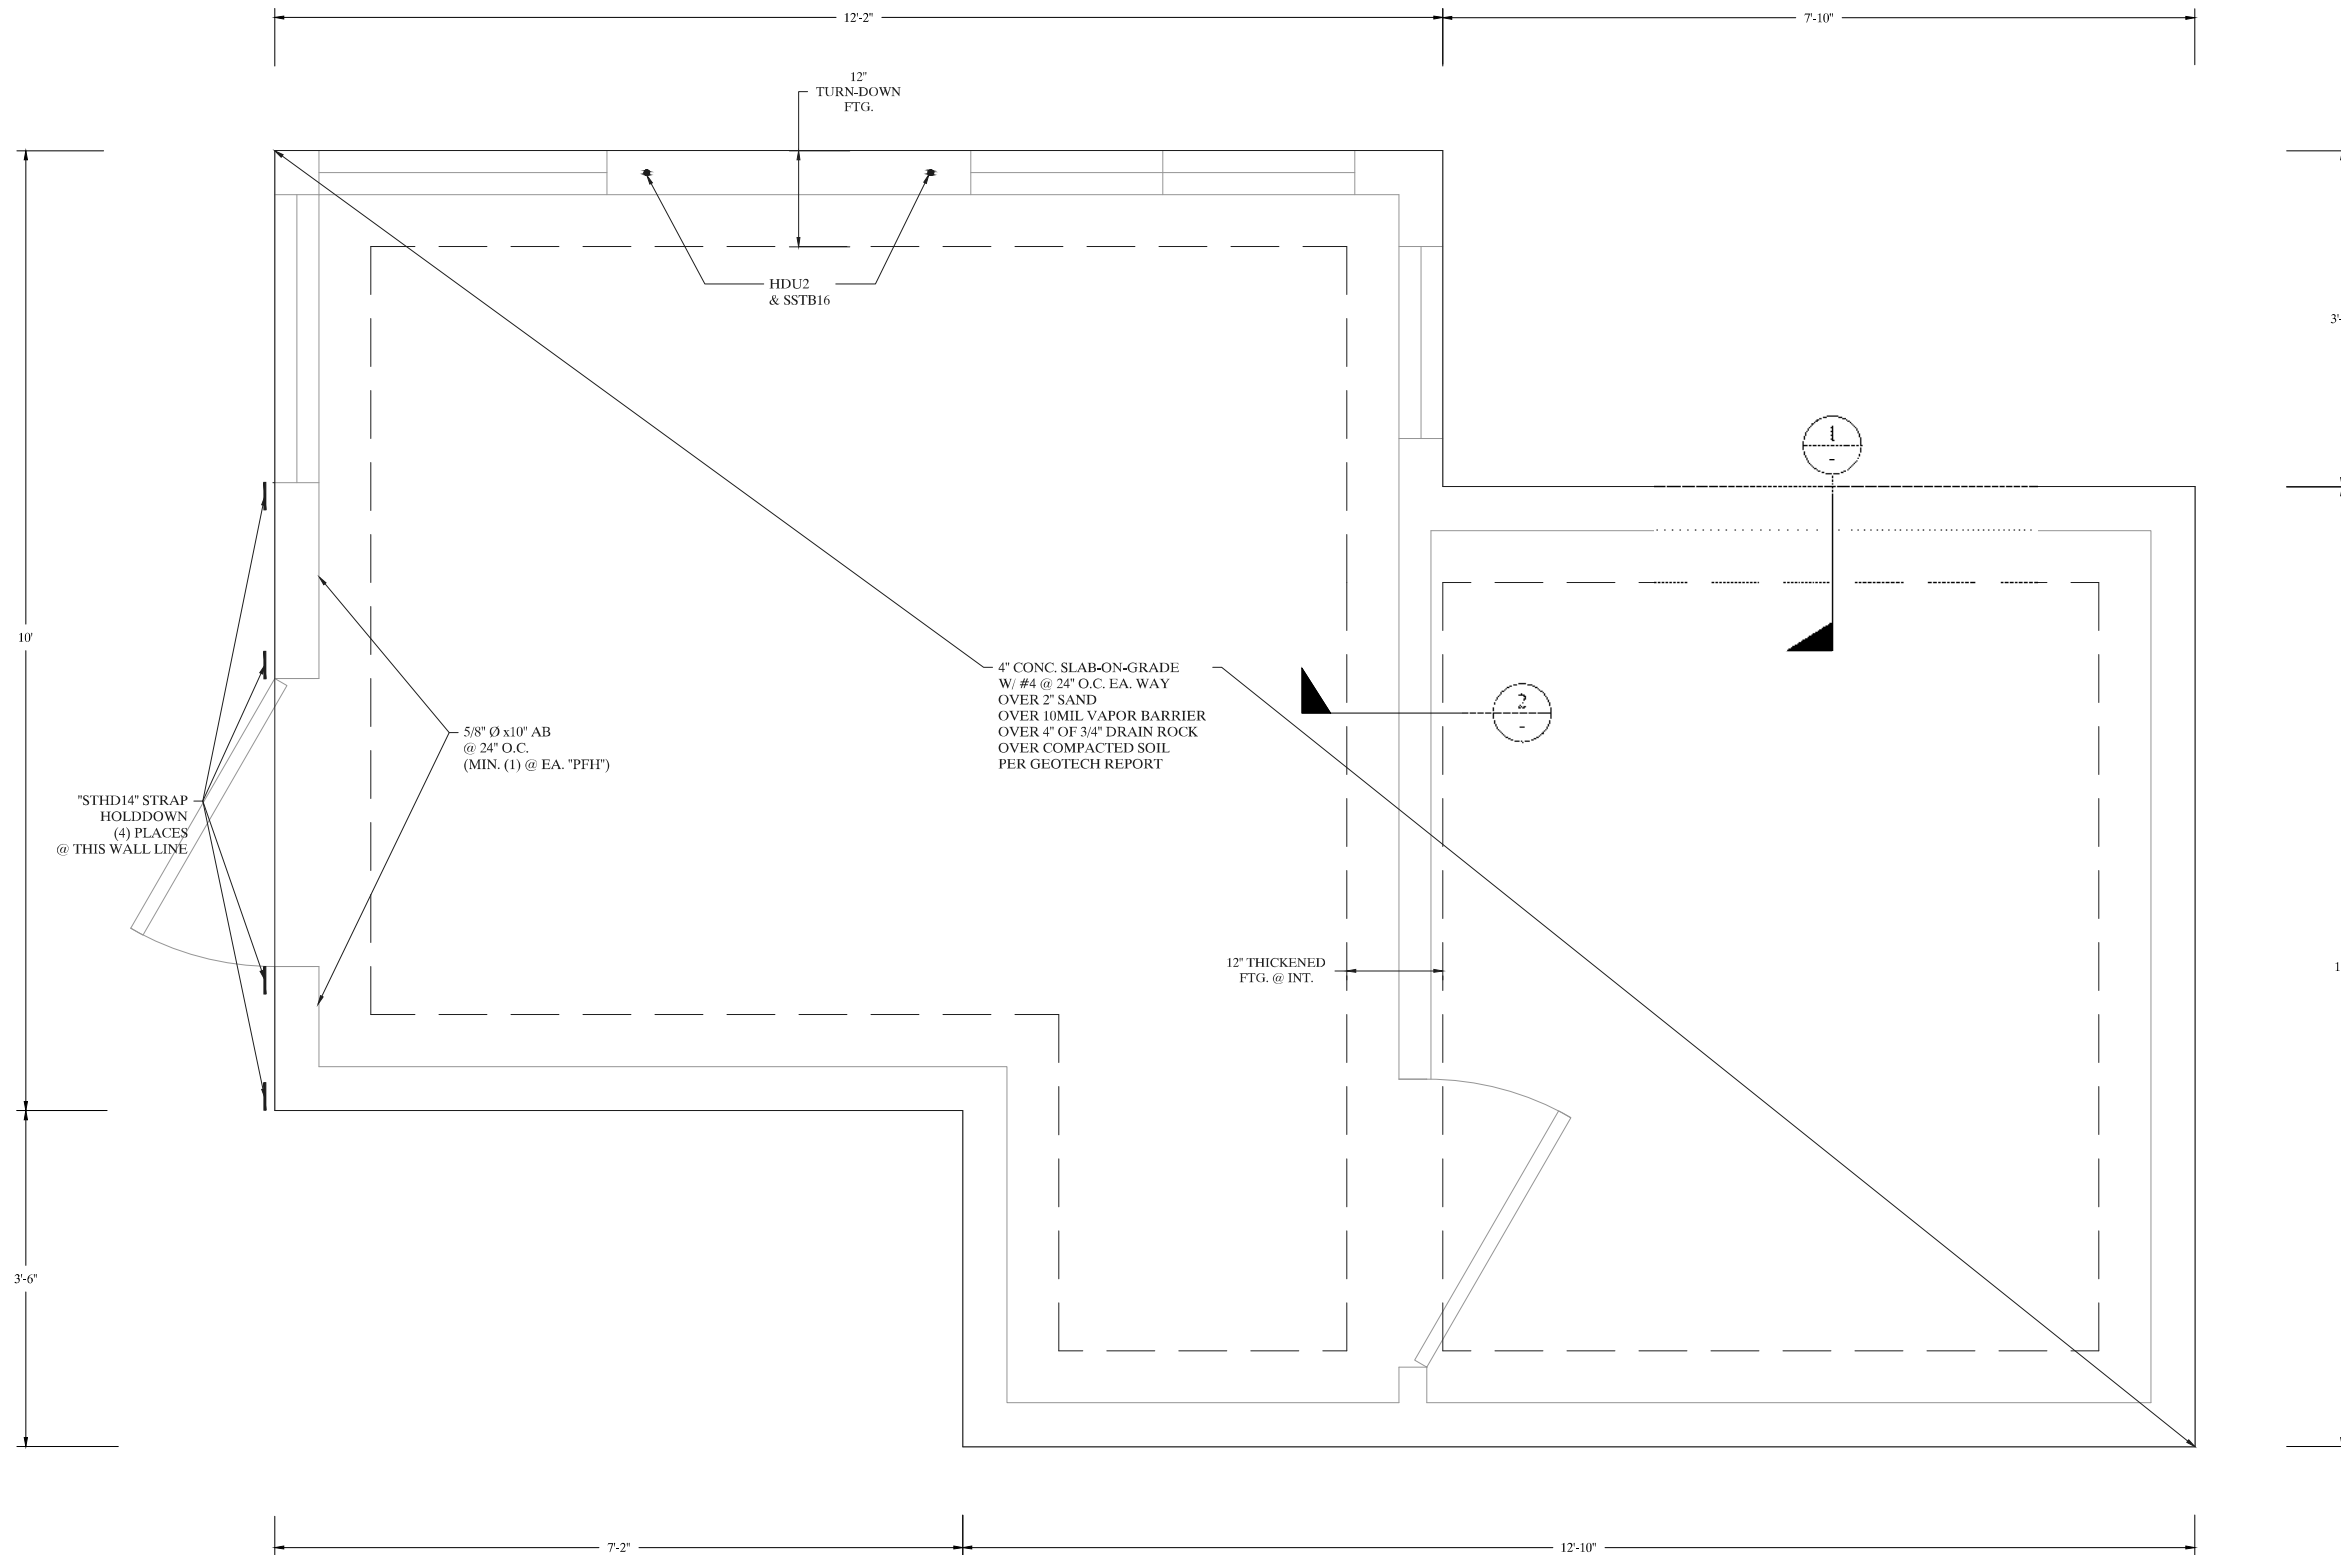

TYPICAL EXTERIOR FOOTING 3/4\" = 1'-0\" 1

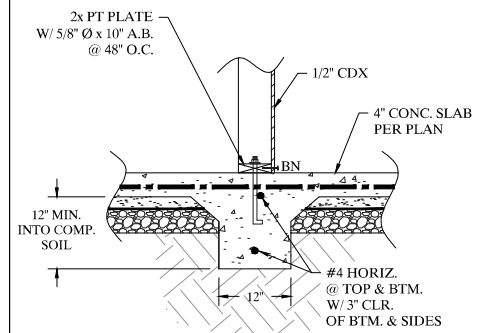

TYPICAL EXTERIOR FOOTING 3/4\" = 1'-0\" 2

FOUNDATION PLAN & DETAILS

REDWAY TRANSFER STATION
 CONSERVATION CAMP RD. REDWAY, CA 95560
 APN: 222-161-002

Date:

Revision No.:

Date: 9/20/2024

Project #: 24041

Drawn by: KIM

Scale: 1\"-1'-0\"

Sheet No.

S1

NOT USED N.T.S. 3

NOT USED N.T.S. 4


CONCRETE AND FOUNDATION NOTES:

1. REVIEW GEOTECHNICAL REPORT BY "CRAWFORD & ASSOCIATES, INC.", DATED JUNE 28, 2023, PRIOR TO START OF CONSTRUCTION FOR RECOMMENDATIONS ON EXCAVATION, GRADING AND FOUNDATION WORK. ALL RECOMMENDATIONS SHALL BE FOLLOWED, INCLUDING OVEREXCAVATION PER SECTION 7.5.3.
2. FINAL SUBGRADE SHOULD BE PROOF-ROLLED TO A FIRM SURFACE PRIOR TO THE PLACEMENT OF ANY ADDITIONAL FILL MATERIALS. SUBGRADE SHOULD BE PROTECTED FROM DRYING OR EXCESSIVE MOISTURE.
3. STRUCTURAL FILL MATERIALS SHALL MEET REQUIREMENTS OF GEOCHINICAL REPORT AS NOTED ABOVE.
4. ALL CONCRETE MIN. 3000 PSI COMMERCIAL COMPRESSIVE STRENGTH. SPECIAL INSPECTION IS REQUIRED PER SHEET S0.1.
5. ALL REINFORCING STEEL ≤#5 SHALL BE MIN. 40 KSI TENSILE STRENGTH.
6. ALL CONCRETE PADS SHALL HAVE #5 BARS @ 12" O.C. EACH WAY W/ 3" MIN. CLEARANCE FROM BOTTOM & SIDES.
7. ENGINEER SHALL INSPECT FOUNDATION EXCAVATION PRIOR TO THE PLACEMENT OF STRUCTURAL FILL OR CONCRETE. SEE SHEET S0.1.
8. SOIL BEARING PRESSURE IS ASSUMED TO BE 1,500 PSF (MIN.).
9. ALL WOOD MEMBERS IN DIRECT CONTACT WITH CONCRETE AND ALL WOOD MEMBERS LOCATED WITHIN 8" OF EARTHEN MATERIALS SHALL BE PRESSURED TREATED D.F.
10. ANCHOR BOLTS SHALL BE MIN. 5/8" DIAMETER A307 STEEL WITH 3X3X0.229" PLATE WASHERS. BOLTS SHALL BE EMBEDDED A MINIMUM OF 7" INTO CONCRETE, SPACED NOT MORE THAN 48" O.C. PROVIDE A MINIMUM OF TWO BOLTS PER SILL, WITH ONE BOLT LOCATED NOT MORE THAN 5" OR LESS THAN 7 BOLT DIAMETERS FROM EACH END.
11. FOLLOW ALL MANUFACTURERS INSTALLATION GUIDELINES FOR SPECIFIED HOLDOWN ANCHORS AND HARDWARE.
12. REFER TO SHEARWALL AND HOLDOWN SCHEDULES FOR ADDITIONAL REQUIREMENTS, ALL WALL LINES.
13. ALL NAILS AND OTHER FASTENERS FOR PRESSURE TREATED WOOD OR EXPOSED TO WEATHER SHALL BE STAINLESS STEEL, HOT DIPPED GALVANIZED, ZINC-COATED (Z-MAX) OR EQUAL AS DICTATED BY COMPATIBILITY WITH THE METHOD OF PRESSURE TREATMENT.





SHEAR PLAN

REDWAY TRANSFER STATION
CONSERVATION CAMP RD. REDWAY, CA 95560
APN: 222-161-002

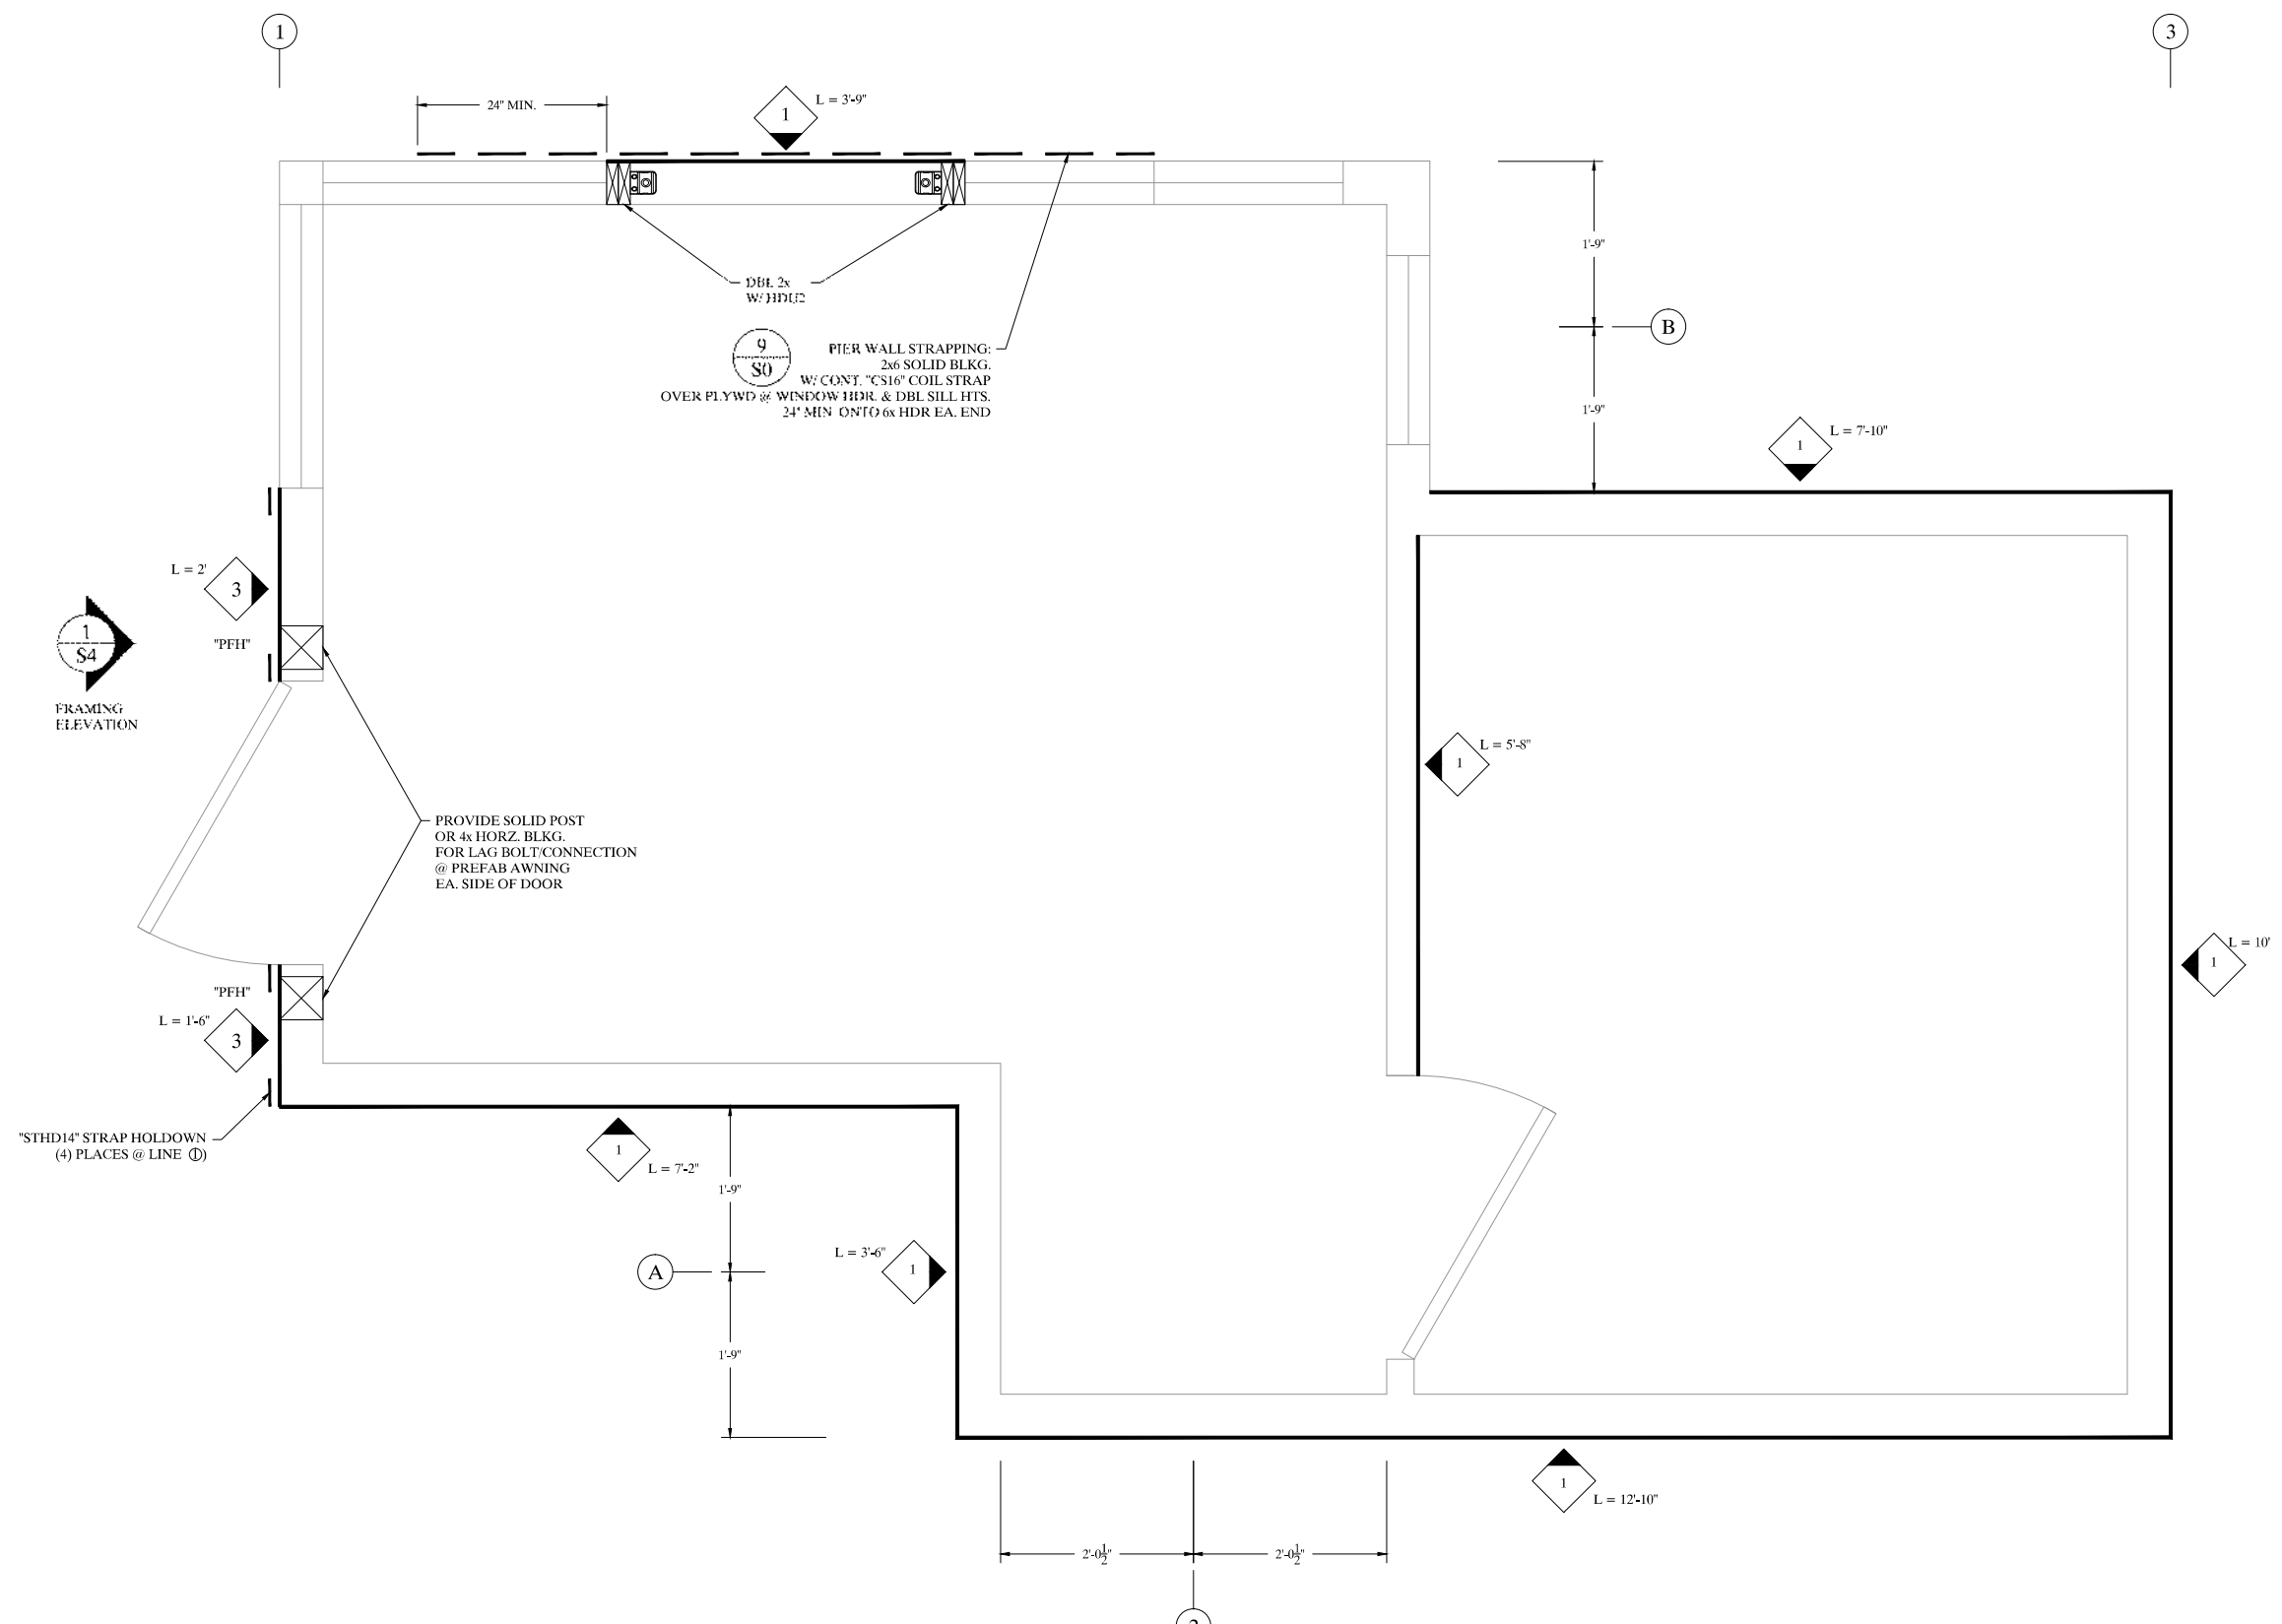


- SHEAR NOTES:**
- SEE S0 SHEET FOR SHEAR SCHEDULE, NAILING SCHEDULES, AND ADDITIONAL INFORMATION.
 - INSTALL 1/2" CDX W/8d @ 6" BN / 12 FN ON ALL SHEATHABLE EXTERIOR SURFACES, UNLESS NOTED OTHERWISE ON SHEAR PLAN.
 - ATTACH HDU2 TO DBL 2x STUD SISTERED TOGETHER W/ 2-16d @ 12" O.C.
 - "L=x" DENOTES MINIMUM WIDTH OF SHEAR WALL. CONTACT ENGINEER-OF-RECORD IF MINIMUM WALL WIDTH IS NOT ACHIEVABLE.
 - 2x6 SOLID FIRE BLOCKING REQUIRED AT 10' MAX HEIGHT IN ALL TALL EXTERIOR WALLS.


SYM	SHEAR VALUE	PANEL MATERIAL	PLYWOOD FASTENER/SPACING		LOAD TRANSFER		
			NAIL	EN/BN	16d	A35	5/8" A.B.
1	260 plf	1/2" CDX PLY	8d	6"	6"	16"	48"
3	490 plf	1/2" CDX PLY	8d	3"	3"	12"	24"

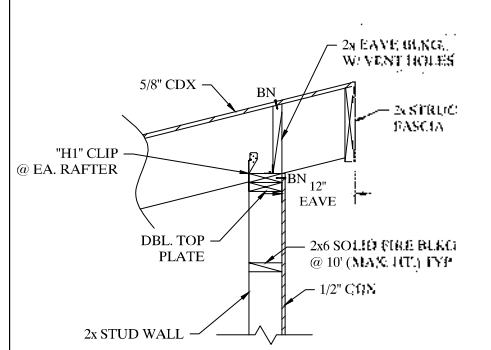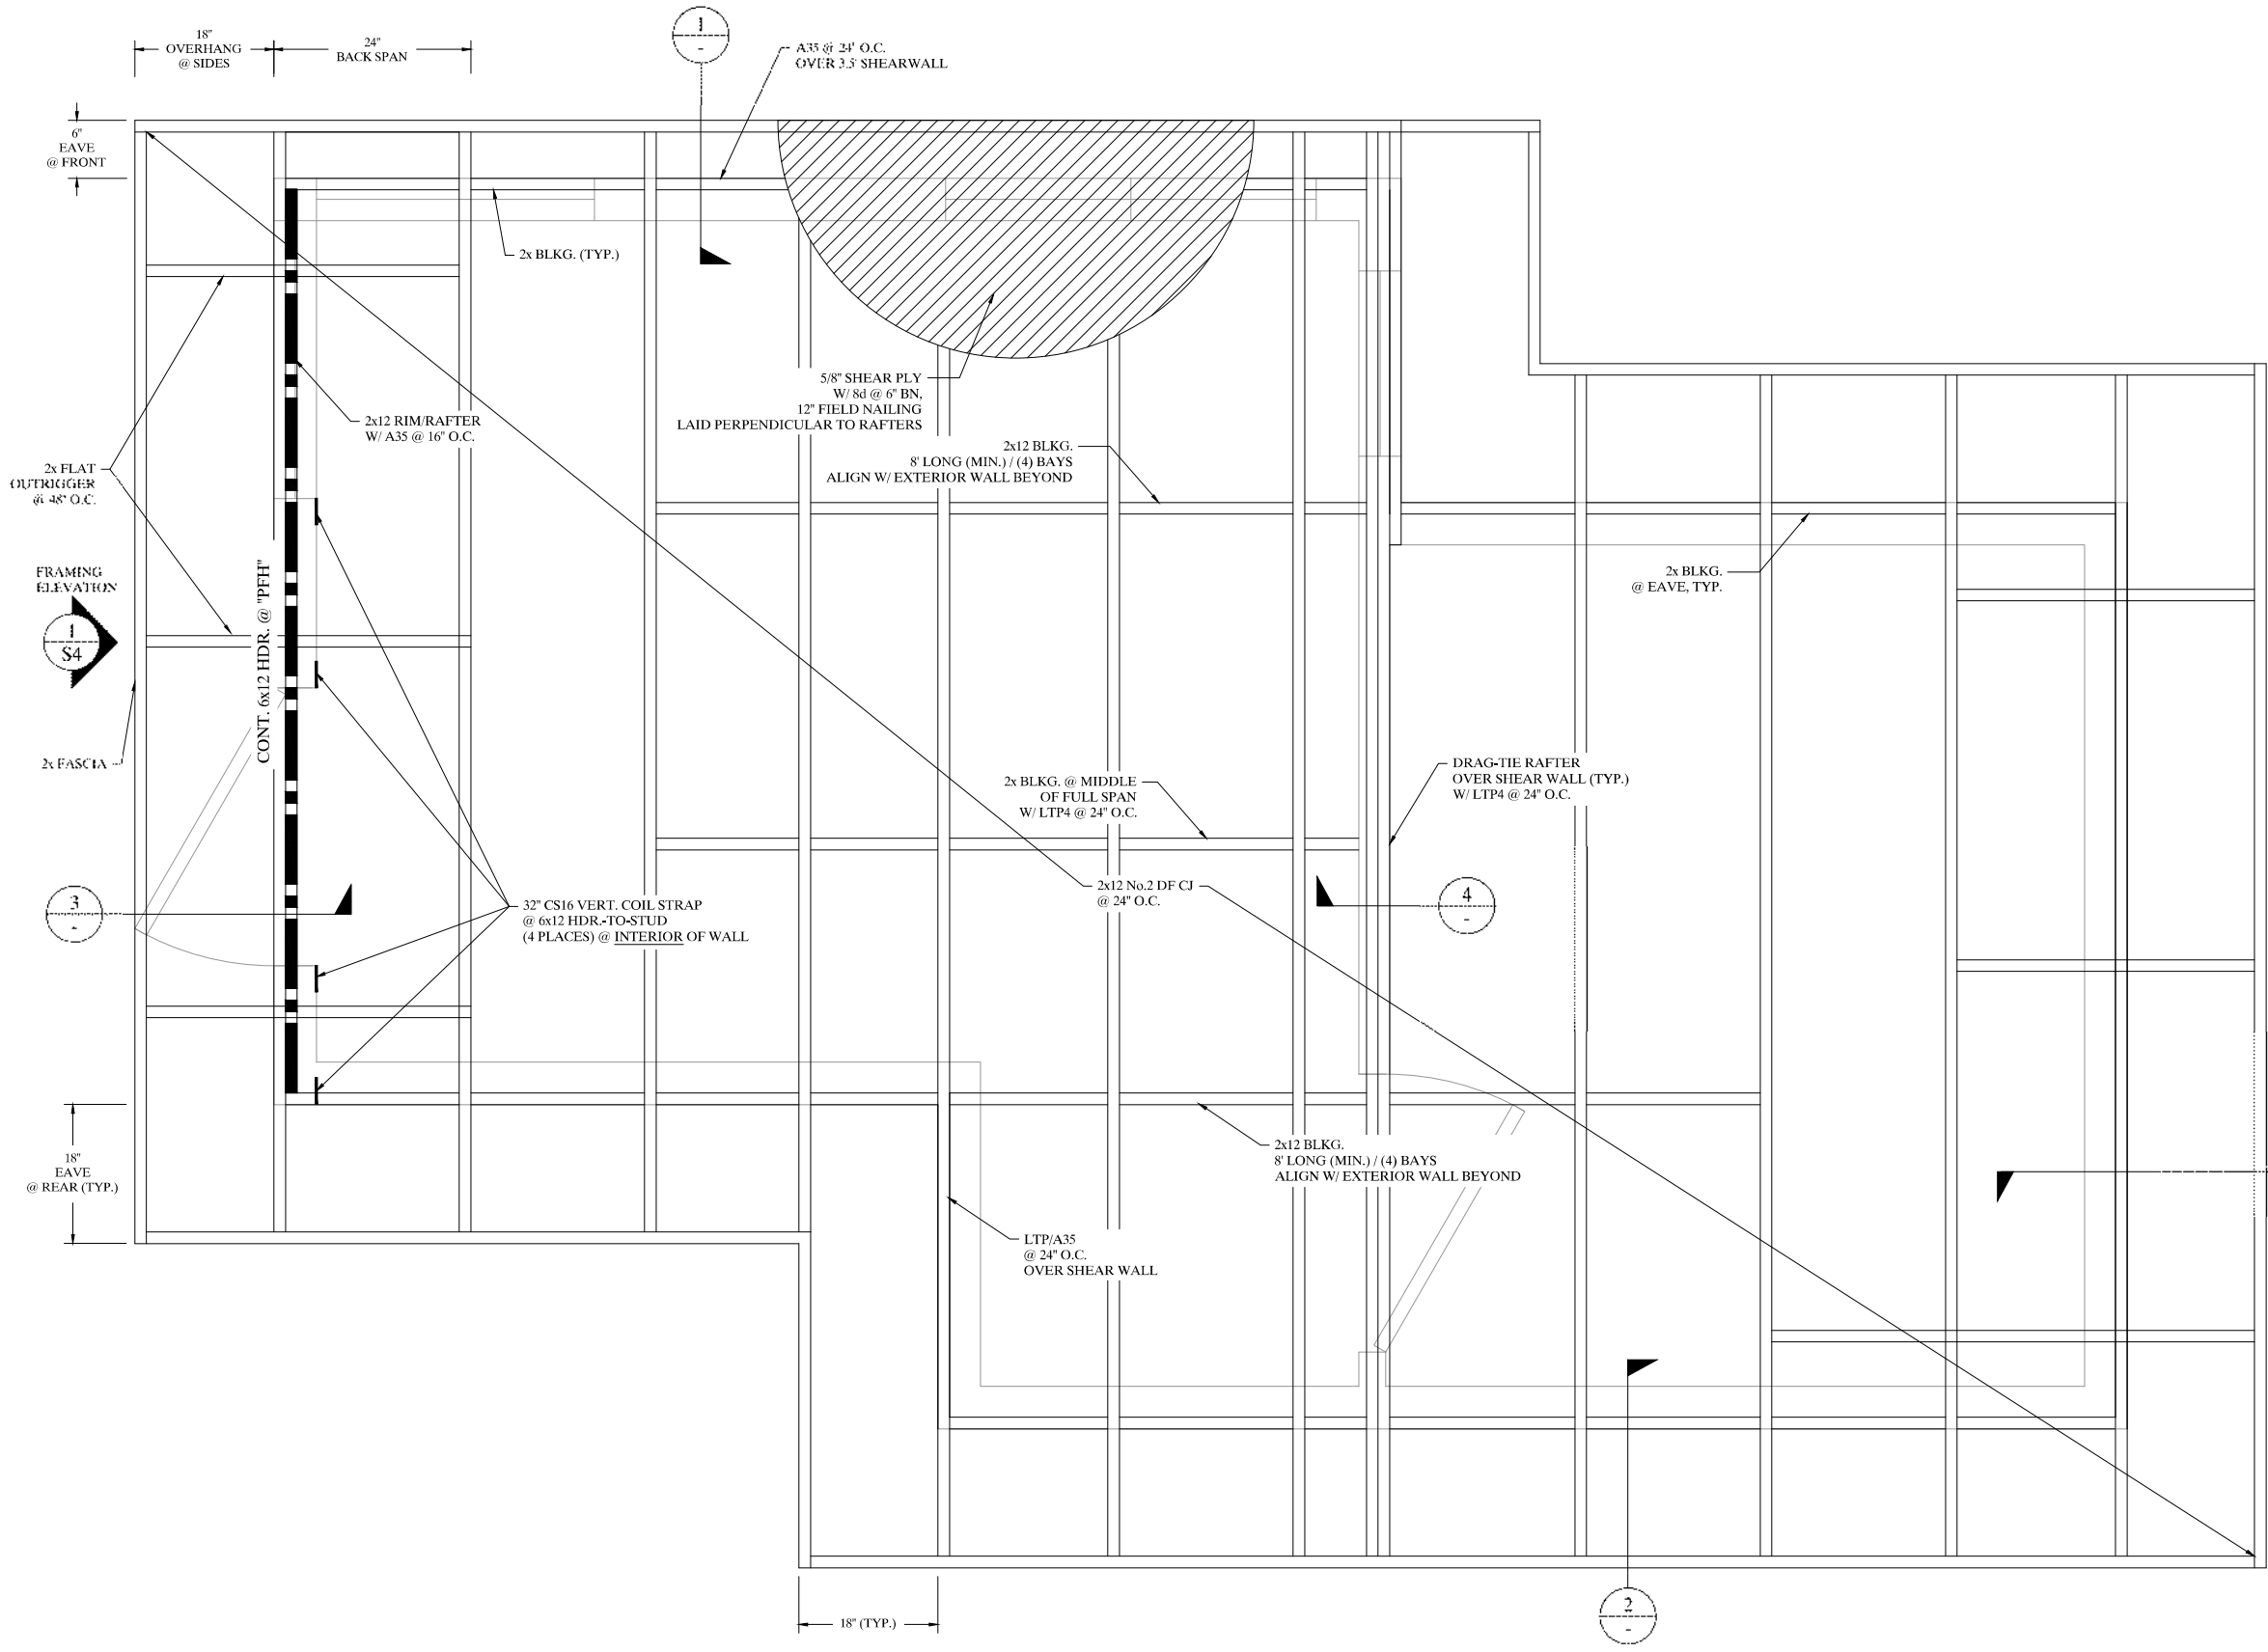


UPPER EAVE SHEAR CONNECTION 3/4" = 1'-0" 1

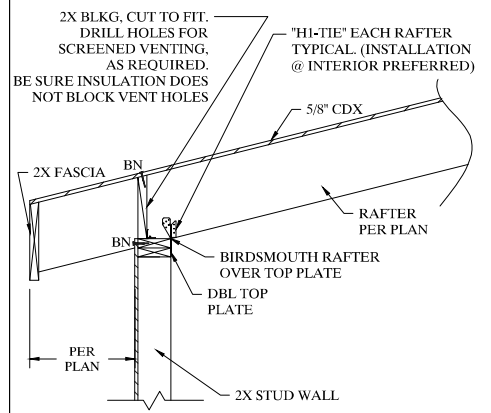

LOWER EAVE SHEAR CONNECTIONS 3/4" = 1'-0" 2

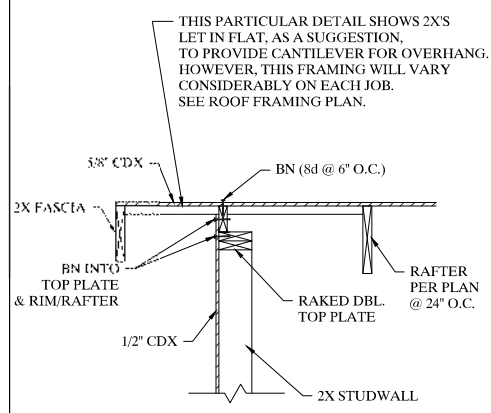

RAKED SHEAR WALL CONNECTIONS 3/4" = 1'-0" 3

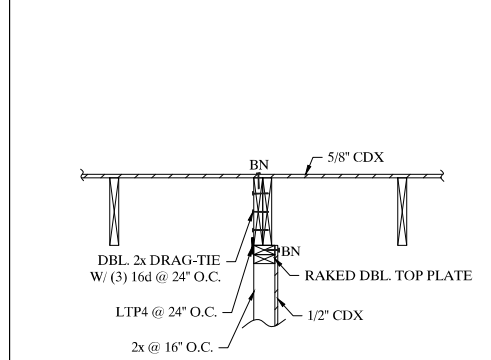

INTERIOR SHEAR DRAG-TIE 1/4" = 1'-0" 4

ROOF FRAMING PLAN AND DETAILS
REDWAY TRANSFER STATION
CONSERVATION CAMP RD. REDWAY, CA 95560
APN: 222-161-002

Date:

Revision No.:

Date: 9/20/2024

Project #: 24041

Drawn by: KIM

Scale: 1"=1'-0"

Sheet No.

S3


ROOF FRAMING NOTES:

1. PROVIDE "HI-TIE" (OR EQUIVALENT) AT EACH RAFTER-TO-PLATE CONNECTION, UNLESS OTHERWISE NOTED.
2. ROOF SHEATHING SHALL BE 5/8" CDX NAILED W/ 8d COMMONS @ 6" O.C. AT PANEL EDGES AND 12" O.C. IN THE FIELD (PANEL EDGES UNBLOCKED).
3. TOP PLATE SPLICES SHALL BE MIN. 48" OVERLAP AND SHALL BE NAILED W/ NO LESS THAN (8) 16d FACE NAILS ON EACH SIDE OF THE SPLICE. SEE DETAIL 8/S0.
4. ALL EXT. HEADERS MIN. 6x8 DF #1 W/ 2x6 KING & TRIMMER STUD EA. END, UNLESS OTHERWISE NOTED.
5. 2x6 SOLID FIRE BLOCKING REQUIRED AT 10' MAX HEIGHT IN ALL TALL EXTERIOR WALLS.



STRUCTURAL DETAILS

REDWAY TRANSFER STATION
CONSERVATION CAMP RD. REDWAY, CA 95560
APN: 222-161-002

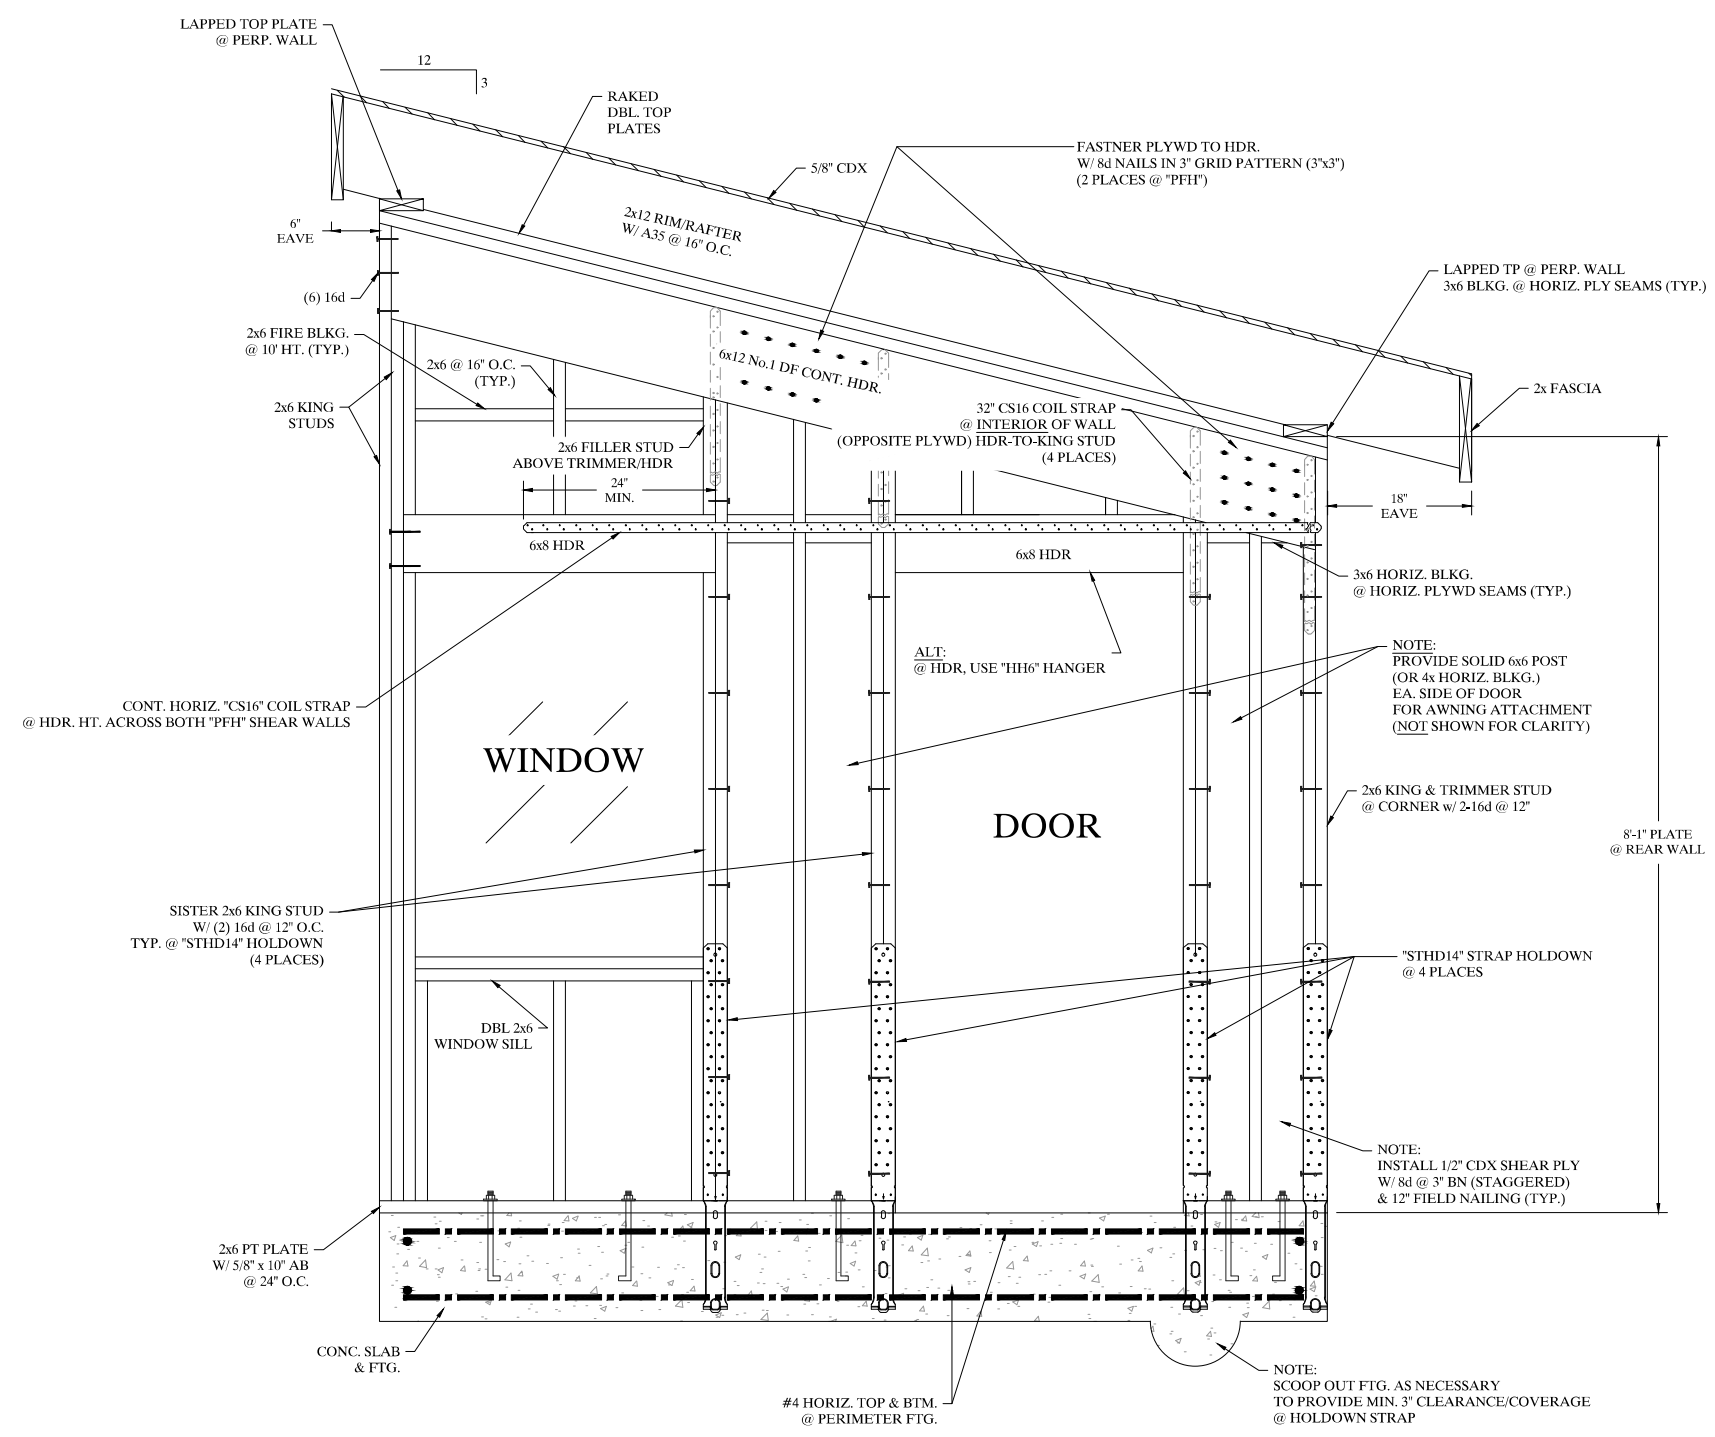

FRAMING ELEVATION @ LINE ①/ "PFH" ("PORTAL FRAME WITH HOLDOWNS")

1"=1'-0" 1

SCALE NOTE: THE DISPLAYED SCALE IS HALVED WHEN PRINTED ON 11"x17" SHEETS

Date:	
Revision No.:	
Date:	9/20/2024
Project #:	24041
Drawn by:	KIM
Scale:	1"=1'-0"
Sheet No.	S4


DESIGN CODE: 2022 California Building Code, 2022 California Mechanical Code, 2022 California Electrical Code, 2022 California Plumbing Code, 2022 California Energy Code, 2022 California Green Building Standards Code, 2022 California Fire Code.

Occupancy: F-2 Low Hazard Factory Industrial
 Occupant Load = 4100 SQFT /100 SQFT Occupancy Factor = 41
 Construction Type: Type I
 # of Stories = 1
 Size = 4100 SQFT
 # of Exits = 2
 Fire Resistance Rating: Type II-B
 Fire Sprinklers: No
 Provide 2- Portable Fire Extinguishers




ROAD NAME: CONSERVATION CAMP RD		HUMCO		COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS	SHEET 42 OF 58
ROAD NO:	MILE POST:	DESIGNED BY: ENGR			
PROJECT NO: 438005		DRAWN BY: PBS		REDWAY TRANSFER STATION	
DRAWING FILE NAME: RTS-Recycling Building.dwg		REVIEWED BY: JAB		TRANSFER BUILDING REPAIRS	
PLOT DATE: 08/19/2025	REVISION DATE:	APPROVED BY: TRS			


NOTE: SEE SHT. 43 FOR INTERIOR WALL AND UTILITY DEMO.

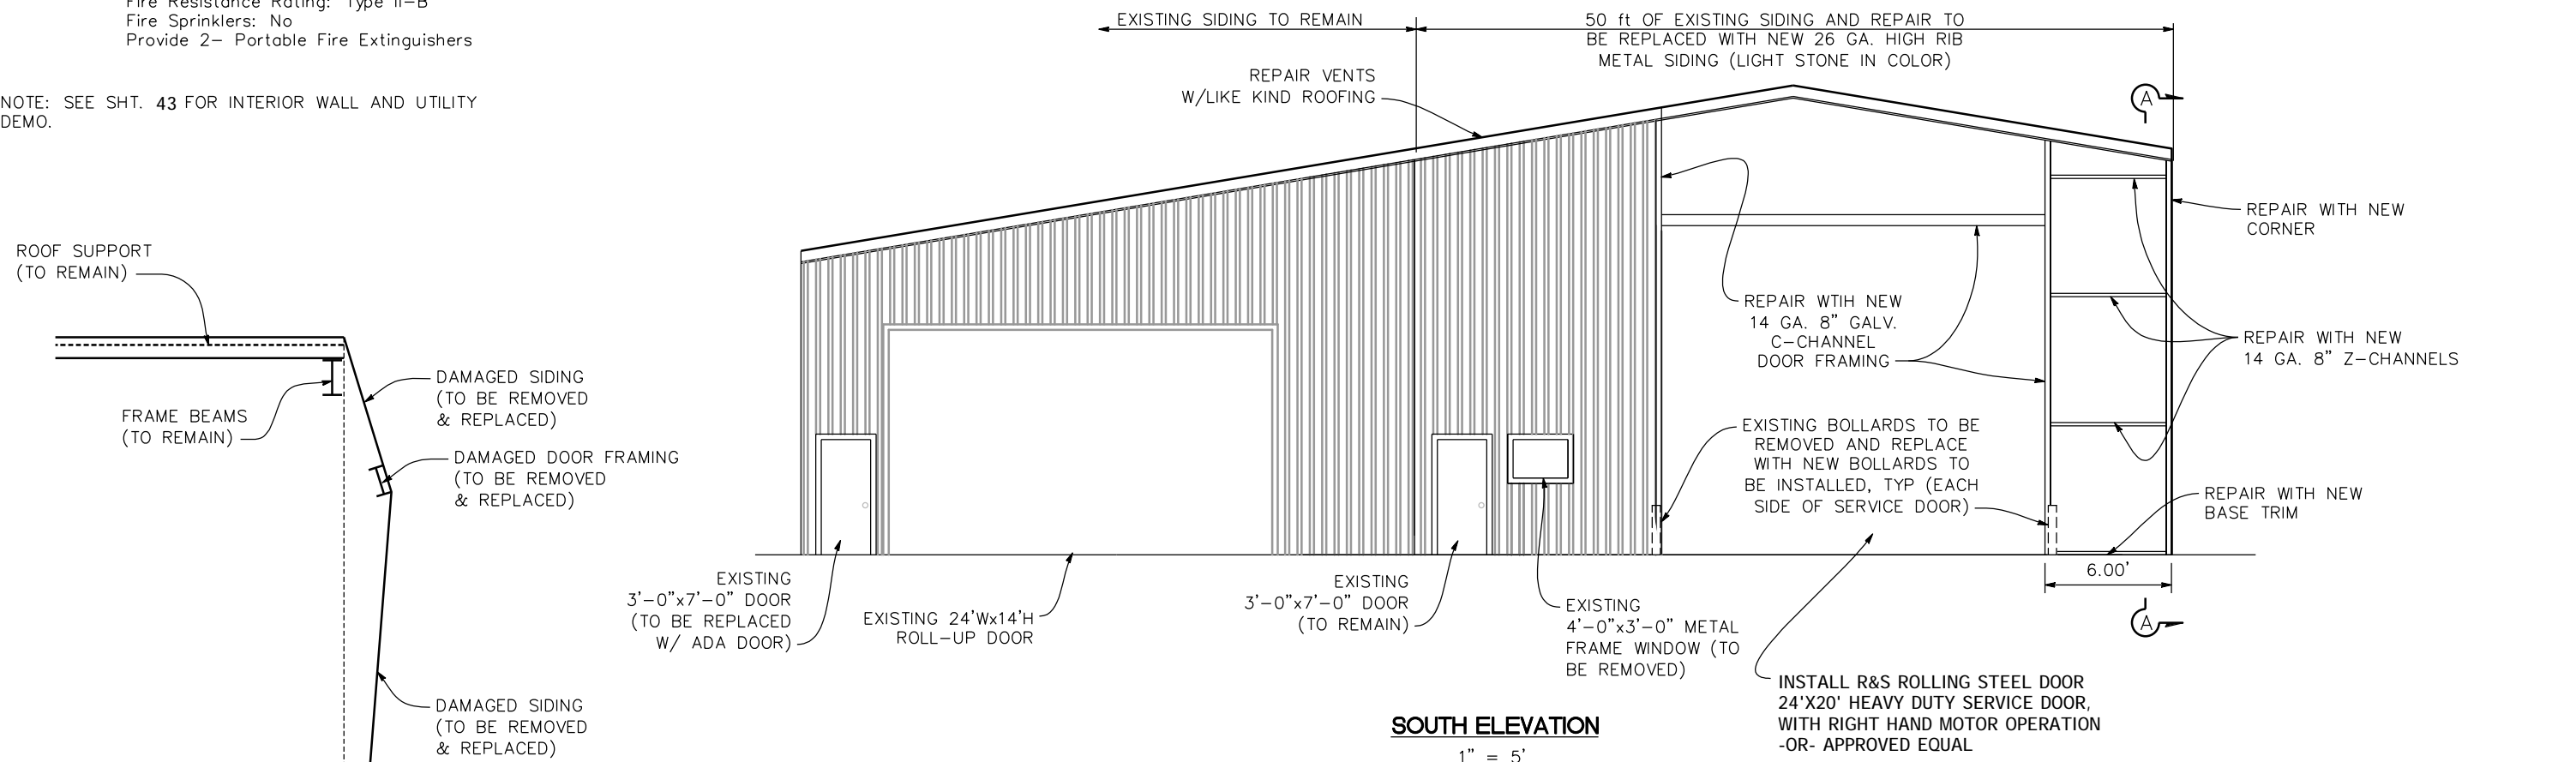


SOUTH ELEVATION
1" = 5'

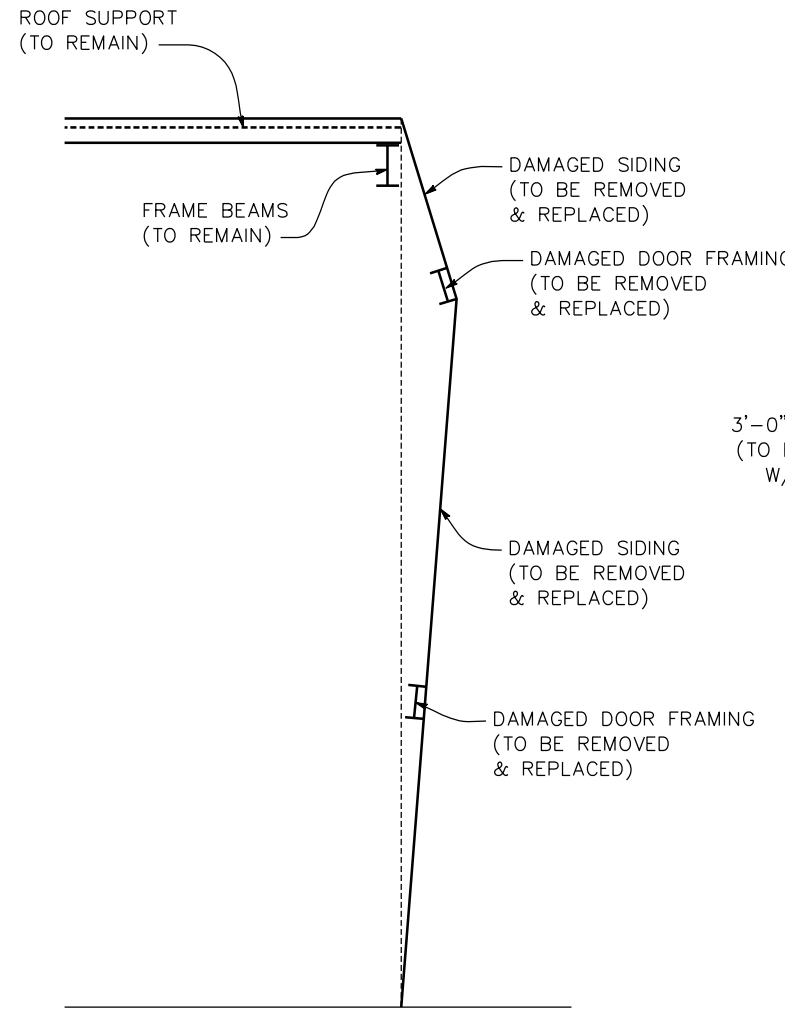

SECTION A-A
3/8" = 1'-0"

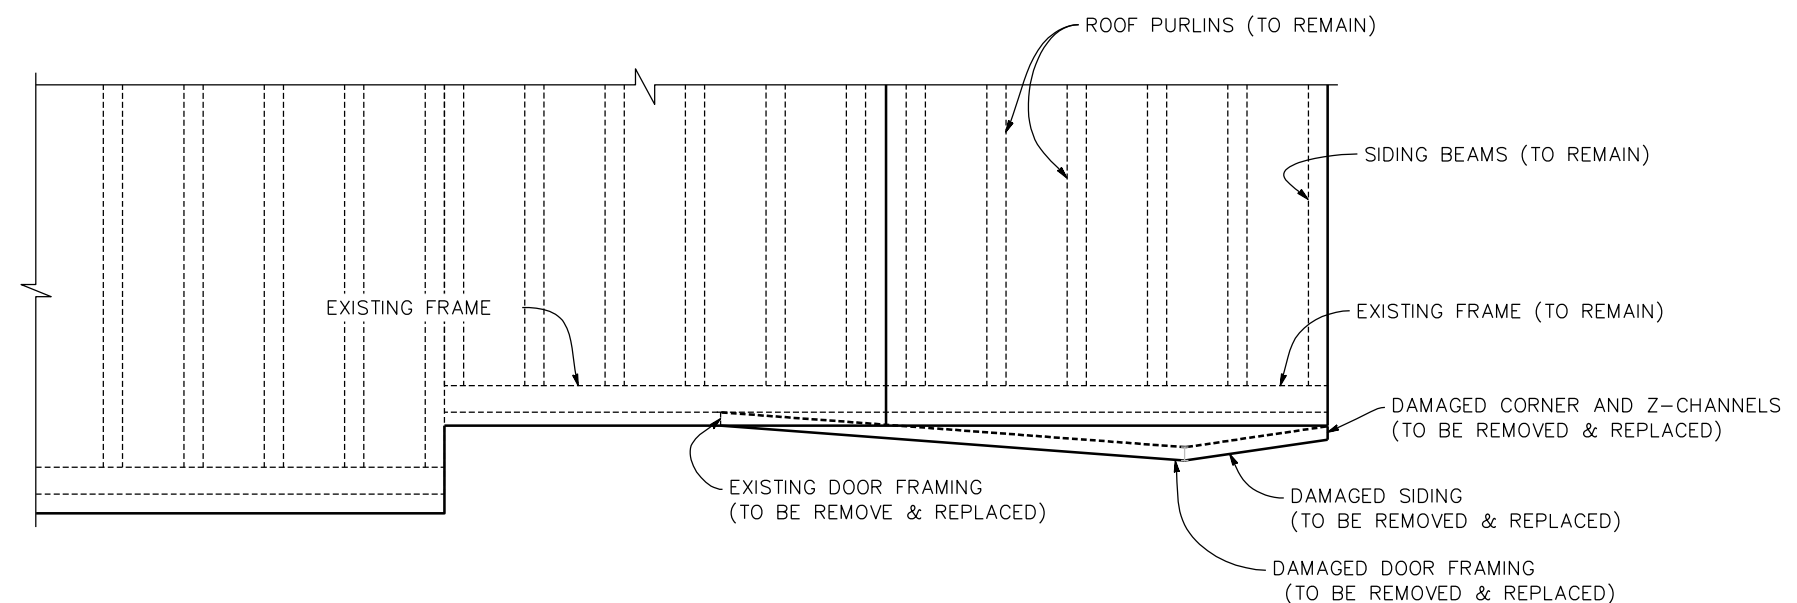

PLAN
1" = 5'




ROAD NAME: CONSERVATION CAMP RD		HUMCO		SHEET 43 OF 58
ROAD NO:	MILE POST:	COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS		
PROJECT NO: 438005		DESIGNED BY: ENGR		
		DRAWN BY: PBS		
DRAWING FILE NAME: RTS-Recycling Building.dwg		REVIEWED BY: JAB		
PLOT DATE: 08/19/2025	REVISION DATE:	APPROVED BY: TRS		
TRANSFER BUILDING INTERIOR DEMO PLAN				



SCALE 1" = 5'

DEMO NOTES:

1. FIELD VERIFY ALL ELECTRICAL IN OFFICE AND BATHROOM IS DE-ENERGIZED PRIOR TO DEMO. ALSO, SEE SHEET 47 ELECTRICAL PLAN NOTES.
2. REMOVE ALL FIXTURES, CUT AND CAP ALL UTILITIES FLUSH WITH TOP OF CONCRETE WITHIN THE OFFICE AND BATHROOM DEMO SHOWN AS HATCHED XXXXXXX.
3. THE CEILING ABOVE THE BATHROOM AND OFFICE IS INCLUDED IN THE DEMO, BUT NOT SHOWN FOR CLARITY.

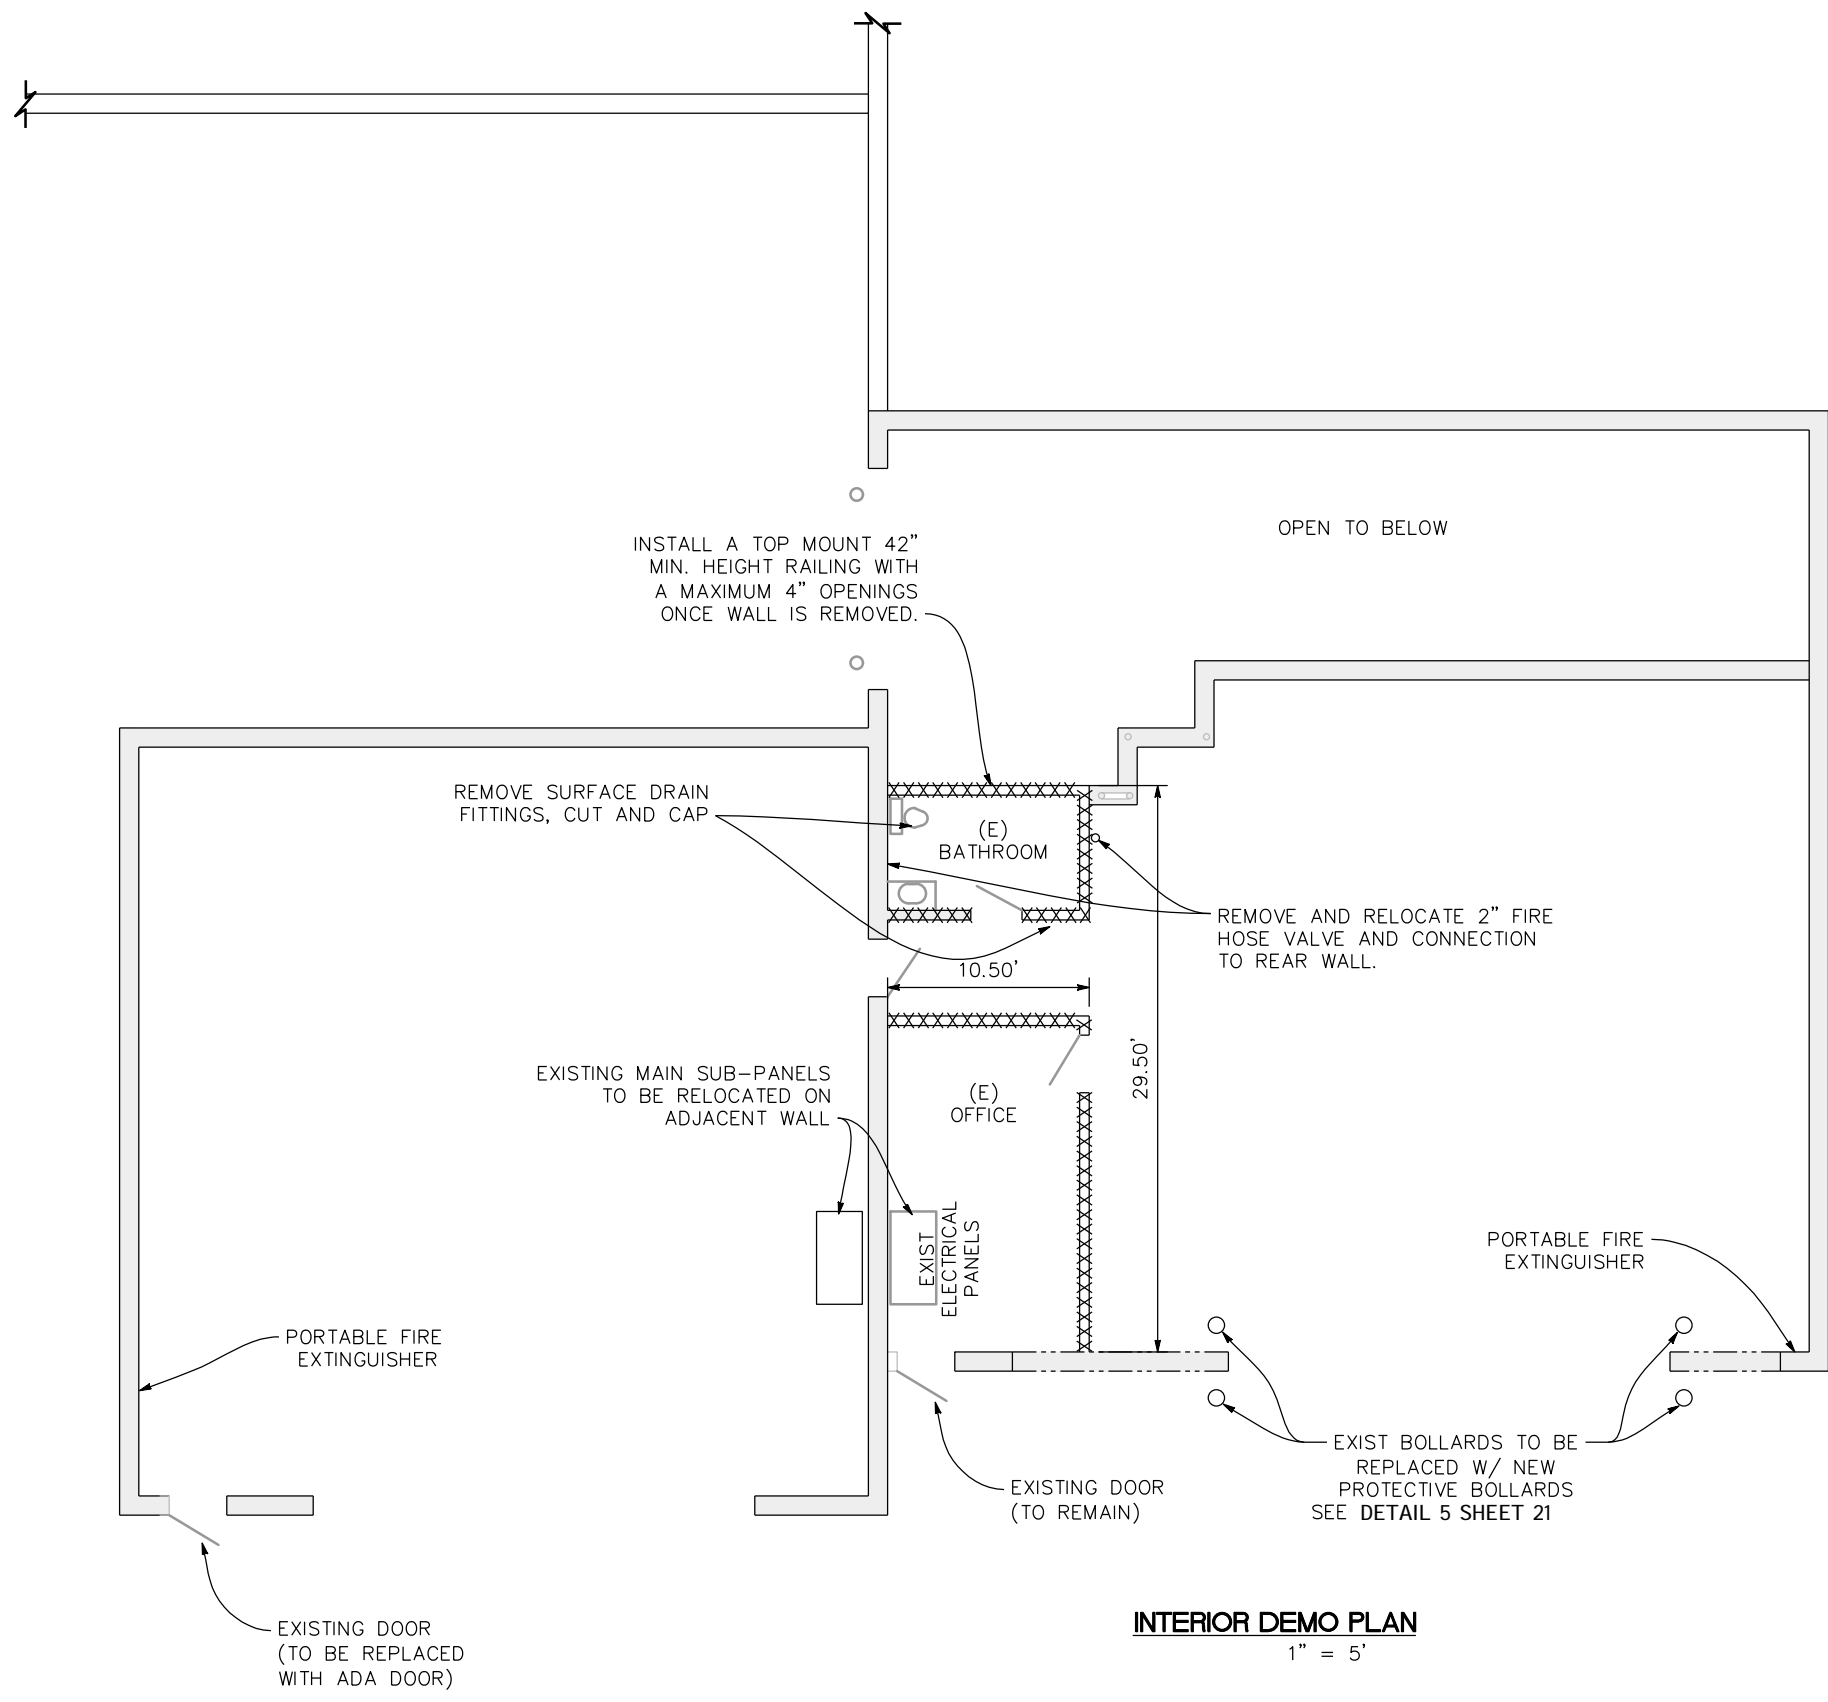

INTERIOR DEMO PLAN
1" = 5'

DESIGN CODE: 2022 California Building Code, 2022 California Mechanical Code, 2022 California Electrical Code, 2022 California Plumbing Code, 2022 California Energy Code, 2022 California Green Standards Code, 2022 California Fire Code.

Occupancy: F-2 Low Hazard Factory Industrial
 Occupant Load = 2400 SQFT /100 SQFT Occupancy Factor = 24
 Construction Type: Type I
 # of Stories = 1
 Size = 2400 SQFT
 # of Exits = 2
 Fire Resistance Rating: Type II-B
 Fire Sprinklers: No


Occupancy Group = S-2
 Live Loading: Roof = 20psf

Seismic Parameters:
 S_s = 1.669
 S₁ = 0.862
 Site Class = D
 PGA = 0.786
 Risk Category = I

Wind Parameters:
 Velocity = 87 mph
 Exposure B
 Surface Roughness B

ADDENDUM #2





REVISED ROOF PITCH AND ELIMINATED DIMENSION




ROAD NAME: CONSERVATION CAMP RD		HUMCO		COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS	SHEET 44 OF 58
ROAD NO:	MILE POST:	DESIGNED BY: ENGR			
PROJECT NO: 438005		DRAWN BY: PBS		REDWAY TRANSFER STATION	
DRAWING FILE NAME: RTS-Recycling Building.dwg		REVIEWED BY: JAB		PROPOSED RECYCLING BUILDING PLANS	
PLOT DATE: 08/19/2025	REVISION DATE:	APPROVED BY: TRS			

NOTES:

- CONCEPTUAL BUILDING DESIGN SHOWN ACTUAL BUILDING MAY VARY SLIGHTLY DEPENDING UPON MANUFACTURER.
- COORDINATE FOUNDATION PLACEMENT WITH BUILDING BASE PLATES AND ANCHOR BOLTS.
- GUTTERS AND DOWNSPOUT SIZING PER BUILDING Mfg. REQUIREMENTS. DOWNSPOUT LOCATIONS SHALL BE; 1 Ea. AT THE NORTHEAST CORNER ON THE EAST SIDE OF Bldg. 1 Ea. ON THE SOUTHWEST CORNER OF THE WEST SIDE OF THE Bldg.
- SEE ELECTRICAL PLAN FOR LAYOUT AND NOTES

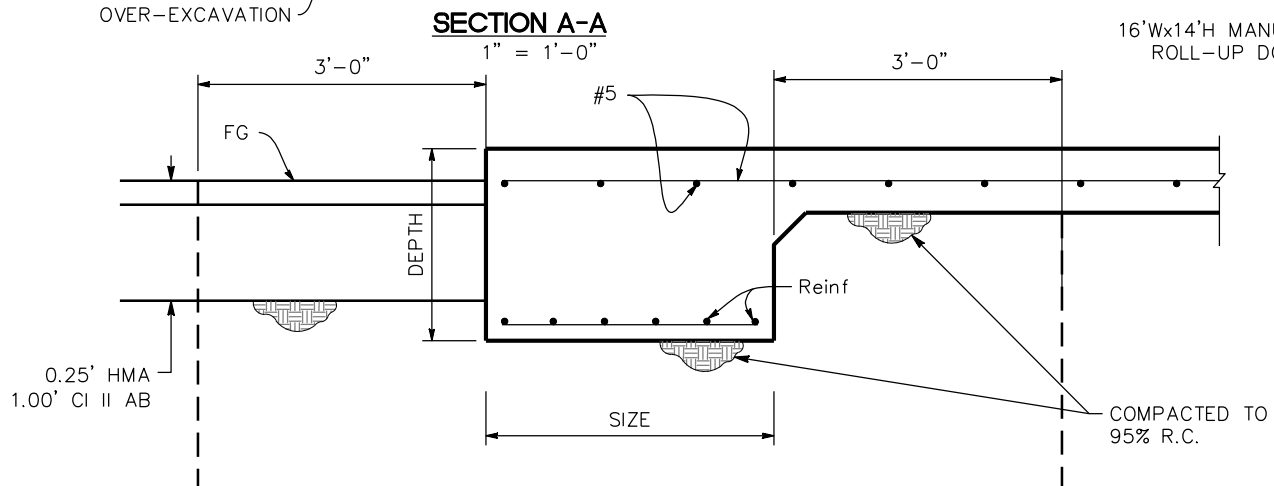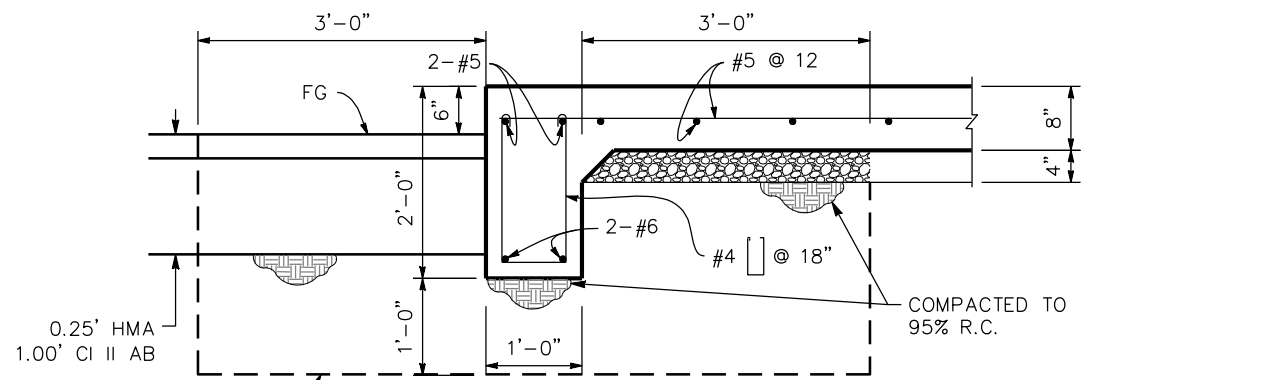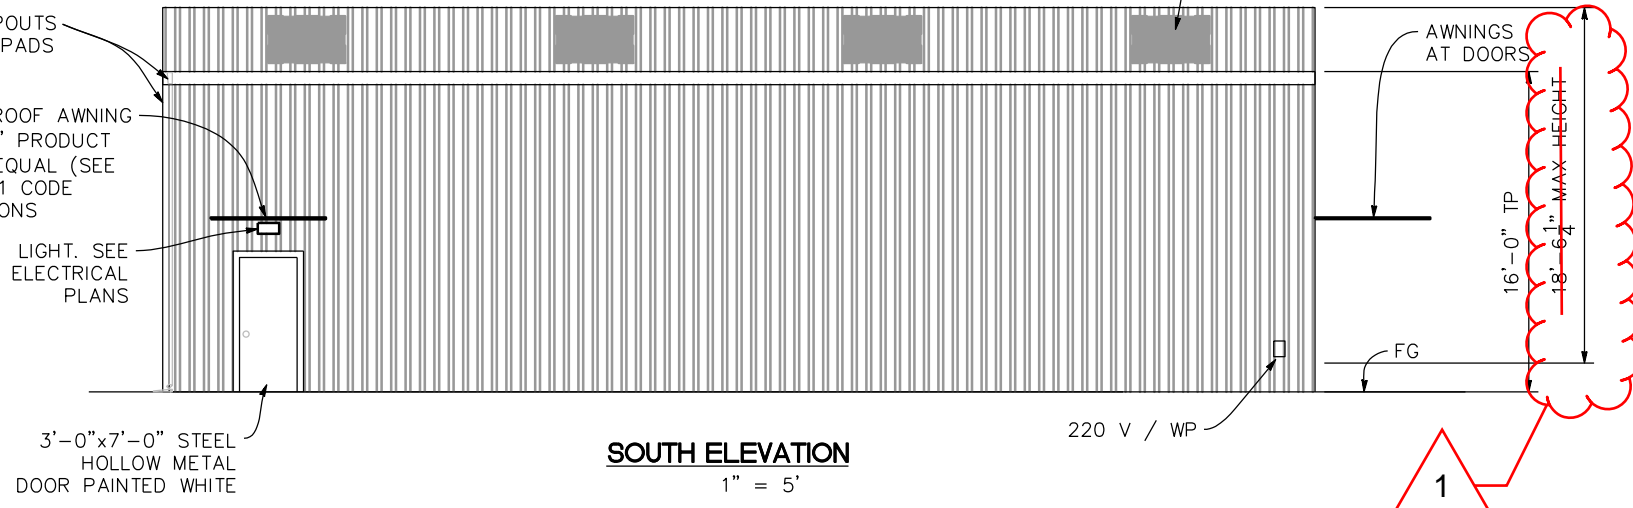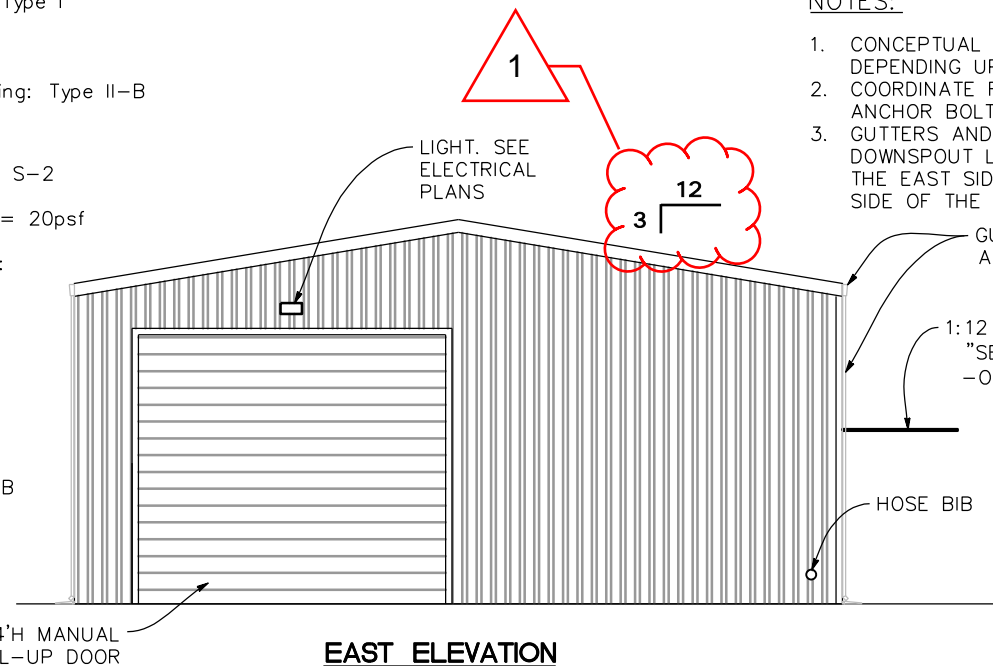

DESCRIPTION	SIZE	DEPTH	Reinf
F2.0	2'-0" x 2'-0"	24"	4-#5 EACH WAY
F3.0	3'-0" x 3'-0"	24"	6-#5 EACH WAY

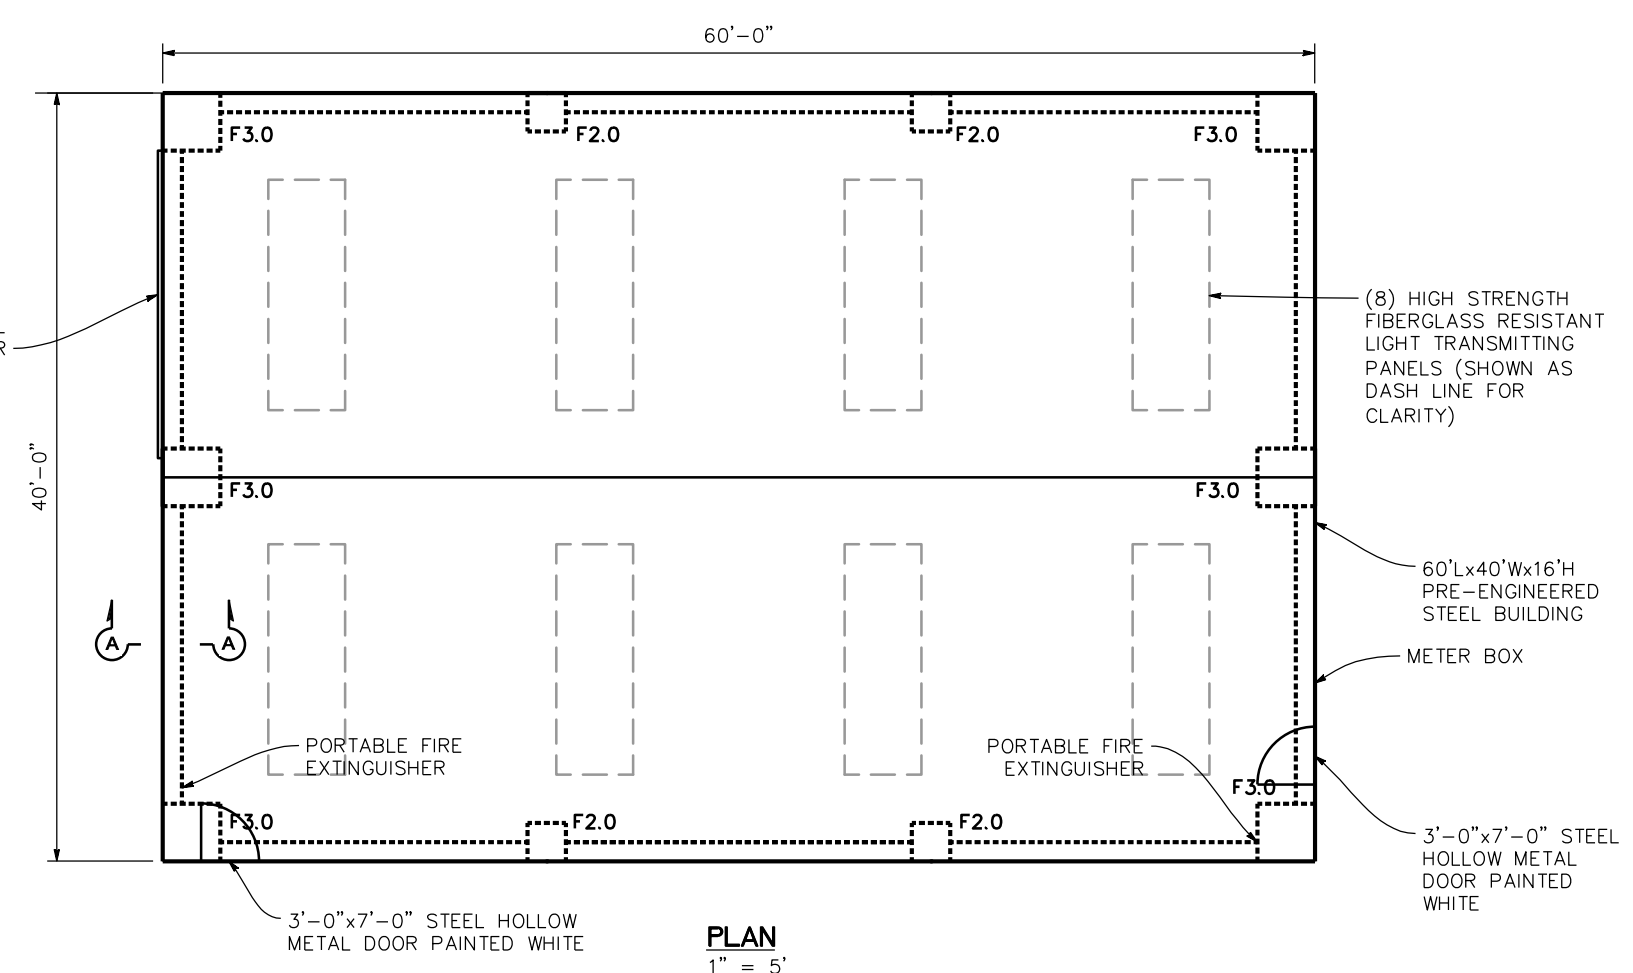

PLAN
1" = 5'

NOTES:



- FOR ACCURATE RIGHT OF WAY DATA AND MAPS, CONTACT DPW LAND USE DIVISION AT THE COUNTY PUBLIC WORKS OFFICE.
- SOIL COMPACTION MUST MEET PG&E'S, AND ANY APPLICABLE FEDERAL, STATE, COUNTY, AND LOCAL REGULATIONS.
- A JOINT SERVICE TRENCH MUST MEET ALL SEPARATION AND CLEARANCE DIMENSIONS SHOWN ON SHEET 15 TRENCH DETAIL.

LEGEND:

- SD—SD PROPOSED STORM DRAIN
- FM—SS—FM—SS—FM PROPOSED SANITARY SEWER / FORCE MAIN
- UGE—UGE PROPOSED UNDER-GROUND ELECTRICAL
- W—W PROPOSED WATER
- E—OH E—OH E—OH EXIST OVERHEAD ELECTRICAL
- E—OH_{C/T} E—OH_{C/T} E—OH EXIST OVERHEAD CABLE/TELEPHONE
- E—SS E—SS E—SS EXIST SANITARY SEWER
- BFP BACK FLOW PREVENTOR (ABOVE GROUND)
- HB HOSE BIB



BAR IS ONE INCH ON ORIGINAL DRAWING IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY	ROAD NAME: CONSERVATION CAMP RD	HUMCO	COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS	SHEET 45 OF 58
	ROAD NO:	MILE POST:	DESIGNED BY: ENGR	
	PROJECT NO: 438005		DRAWN BY: PBS	
	DRAWING FILE NAME: RTS_UTILITY PLAN		REVIEWED BY: JAB	
	PLOT DATE: 08/19/25		APPROVED BY: TRS	

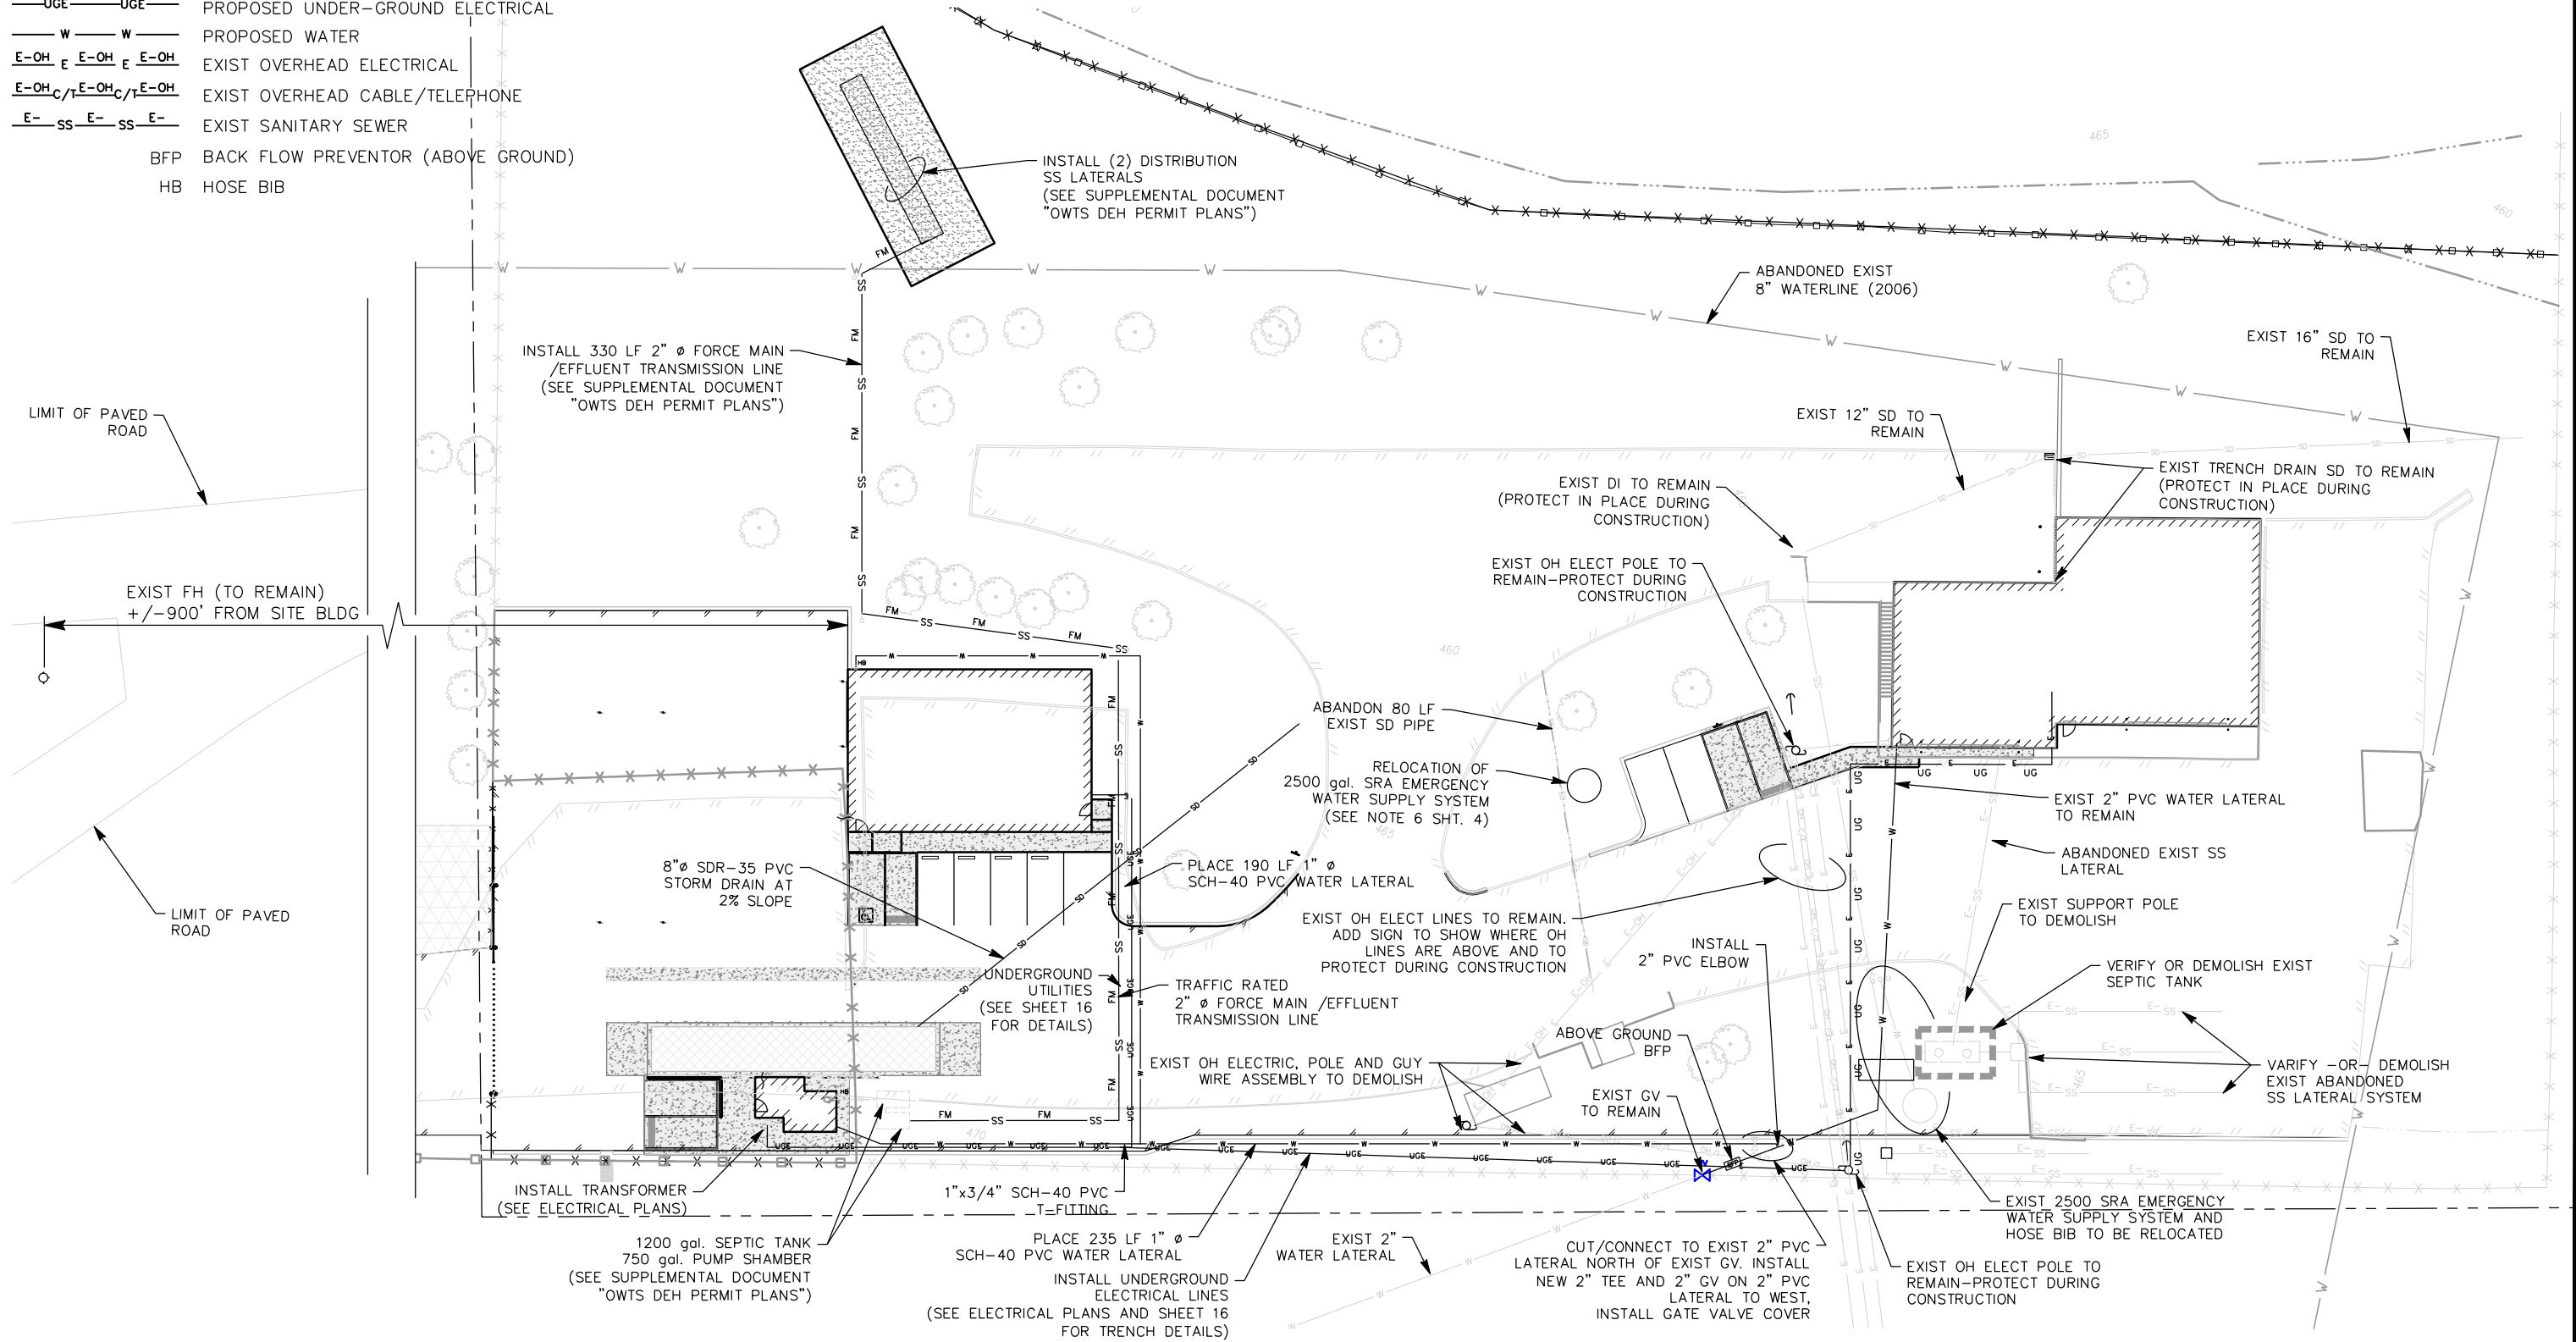



BAR IS ONE INCH ON ORIGINAL DRAWING IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY	ROAD NAME: CONSERVATION CAMP RD	HUMCO	COUNTY OF HUMBOLDT DEPARTMENT OF PUBLIC WORKS REDWAY TRANSFER STATION WATER POLLUTION AND EROSION CONTROL PLAN	SHEET 46 OF 58
	ROAD NO: PROJECT NO: 438005	MILE POST: DESIGNED BY: ENGR DRAWN BY: PBS REVIEWED BY: JAB APPROVED BY: TRS		
DRAWING FILE NAME: RTS_TEMP WATER POLL CON PLAN				
PLOT DATE: 08/19/25				

LEGEND:


— TFR —	TEMP FIBER ROLL
- - - TSF - - -	TEMP SILT FENCE
■	NEW HMA/PAVED SECTION LIMITS
WASH	TEMP CONCRETE WASHOUT
▨	TEMP CONSTRUCTION ENTRANCE (CONTRACTOR TO VERIFY ACTUAL LOCATION)



SCALE 1" = 20'

CONSERVATION CAMP ROAD

THE ACTUAL LOCATION OF TEMP CONSTRUCTION ENTRANCE AND CONCRETE WASHOUT AREA SHALL BE APPROVED BY COUNTY AND/OR RESIDENT ENGINEER PRIOR TO CONTRACTOR INSTALLATION

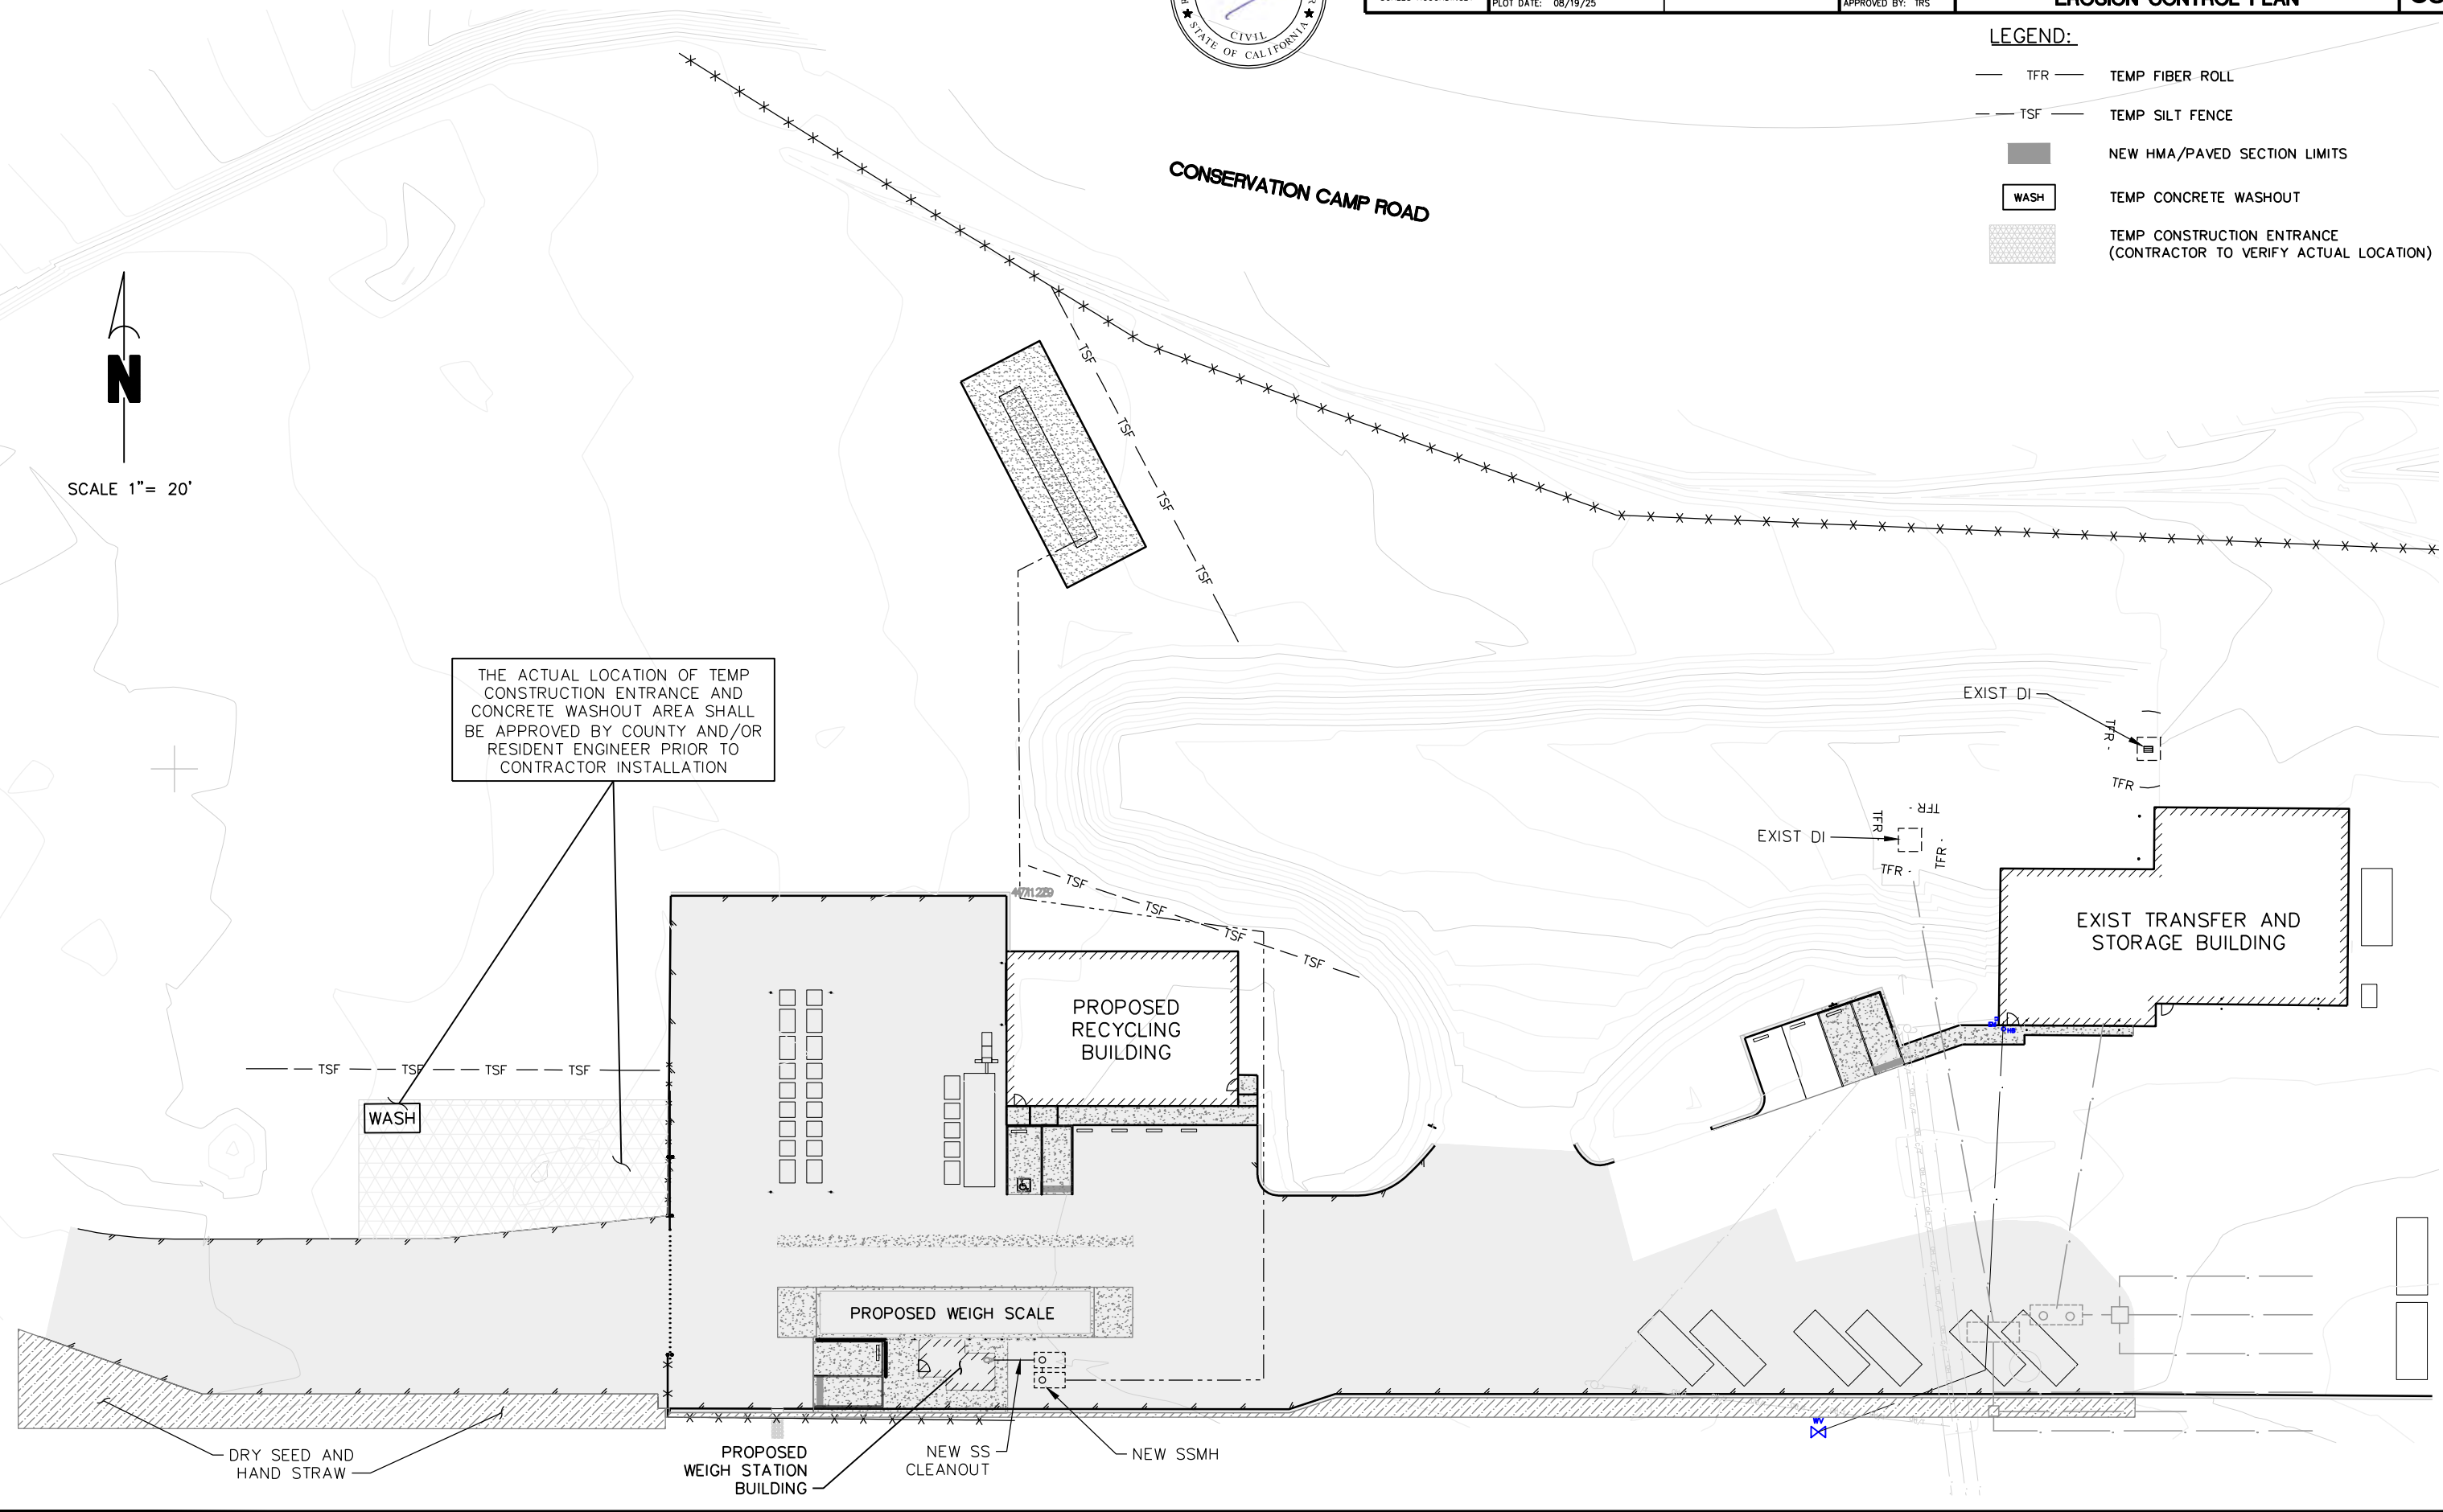

JUN 17 2025 - 10:36am
 UNAUTHORIZED CHANGES & USES:
 M. Neils Engineering, Inc. preparing these plans will not be responsible for, or liable for unauthorized changes to or uses to these plans. All changes to these plans must be in writing and must be approved by M. Neils Engineering, Inc.



June 17, 2025

M. NEILS ENGINEERING, INC.
 Electrical Engineers | Lighting Designers
 100 Howe Ave., Suite 235N
 Sacramento, CA 95825-8217
 www.mneilseng.com
 Tel: (916) 923-4400 Fax: (916) 923-4410
 PROJECT #: 19086.21

ROAD NAME: CONSERVATION CAMP RD		M. NEILS ENGINEERING	
ROAD NO:	MILE POST:	DESIGNED BY: SKL	
PROJECT NO.: 438005	EA NO.:	DRAWN BY: PI	
CONTRACT NO.:	BRIDGE NO.:	REVIEWED BY: SKL/ALB	
DRAWING FILE NAME:	REVISION DATE:	APPROVED BY: ALB	
PLOT DATE: 6/17/25			

COUNTY OF HUMBOLDT
DEPARTMENT OF PUBLIC WORKS
REDWAY TRANSFER STATION
ELECTRICAL SHEET INDEX, SYMBOL
LIST AND ABBREVIATIONS

SHEET
47
 OF
58
E01

DEMOLITION GENERAL NOTES	
1.	INFORMATION SHOWN RELATIVE TO EXISTING CONDITIONS IS BASED UPON AVAILABLE RECORDS AND DATA. THEREFORE, IT SHALL BE REGARDED AS AN APPROXIMATION ONLY. CONTRACTOR AGREES THAT IN ACCORDANCE WITH GENERALLY ACCEPTED CONSTRUCTION PRACTICES, CONTRACTOR WILL BE REQUIRED TO ASSUME SOLE AND COMPLETE RESPONSIBILITY FOR JOB SITE CONDITIONS DURING THE COURSE OF CONSTRUCTION OF THE PROJECT. PRIOR TO SUBMITTING BID AND/OR BEFORE START OF ANY ELECTRICAL WORK, INSPECT ALL EXISTING LOCATIONS AND CONDITIONS AND ASCERTAIN WORK REQUIRED TO CLEAR PROJECT AREA OF ALL EXISTING ELECTRICAL ITEMS NOT BEING REUSED OR EXISTING TO REMAIN AS IS. REPORT ALL DISCREPANCIES AND COORDINATE ALL DEMOLITION WORK WITH THE OWNER'S REPRESENTATIVE. MAINTAIN SERVICE TO EXISTING ELECTRICAL EQUIPMENT IN AREAS ADJACENT TO REMODEL AREA, UNLESS OTHERWISE NOTED.
2.	PROTECT ALL EXISTING ELECTRICAL EQUIPMENT ON EXISTING WALLS AND CEILINGS NOT REQUIRED TO BE DEMOLISHED UNLESS OTHERWISE NOTED. DELIVER ALL EXISTING ELECTRICAL EQUIPMENT IN REMODELED AREAS, THAT ARE REMOVED AND NOT REUSED ELSEWHERE, AND ARE DEEMED TO BE SALVAGEABLE IN THE JUDGMENT OF THE CONTRACTOR AND OWNER'S REPRESENTATIVE, TO THE OWNER. DELIVER ALL SALVAGED ELECTRICAL EQUIPMENT AND OTHER ITEMS TO A LOCATION DESIGNATED BY THE OWNER'S REPRESENTATIVE. REMOVE FROM SITE, ALL OTHER ELECTRICAL EQUIPMENT, HARDWARE, AND OTHER ITEMS THAT ARE DEEMED UNSALVAGEABLE BY CONTRACTOR AND THE OWNER'S REPRESENTATIVE.
3.	CUT, PATCH AND MATCH IN ALL AREAS AFFECTED BY REMOVAL OF ELECTRICAL EQUIPMENT AND DEVICES.
4.	CAUSE AS LITTLE INTERFERENCE OR INTERRUPTION OF EXISTING UTILITIES AND SERVICES AS POSSIBLE. SCHEDULE ANY POWER OR OTHER UTILITY SHUTDOWN WITH THE OWNER'S REPRESENTATIVE. SHUTDOWNS WHICH MAY BE REQUIRED SHALL BE PRESENTED IN WRITING TO THE OWNER'S REPRESENTATIVE FOR APPROVAL TWO WEEKS PRIOR TO COMMENCEMENT OF WORK. SHUTDOWN WORK SHALL BE PERFORMED ON OVERTIME HOURS IF SO DIRECTED BY OWNER'S REPRESENTATIVE.
5.	DISCONNECT AND REMOVE ALL EXISTING ELECTRICAL EQUIPMENT, FIXTURES, OUTLETS, DEVICES, CONDUIT, WIRING AND OTHER ELECTRICAL ITEMS, WHETHER SHOWN OR NOT, FROM EXISTING CEILINGS AND WALLS WHICH ARE TO BE DEMOLISHED. MAINTAIN CIRCUIT CONTINUITY TO ALL EXISTING REMAINING DEVICES, UNLESS OTHERWISE NOTED.
6.	COORDINATE WITH OTHER TRADES AND PROMPTLY TRANSMIT ALL INFORMATION REQUIRED BY THEM. COORDINATE THE SEQUENCE OF DEMOLITION WITH OTHER TRADES TO ENSURE THAT ALL WORK PROCEEDS WITH A MINIMUM OF INTERFERENCE AND DELAY.
7.	RELOCATE ALL CONDUITS THAT ARE TO REMAIN IN SERVICE WHICH ARE IN A LOCATION TO CONFLICT WITH NEW WORK.
8.	WHEREVER EXISTING ELECTRICAL DEVICES, PANELS, CONDUITS, CABLES, AND OTHER ITEMS, CONFLICT WITH REMODEL WORK, WHETHER SHOWN OR NOT, RELOCATE THESE ITEMS TO COORDINATE WITH NEW CONSTRUCTION.
9.	REUSE EXISTING CONDUITS AND WIRING WHEREVER POSSIBLE UNLESS OTHERWISE NOTED TO BE REMOVED.
10.	PROVIDE PROTECTIVE COVERING OVER EXISTING EQUIPMENT WHEN INSTALLING ALL NEW WORK.
11.	PROVIDE NEW TYPED PANEL DIRECTORIES FOR EXISTING PANELS INVOLVED IN THIS RENOVATION WORK, REFLECTING ALL CHANGES TO CIRCUIT DESIGNATIONS.
12.	ASBESTOS REMOVAL: IN THE EVENT ASBESTOS IS FOUND TO BE PRESENT IN AREAS CONFLICTING WITH ELECTRICAL WORK, BEFORE CONTINUATION OF WORK IN THOSE AREAS, NOTIFY THE OWNER'S REPRESENTATIVE FOR THE REMOVAL OF SUCH HAZARDOUS MATERIAL BY A CERTIFIED ASBESTOS CONTRACTOR.
13.	CIRCUIT NUMBERS AND CIRCUITING BASED UPON AS-BUILTS. ACTUAL CONDITION MAY VARY. TRACE AND VERIFY ALL CIRCUITS SHOWN ARE AVAILABLE FOR DEMOLITION AND REUSE AS NEEDED DURING THE REMODEL PHASE. DOCUMENT ALL CHANGES ON AS-BUILT DRAWINGS.

ELECTRICAL SYMBOL LIST	
X ^o ABC-#	LUMINAIRE - CEILING SURFACE OR PENDANT MOUNTED (LETTER "X" INDICATES TYPE, "o" DENOTES SWITCH FUNCTION, "ABC-#" INDICATES PANEL AND CIRCUIT NUMBER - TYPICAL FOR ALL LUMINAIRES UNLESS NOTED OTHERWISE).
	ENCLOSED LUMINAIRE - SURFACE MOUNTED
	LUMINAIRE - WALL MOUNTED
	SINGLE POLE TOGGLE SWITCH, +45° A.F.F. - "a" LETTER DENOTES SWITCH FUNCTION, TYPICAL FOR ALL SWITCHES UNLESS NOTED OTHERWISE
	DIMMER SWITCH - SIZE AS NOTED ON PLAN, +45° A.F.F.
	JUNCTION BOX - SIZE AS REQUIRED BY CODE
	DUPLEX CONVENIENCE OUTLET - NEMA 5-20R +18° A.F.F. TYPICAL FOR ALL CONVENIENCE OUTLETS, UNLESS NOTED OTHERWISE (LETTER "A" SHOWN ADJACENT TO OUTLET DESIGNATES MOUNTED HORIZONTALLY ABOVE COUNTER).
	GFCI DUPLEX CONVENIENCE OUTLET - NEMA 5-20R
	QUADPLEX CONVENIENCE OUTLET - NEMA 5-20R
	SPECIAL RECEPTACLE AS SHOWN ON PLANS
	FLEXIBLE CONDUIT CONCEALED. NUMBER OF HASH MARKS DENOTES QUANTITY OF WIRES. CURVED HASH MARK DENOTES QUANTITY OF #12 GREEN GROUND WIRES. CONDUCTORS OTHER THAN #12 ARE INDICATED ON PLANS. NO HASH MARKS DENOTES 2 #12 AWG AND 1 #12 GREEN GROUND IN 1/2" MINIMUM DIAMETER CONDUIT.
	CONDUIT RUN UNDERFLOOR OR UNDERGROUND MINIMUM 1" DIAMETER.
	CONDUIT HOMERUN TO PANELBOARD, SWITCHBOARD OR TERMINAL CABINET
	CONDUIT TURNED AND RISED UP
	CONDUIT TURNED AND DROPPED DOWN
	EXISTING CONDUIT AND WIRING
	EXISTING CONDUIT TO BE REMOVED OR ABANDONED, REMOVE WIRES. COORDINATE WITH OWNER.
	EXISTING OVERHEAD WIRING
	PANELBOARD - SURFACE MOUNTED
	PANELBOARD - FLUSH MOUNTED
	EXISTING PANELBOARD - SURFACE MOUNTED
	EXISTING PANELBOARD - FLUSH MOUNTED
	EQUIPMENT DISCONNECT SWITCH - EXTERNALLY OPERATED, FUSED WITH FUSE SIZE INDICATED
	EQUIPMENT DISCONNECT SWITCH - EXTERNALLY OPERATED, NON-FUSIBLE
	TOGGLE TYPE MOTOR RATED DISCONNECT SWITCH WITH OVERLOAD PROTECTION
	ELECTRICAL PULL BOX. "PB#" INDICATES SIZE CORRESPONDING TO PULL BOX SCHEDULE.
	DRAWING SHEET NUMBERED NOTE DESIGNATION - APPLIES TO NUMBERED NOTE ON SAME SHEET
	ELECTRICAL TRANSFORMER. RATING PER SPECIFICATIONS.
	DRAWING PLAN OR DETAIL DESIGNATION - "1" OR "A" DENOTES PLAN OR DETAIL NUMBER, "E-1" DENOTES SHEET NUMBER
	MECHANICAL EQUIPMENT DESIGNATION - SEE MECHANICAL PLANS

- SYMBOL LIST NOTES:**
- "ABC-#" INDICATES PANEL AND CIRCUIT NUMBER.
 - MINIMUM CONDUCTOR SIZE FOR 120V BRANCH CIRCUITS SHALL BE #12 AWG. AT A MINIMUM ALL BRANCH CIRCUITS SHALL CONTAIN 3/4"C, 2#12 AWG AND 1#12 GND UNLESS OTHERWISE INDICATED.
 - EXISTING ELECTRICAL EQUIPMENT, OUTLETS, AND DEVICES ARE SHOWN THE SAME AS NEW, EXCEPT LIGHTLY AND ACCOMPANIED BY (E). SUCH ELECTRICAL EQUIPMENT, OUTLETS, AND DEVICES ARE TO REMAIN AS IS, UNLESS OTHERWISE NOTED ON PLAN OR SPECIFICATION.
 - ELECTRICAL OUTLET BOXES MOUNTED ON OPPOSITE SIDES OF FIRE-RATED WALLS OR PARTITIONS SHALL BE SEPARATED BY A HORIZONTAL DISTANCE OF NOT LESS THAN 24 INCHES PER CBC, WHETHER SHOWN ON THE PLANS OR NOT.
 - VERIFY ON SITE THAT ALL PANELBOARDS HAVE MINIMUM WORKING SPACES PER CODE AND THAT THE DEDICATED PANELBOARD SPACES ARE CLEAR OF ALL DUCTS, PIPING AND EQUIPMENT FOREIGN TO THE PANEL BOARDS. NOTIFY THE ENGINEER FOR CORRECTIVE ACTION IN THE EVENT THAT FOREIGN OBJECTS IMPEDE THE DEDICATED PANELBOARD AREAS.
 - WHERE CONDUIT STUB IS INDICATED, PROVIDE CONDUIT WITH BUSHING AT THE END OF CONDUIT AND PULL ROPE INTO ACCESSIBLE CEILING AREA.

ELECTRICAL SHEET INDEX		
No. OF SHEETS	DRAWING No.	DRAWING DESCRIPTIONS
1	E0.1	ELECTRICAL SHEET INDEX, SYMBOL LIST AND ABBREVIATIONS
2	E1.0	SITE PLAN - ELECTRICAL
3	E2.0	WAREHOUSE FLOOR PLAN - ELECTRICAL
4	E2.1	RECYCLE BUILDING & WEIGH STATION FLOOR PLAN - ELECTRICAL
5	E3.0	ONE-LINE POWER DIAGRAM AND PANEL SCHEDULE
6	E4.0	ELECTRICAL DETAILS
7	E5.0	TITLE 24 INDOOR LIGHTING COMPLIANCE FORMS
8	E5.1	TITLE 24 WEIGH STATION - INDOOR LIGHTING
9	E5.2	TITLE 24 WEIGH STATION - INDOOR & OUTDOOR LIGHTING
10	E5.3	TITLE 24 WEIGH STATION - OUTDOOR LIGHTING
11	E5.4	TITLE 24 RECYCLE BUILDING - INDOOR LIGHTING
12	E5.5	TITLE 24 RECYCLE BUILDING - INDOOR & OUTDOOR LIGHTING
13	E5.6	TITLE 24 RECYCLE BUILDING - OUTDOOR LIGHTING

ABBREVIATIONS			
A	AMPERES	NEMA	NATIONAL ELECTRICAL MANUFACTURERS ASSOCIATION
A.F.F.	ABOVE FINISHED FLOOR	O.H.	OVERHEAD
AFG	ABOVE FINISHED GRADE	PFB	PROVISIONS FOR FUTURE CIRCUIT BREAKER
AF	AMP FUSE	PH	PHASE
A.I.C.	AMPERE INTERRUPTING CAPACITY	PVC	POLYVINYL CHLORIDE
AS	AMP SWITCH	(R)	REMOVE
AWG	AMERICAN WIRE GAUGE	(RE)	RELOCATE EXISTING
BKR	BREAKER	RCPT.	RECEPTACLE
C.	CONDUIT	SWBD	SWITCHBOARD
CU	COPPER	SYS	SYSTEM
(E)	EXISTING	THW	INSULATED STRAND WIRE
(ER)	EXISTING RELOCATED	THHN	NYLON JACKETED WIRE
EMT	ELECTRICAL METALLIC CONDUIT	TYP	TYPICAL
GND	GROUND	UGPS	UNDERGROUND PULL SECTION
GFCI	GROUND FAULT CIRCUIT INTERRUPTER	UL	UNDERWRITERS LABORATORY
Isc	SHORT CIRCUIT AMPERES	W	WIRE, WATT
KVA	KILO VOLT AMPERE	WP	WEATHER PROTECTED
LT.	LIGHT	WR	WEATHER RESISTANT AND WEATHERPROOF
MAX.	MAXIMUM	XFMR	TRANSFORMER
MIN.	MINIMUM	XHHW	CROSS-LINKED POLYETHYLENE WIRE INSULATED
MOG.	MOGUL BASE	Y	WYE
N	NEUTRAL		
(N)	NEW		



June 17, 2025

M. NEILS ENGINEERING, INC.
 Electrical Engineers | Lighting Designers
 100 Howe Ave., Suite 235N
 Sacramento, CA 95825-8217
 www.mneilsengineering.com
 Tel: (916) 923-4400 Fax: (916) 923-4410
 PROJECT #: 19086.21

BAR IS ONE INCH ON ORIGINAL DRAWING
 IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

ROAD NAME: CONSERVATION CAMP RD	MILE POST:	M.NEILS ENGINEERING
ROAD NO.:	EA NO.:	DESIGNED BY: SKL
PROJECT NO.: 438005	BRIDGE NO.:	DRAWN BY: PI
CONTRACT NO.:	DRAWING FILE NAME:	REVIEWED BY: SKL/JLB
PLOT DATE: 6/17/25	REVISION DATE:	APPROVED BY: JLB

UNDERGROUND PULL BOX SCHEDULE

TAG	NOMINAL WIDTH	NOMINAL LENGTH	NOMINAL DEPTH
PB10	10"	17"	12"
PB13	13"	24"	12"
PB17	17"	30"	12"
PB24	24"	36"	12"
PB30	30"	48"	12"

REFER TO PLAN FOR LOCATION OF BOXES AND TYPES USED.

FEEDER SCHEDULE

TAG ###	DESCRIPTION
203*	1" C., 3 #10, AND 1 #10 GND.
203**	1" C., 3 #8, AND 1 #8 GND.

TAGS DENOTED WITH "*" HAVE BEEN UPSIZED FOR VOLTAGE DROP.

- ### NUMBERED NOTES
- 1 PROVIDE NEW DRY TYPE TRANSFORMER WITH NEMA 3R ENCLOSURE. REFER TO ONE-LINE POWER DIAGRAM, "2/E3.0".
 - 2 PROVIDE 1" CONDUIT FOR SIGNAL WIRING FROM SCALE BUILDING TO SCALE. WIRING BY SCALE INSTALLER. COORDINATE LOCATION AND REQUIREMENTS PRIOR TO INSTALLATION
 - 3 PROVIDE 120V CIRCUIT TO SEPTIC TANK CONTROL PANEL AND PUMP. REFER TO SEPTIC TANK DETAIL ON CIVIL PLANS.

VOLTAGE DROP CALCULATION


CEC 215.2(A)(3) FPN No. 2

3 PHASE FORMULA: $VD = \frac{\sqrt{3} \cdot L \cdot R \cdot A}{1000}$ $\%VD = \frac{VD \cdot 100}{V}$

1 PHASE FORMULA: $VD = \frac{2 \cdot L \cdot R \cdot A}{1000}$ $\%VD = \frac{VD \cdot 100}{V}$

PANEL - CKT	DISTANCE (FT)	AMPS	VOLTAGE	CONDUCTOR TYPE	PHASE	WIRE SIZE	IMPEDANCE OHMS/KFT	VD	%VD
METER to MPH	70	160	480	CJ	3	#3/0	0.094	1.82	0.38%
MPH to XFMR "TR"	450	40	480	CJ	3	#3	0.240	7.15	1.49%
PHL "S" to PHL "R"	165	48	208	CJ	3	#3	0.240	3.29	1.58%
R - 13, 15, 17	125	15	208	CJ	3	#8	0.700	2.27	1.09%
R - 5	125	2	120	CJ	1	#10	1.100	0.41	0.34%



1. CONDUCTOR IMPEDANCE VALUES BASED ON CEC CHAPTER 9 TABLE 9 - EFFECTIVE IMPEDANCE FOR UNCOATED COPPER WIRES IN STEEL CONDUIT @ 0.85 PF (OHM/KFT)
 2. PER CEC 210.19(A) FPN NO. 4 - BRANCH CIRCUITS ARE ALLOWED 3% VOLTAGE DROP AND THE MAXIMUM TOTAL VOLTAGE DROP ON BOTH FEEDERS AND BRANCH CIRCUITS TO THE FARTHEST OUTLET DOES NOT EXCEED 5%

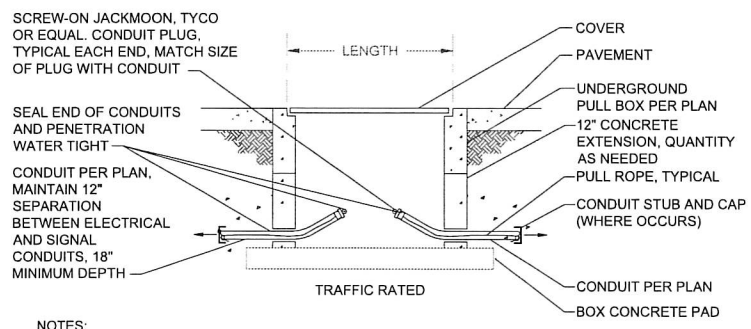

- NOTES:
1. PULL BOX SHALL BE TRAFFIC RATED WHEN SUBJECT TO VEHICULAR TRAFFIC
 2. CLEAN 2" AND LARGER SPARE EMPTY CONDUITS WITH APPROPRIATE SIZE MANDREL PRIOR TO PLACING PULL ROPE AND PLUGGING EMPTY CONDUITS WITH CONDUIT PLUGS.
 3. PULL ROPE: TIE OFF EACH END TO DUCT PLUG TO PREVENT PULL ROPE LOSS IN CONDUIT.

3 UNDERGROUND PULL BOX DETAIL & SCHEDULE

E1.0 NO SCALE

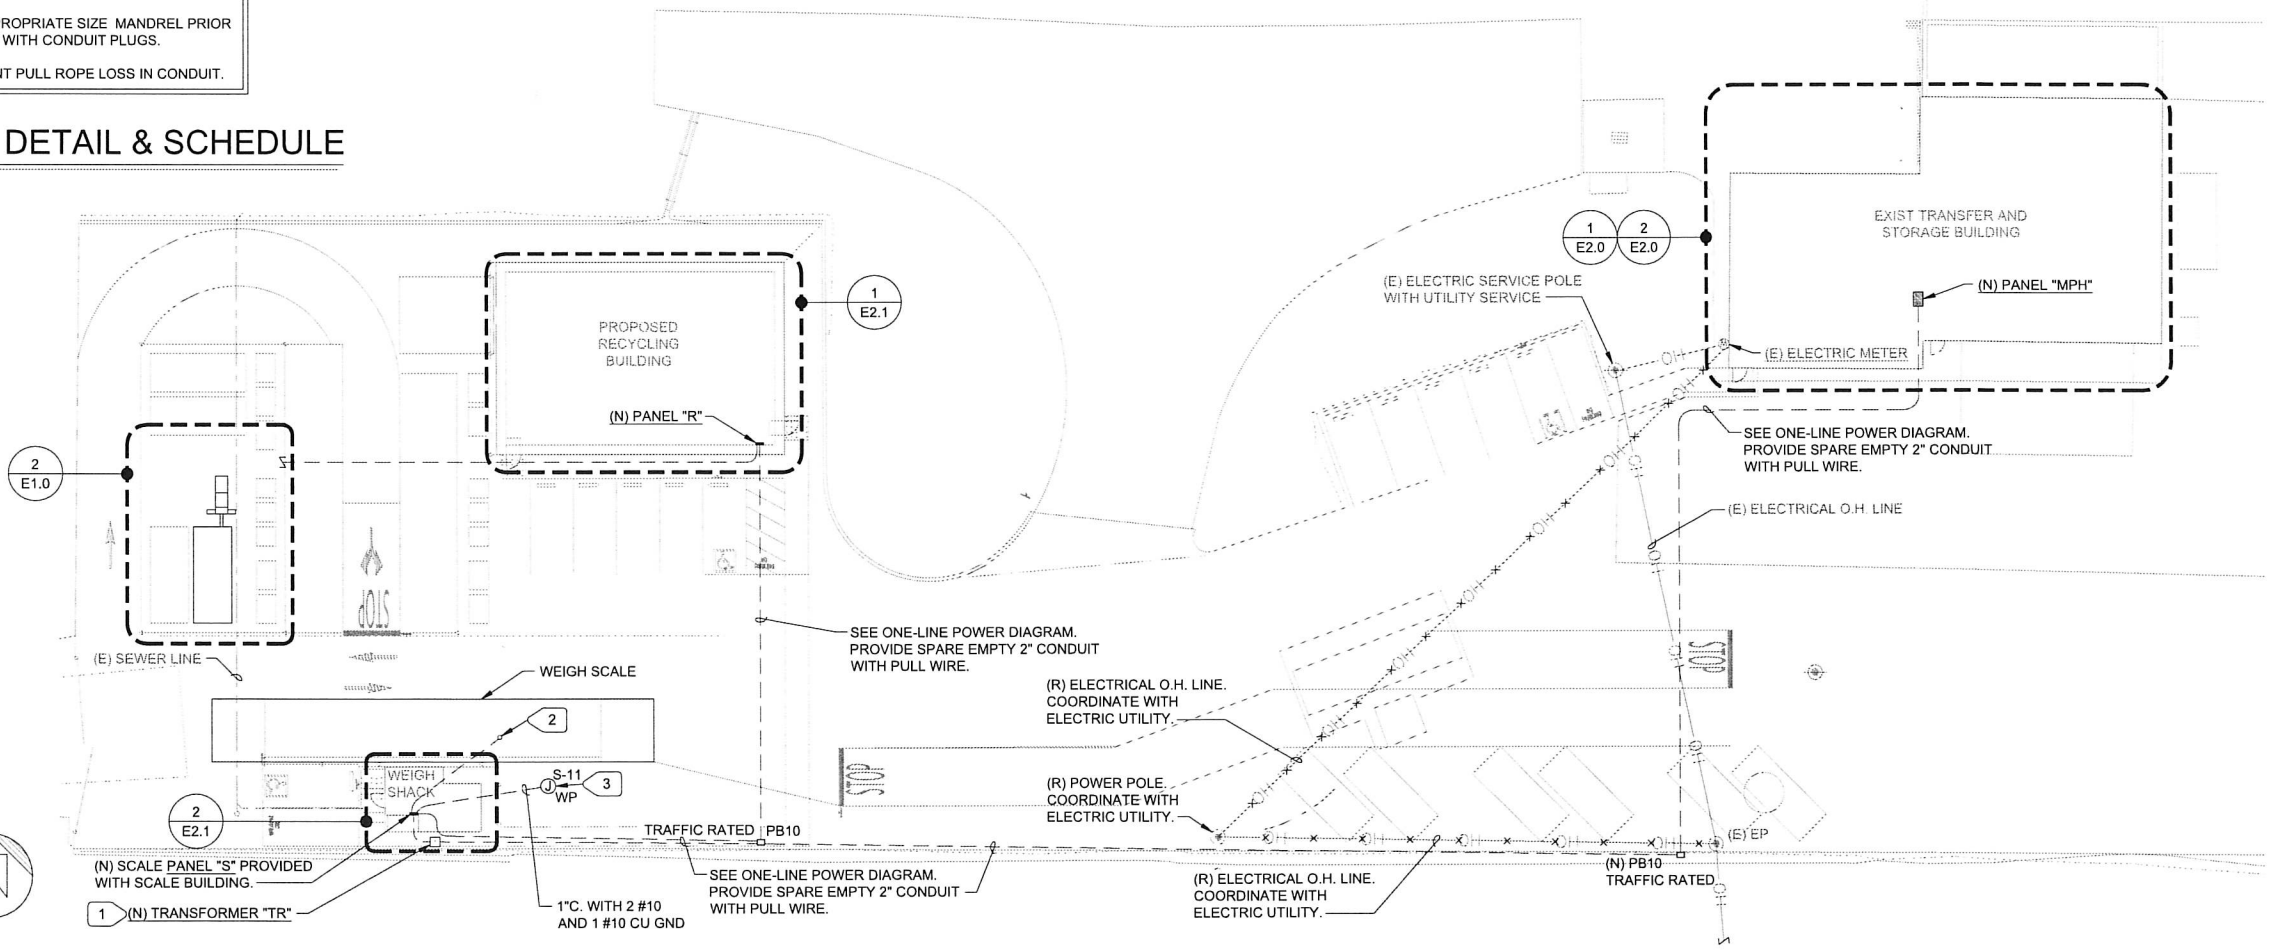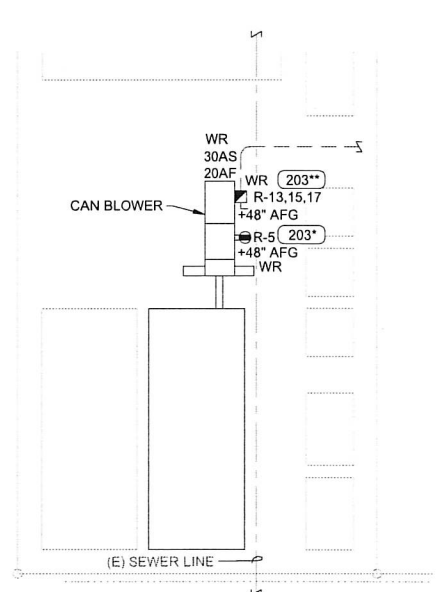

2 CAN BLOWER CONNECTION PLAN

E1.0 SCALE: 1/8" = 1'-0"

1 SITE PLAN - ELECTRICAL

E1.0 SCALE: 1" = 20'-0"

17, 2025 - 10:35am
 UNAUTHORIZED CHANGES & USES:
 M. Neils Engineering, Inc. preparing these plans will not be responsible for or liable for unauthorized changes to or uses to these plans. All changes to these plans must be in writing and must be approved by M. Neils Engineering, Inc.

Jun 17, 2025 - 10:38am UNAUTHORIZED CHANGES & USES: M. Neils Engineering, Inc. preparing these plans will not be responsible for, or liable for unauthorized changes to or uses to these plans. All changes to these plans must be in writing and must be approved by M. Neils Engineering, Inc.



M. NEILS ENGINEERING, INC.
 Electrical Engineers | Lighting Designers
 100 Howe Ave., Suite 235N
 Sacramento, CA 95825-8217
 www.mneilsengineering.com
 Tel: (916) 923-4400 Fax: (916) 923-4410
 PROJECT #: 19086.21

BAR IS ONE INCH ON ORIGINAL DRAWING
 IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY



ROAD NAME: CONSERVATION CAMP RD	M.NEILS ENGINEERING
ROAD NO:	MILE POST:
PROJECT NO.: 438005	EA NO.:
CONTRACT NO.:	BRIDGE NO.:
DRAWING FILE NAME:	DESIGNED BY: SKL
PLOT DATE: 6/17/25	REVIEWED BY: SKL/JLB
REVISION DATE:	APPROVED BY: JLB

EXISTING SITE CONDITIONS NOTE

INFORMATION SHOWN RELATIVE TO EXISTING CONDITIONS IS BASED UPON AVAILABLE RECORDS AND DATA. NOT ALL EXISTING ELECTRICAL DEVICES ARE SHOWN ON DRAWINGS. THEREFORE, IT SHALL BE REGARDED AS AN APPROXIMATION ONLY.

PRIOR TO SUBMITTING BID AND BEFORE START OF ANY ELECTRICAL WORK, INSPECT ALL EXISTING LOCATIONS AND CONDITIONS AND ASCERTAIN WORK REQUIRED TO CLEAR PROJECT AREA OF ALL EXISTING ELECTRICAL ITEMS NOT BEING REUSED OR EXISTING TO REMAIN AS IS. REPORT ALL DISCREPANCIES AND COORDINATE ALL DEMOLITION WORK WITH THE OWNER'S REPRESENTATIVE. MAINTAIN SERVICE TO EXISTING ELECTRICAL EQUIPMENT IN AREAS ADJACENT TO REMODEL AREA, UNLESS OTHERWISE NOTED. SEE DEMOLITION NOTES ON SHEET E0.1 FOR ADDITIONAL REQUIREMENTS.

- NUMBERED NOTES**
- 1 REROUTE ALL EXISTING CIRCUITS FROM REMOVED MAIN PANEL TO NEW PANEL "MPL" RESPECTIVE TO THEIR VOLTAGES. SEE ONE-LINE DIAGRAM FOR ADDITIONAL INSTRUCTIONS. PROVIDE UPDATED PANEL SCHEDULE REFLECTING AS-BUILT CONDITIONS AT PROJECT COMPLETION.
 - 2 MOUNT ELECTRICAL EQUIPMENT TO NEW UNISTRUT MOUNTING STAND. SEE DETAIL "5/E4.0".
 - 3 REROUTE ALL EXISTING CIRCUITS FROM REMOVED ELECTRICAL EQUIPMENT TO NEW PANELS "MPL" AND "MPH" RESPECTIVE TO THEIR VOLTAGE REQUIREMENTS. SEE ONE-LINE DIAGRAM FOR ADDITIONAL INSTRUCTIONS. NOTIFY ENGINEER OF RECORD IF EQUIPMENT CIRCUIT BREAKER REQUIREMENTS DIFFER FROM DRAWINGS. PROVIDE UPDATED PANEL SCHEDULE REFLECTING AS-BUILT CONDITIONS AT PROJECT COMPLETION.
 - 4 DISCONNECT AND REMOVE ALL CONDUCTORS SERVING ALL LOADS CONNECTED TO THE SECONDARY SIDE OF THE TRANSFORMER.
 - 5 MAINTAIN CEC REQUIRED WORKING CLEARANCE IN FRONT OF ALL ELECTRICAL EQUIPMENT.

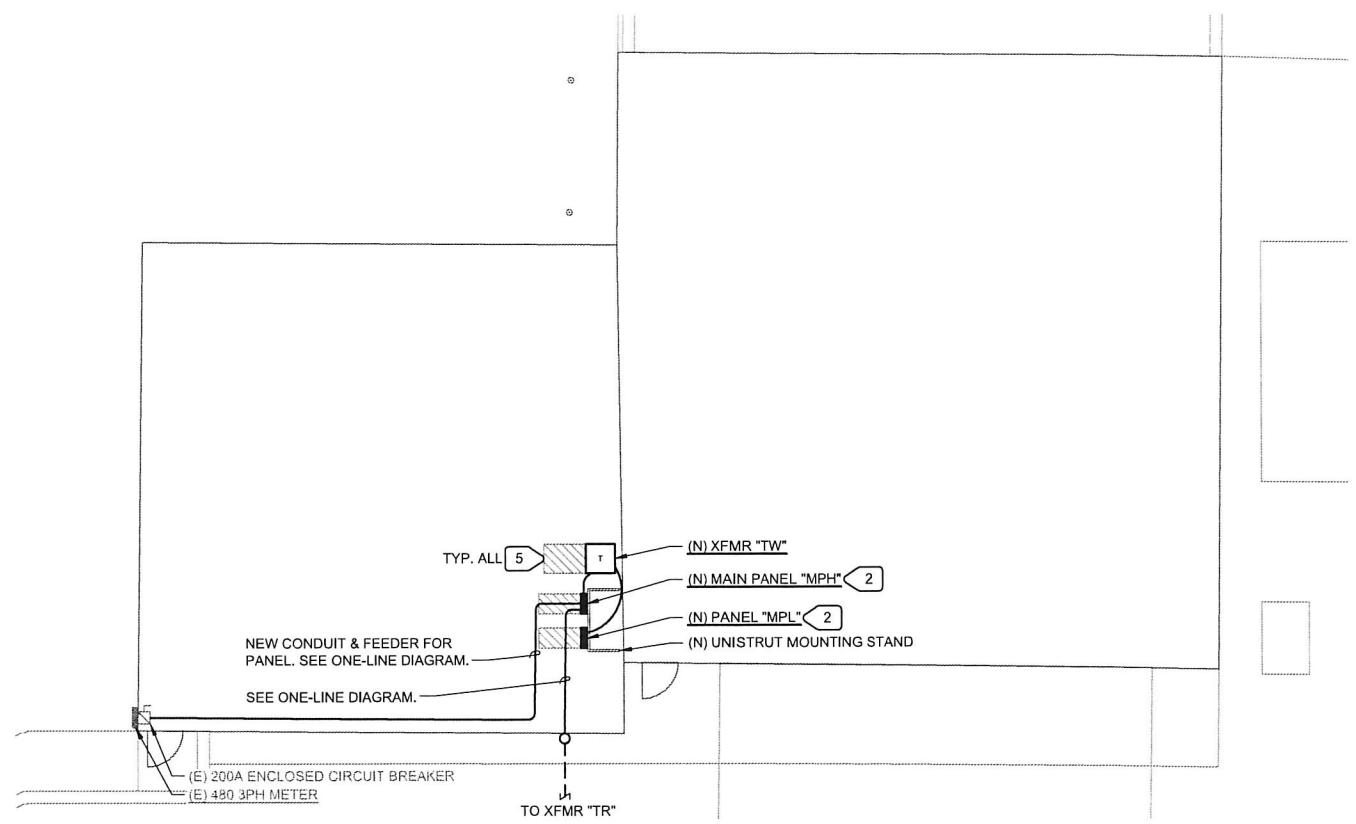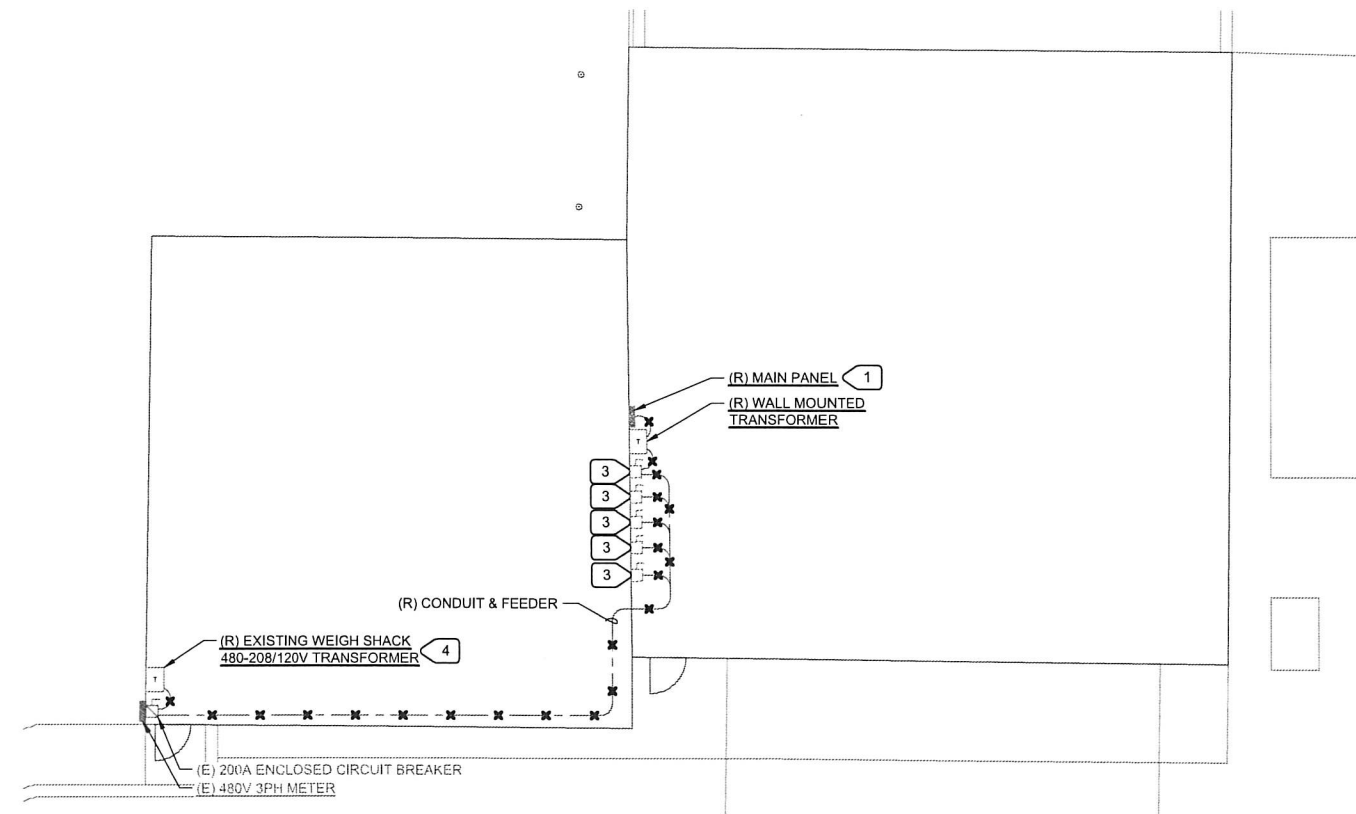

1 WAREHOUSE FLOOR PLAN - DEMOLITION
 E2.0 SCALE: 1/8" = 1'-0"

2 WAREHOUSE FLOOR PLAN - REMODEL
 E2.0 SCALE: 1/8" = 1'-0"



M. NEILS ENGINEERING, INC.
 Electrical Engineers | Lighting Designers
 100 Howe Ave., Suite 235N
 Sacramento, CA 95825-8217
 www.mneilsengineering.com
 Tel: (916) 923-4400 Fax: (916) 923-4410
 PROJECT #: 19086.21

June 17, 2025

BAR IS ONE INCH ON ORIGINAL DRAWING
 IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

ROAD NAME: CONSERVATION CAMP RD	M. NEILS ENGINEERING
ROAD NO.:	MILE POST:
PROJECT NO.: 438005	EA NO.:
CONTRACT NO.:	BRIDGE NO.:
DRAWING FILE NAME:	REVIEWED BY: SKL/ALB
PLOT DATE: 6/17/25	REVISION DATE:
	APPROVED BY: JLB

COUNTY OF HUMBOLDT
 DEPARTMENT OF PUBLIC WORKS
REDWAY TRANSFER STATION
RECYCLE BUILDING & WEIGH STATION
FLOOR PLAN - ELECTRICAL

SHEET
50
 OF
58


E2.1

FEEDER SCHEDULE	
TAG ###	DESCRIPTION
203	1" C., 3 #12, AND 1 #12 GND.
303	3/4" C., 3 #10, AND 1 #10 GND.
502	1" C., 2 #6, AND 1 #10 GND.


NUMBERED NOTES	
1	LOCATE WALL PACK FIXTURE OVER THE ROLL-UP DOOR.
2	LOCATE WALL PACK FIXTURE OVER THE DOOR.
3	PROVIDE NEW DRY TYPE TRANSFORMER "TR" ON NEW CONCRETE PAD. REFER TO ONE-LINE POWER DIAGRAM AND DETAIL "2/E4.0" FOR CONCRETE PAD.
4	PROVIDE PRIMARY DISCONNECT IN NEMA 3R ENCLOSURE. REFER TO ONE-LINE POWER DIAGRAM.
5	PROVIDE ASTRONOMICAL TIME SWITCH, INTERMATIC ET90000, FOR EXTERIOR LIGHTING CONTROL.
6	PROVIDE TIME SWITCH, INTERMATIC ET90000, FOR INTERIOR LIGHTING CONTROL.
7	PROVIDE 15A-2P MOTOR RATED DISCONNECT SWITCH WITH OVERLOAD PROTECTION.

LUMINAIRE SCHEDULE					
TYPE	MANUFACTURER CATALOG NO.	VOLTAGE DESCRIPTION	LIGHT SOURCE (LED, WATTS, LUMENS, COLOR TEMPERATURE, CRI, R9 IF AVAILABLE)	MOUNTING	REMARK NOTE NO.
A1	LSI INDUSTRIES INC. EG3-4-LED-6L-DA-S-UNV- DIM-40-90-OCSWL	UNIV 4FT WET LOCATION LED	LED, 48.46W, 4511L, 4000K*, 80CRI	CEILING MOUNT	
B1	LSI INDUSTRIES INC. SWP1212-MINI-25W-40K- MVOLT-OP-BLK-OCC	UNIV VANDAL RESISTANT LED	LED, 26.7W, 3527L, 4000K*	SURFACE CEILING MOUNT	
C1	LSI INDUSTRIES INC. SWPM-WB-LED-PL2-40- UE-BRZ-PD	UNIV OUTDOOR WALL LED	LED, 68W, 6237L, 4000K*, 84CRI	WALL MOUNT	1
C2	LSI INDUSTRIES INC. SWPL-WB-LED-PLA-40- UE-BRZ-PD	UNIV OUTDOOR WALL LED	LED, 90W, 9191L, 4000K*, 80CRI	WALL MOUNT	1

LUMINAIRE SCHEDULE REMARK NOTES:
 1 PROVIDE LUMINAIRE WITH INTEGRAL PHOTO CELL OPTION TO MEET TITLE 24 PART 6 COMPLIANCE.
GENERAL NOTE:
 REFER TO PLAN FOR LOCATION, QUANTITIES, AND SWITCH FUNCTION.

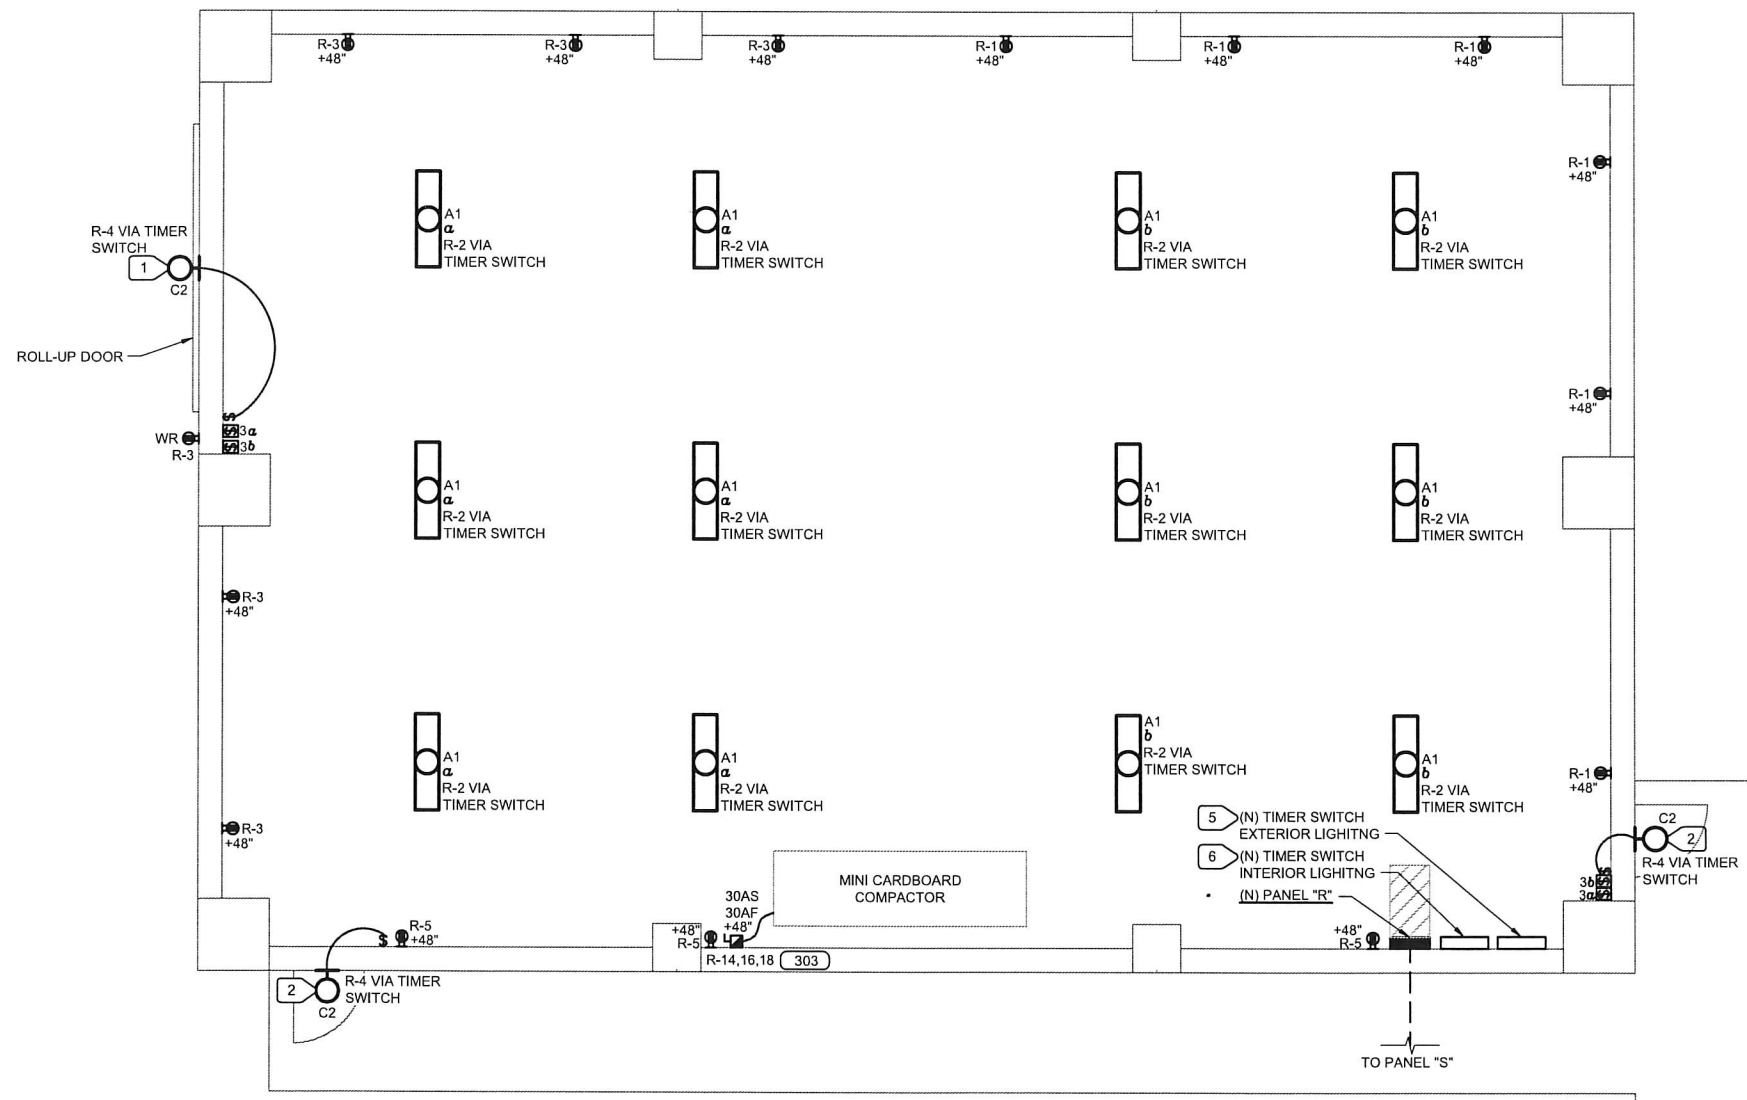

1 RECYCLE BUILDING PLAN - ELECTRICAL
 E2.1 SCALE: 1/4" = 1'-0"

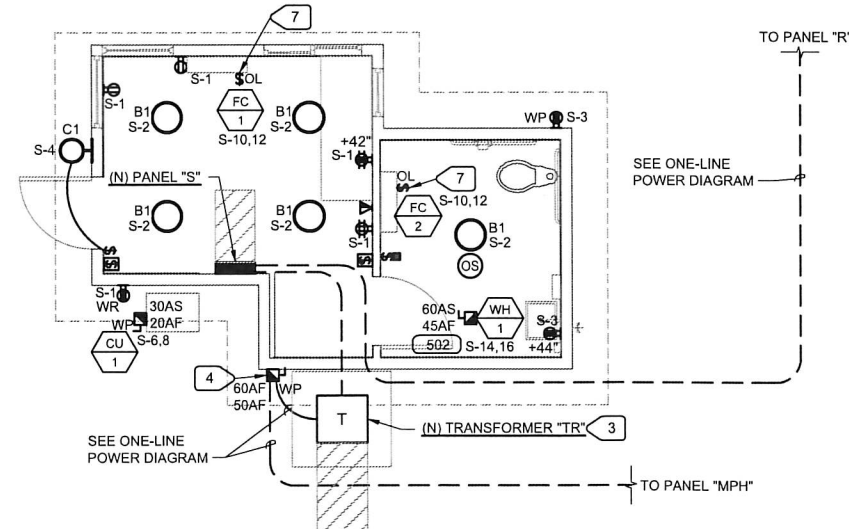

2 WEIGH STATION PLAN - ELECTRICAL
 E2.1 SCALE: 1/4" = 1'-0"

Jun 17, 2025 - 10:39am
 UNAUTHORIZED CHANGES & USES:
 M. Neils Engineering, Inc. preparing these plans will not be responsible for, or liable for unauthorized changes to or uses to these plans. All changes to these plans must be in writing and must be approved by M. Neils Engineering, Inc.



M. NEILS
ENGINEERING, INC.
Electrical Engineers | Lighting Designers
100 Howe Ave., Suite 235N
Sacramento, CA 95825-8217
www.mneilsengineering.com
Tel: (916) 923-4400 Fax: (916) 923-4410
PROJECT #: 19086.21

BAR IS ONE INCH ON ORIGINAL DRAWING
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

ROAD NAME: CONSERVATION CAMP RD
ROAD NO.: PROJECT NO: 438005
MILE POST: EA NO.:
CONTRACT NO.: BRIDGE NO.:
DRAWING FILE NAME:
PLOT DATE: 6/17/25 REVISION DATE:

M. NEILS ENGINEERING
DESIGNED BY: SKL
DRAWN BY: PI
REVIEWED BY: SKL/JLB
APPROVED BY: JLB

COUNTY OF HUMBOLDT
DEPARTMENT OF PUBLIC WORKS
REDWAY TRANSFER STATION
ONE-LINE POWER DIAGRAM AND PANEL SCHEDULE


SHEET 51 OF 58
E3.0

FEEDER SCHEDULE

TAG	###	DESCRIPTION
503*		1-1/4" C., 3 #3, AND 1 #7 GND.
604*		1-1/4" C., 4 #3, AND 1 #8 GND.
1004		1-1/2" C., 4 #1, AND 1 #6 GND.
1253		2" C., 3 #1/0, AND 1 #6 GND.
2004		2" C., 4 #3/0, AND 1 #6 GND.
2504		3" C., 4 #250, AND 1 #4 GND.

NOTE: TAGS WITH ADDED "*" HAVE BEEN UPSIZED TO ACCOUNT FOR VOLTAGE DROP

- ### NUMBERED NOTES
- DISCONNECT EXISTING LOADS FROM EXISTING PANEL TO BE REMOVED. INTERCEPT, EXTEND AND CONNECT EXISTING EQUIPMENT TO NEW PANEL "MPL".
 - DISCONNECT EXISTING LOADS FROM EXISTING CIRCUIT BREAKERS TO BE REMOVED. INTERCEPT, EXTEND AND CONNECT EXISTING EQUIPMENT TO NEW PANEL "MPH".

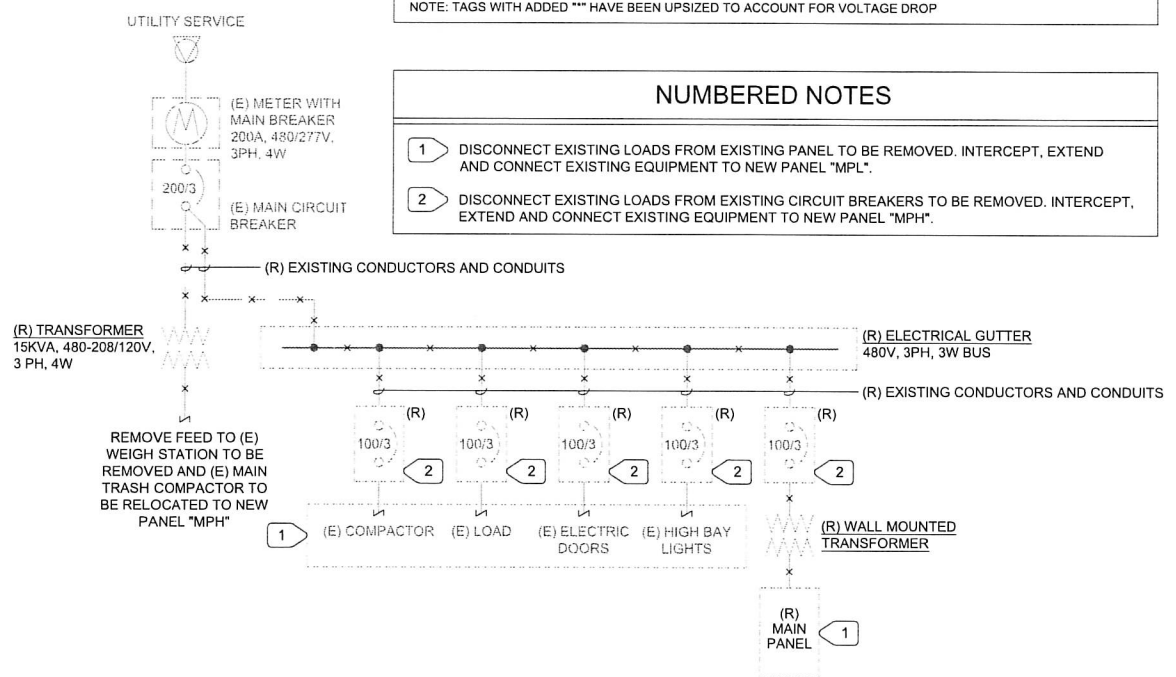

1 PARTIAL ONE-LINE POWER DIAGRAM - DEMOLITION
E3.0 NO SCALE

NEW PANEL "MPH" SCHEDULE

POWER SOURCE: METER MAIN SYSTEM: NORMAL BRANCH		LOCATION: WAREHOUSE				
TYPE	BUS: 225 AMPS	MAIN BKR: 200/3	VOLTAGE: 480Y/277 VOLT, 3 PHASE, 4 WIRES	MOUNTING SURFACE: PANEL TYPE NEMA 1	REMARKS: COORDINATE AIC RATING WITH EXISTING SERVICE	
LOAD SERVED	kVA	CB	CKT PHASE CKT	CB	kVA	LOAD SERVED
PANEL "MPL" VIA XFMR "TW"	[1]	110/3	1 A 2	15/3	[1]	CAN BLOWER [2]
	[1]		3 B 4			
	[1]		5 C 6			
PANEL "S" VIA XFMR "TR"	10.9	50/3	7 A 8	20/3	[1]	MAIN TRASH COMPACTOR [2]
	9.2		9 B 10			
	7.1		11 C 12			
UNKNOWN EXISTING LOAD [1][3]	[1]	PFB	13 A 14	20/2	[1]	HIGH BAY LIGHTS [2]
	[1]		15 B 16			
	[1]		17 C 18	PFB	[1]	SPACE

NOTES:
[1] LOADS ARE EXISTING AND ACCOUNTED FOR IN THE MAIN SERVICE LOAD CALCULATION AS EXISTING LOAD
[2] EXISTING EQUIPMENT RECONNECTED TO NEW CIRCUIT
[3] VERIFY IF UNKNOWN EXISTING LOAD IS STILL ON SITE AND NEEDS POWER PRIOR TO BID. INCLUDE IN BID PRICING FOR A COMPLETE BRANCH CIRCUIT AND BREAKER SIZED FOR EQUIPMENT PER MANUFACTURER'S RECOMMENDATIONS. SUBMIT EXISTING EQUIPMENT INFORMATION TO FEED

NEW PANEL "MPL" SCHEDULE [1]


POWER SOURCE: PANEL "MPH" VIA XFMR "TW" SYSTEM: NORMAL BRANCH		LOCATION: WAREHOUSE				
TYPE	BUS: 400 AMPS	MAIN BKR: 250/3	VOLTAGE: 208Y/120 VOLT, 3 PHASE, 4 WIRES	MOUNTING SURFACE: PANEL TYPE NEMA 3R	REMARKS: COORDINATE AIC RATING WITH EXISTING SERVICE	
LOAD SERVED	kVA	CB	CKT PHASE CKT	CB	kVA	LOAD SERVED
BALER		20/1	1 A 2	20/1		OFFICE/RECYCLING OUTLETS
			3 B 4	20/1		SPARE
			5 C 6	20/1		SPARE
DUMP OUTLETS		30/1	7 A 8	20/1		OFFICE
DUMP OUTLETS		30/1	9 B 10	20/1		OFFICE
RECYCLING OUTSIDE OUTLETS		20/1	11 C 12	30/2		220V OUTLET WEST WALL
RECYCLING OUTLETS		20/1	13 A 14	20/2		220V OUTLET EAST WALL
RECYCLING 220V		20/2	15 E 16	20/2		220V OUTLET EAST WALL
			17 C 18			
SPACE		PFB	19 A 20	20/2		PUMP PIT
			23 C 24			
SPACE		PFB	25 A 26	30/2		AL. CAN CONV
SPACE		PFB	27 B 28	PFB		SPACE
SPACE		PFB	29 C 30	PFB		SPACE
SPACE		PFB	31 A 32	PFB		SPACE
SPACE		PFB	33 E 34	PFB		SPACE
SPACE		PFB	35 C 36	PFB		SPACE
SPACE		PFB	37 A 38	PFB		SPACE
SPACE		PFB	39 B 40	PFB		SPACE
SPACE		PFB	41 C 42	PFB		SPACE

NOTES:
[1] ALL CIRCUITS ARE EXISTING. RELOCATED FROM THE EXISTING 208/120V, 3-PHASE, 4-WIRE ELECTRICAL PANEL IN THE EXISTING WAREHOUSE BUILDING. NO NEW LOADS ARE BEING ADDED. NEW PANEL IS THE SAME VOLTAGE AND CAPACITY AS THE EXISTING PANEL THAT IS BEING REPLACED.

NEW PANEL "S" SCHEDULE

POWER SOURCE: PANEL "MPH" VIA XFMR "TR" SYSTEM: NORMAL BRANCH		LOCATION: WEIGH SHACK				
TYPE	BUS: 100 AMPS	MAIN BKR: 100/3	VOLTAGE: 208Y/120 VOLT, 3 PHASE, 4 WIRES	MOUNTING SURFACE: PANEL TYPE NEMA 1	REMARKS: COORDINATE AIC RATING WITH EXISTING SERVICE	
LOAD SERVED	kVA	CB	CKT PHASE CKT	CB	kVA	LOAD SERVED
RECEPTACLES	1.1	20/1	1 A 2	20/1	0.1	INTERIOR LIGHTING
RECEPTACLES	0.4	20/1	3 B 4	20/1	0.1	OUTDOOR LIGHTING
SPARE		20/1	5 C 6	20/2	0.8	OUTDOOR AC-UNIT CU-1
SPARE		20/1	7 A 8		0.8	
SPARE		20/1	9 B 10	15/2	0.2	INDOOR AC-UNIT FC-1, FC-2
SEPTIC TANK	1.7	25/1	11 C 12		0.2	
	5.4		13 A 14	45/2	3.5	INSTANTANEOUS WATER HEATER WH-1
PANEL "R"	5.1	60/3	15 B 16		3.5	
	4.4		17 C 18	PFB		SPACE
SPACE		PFB	19 A 20	PFB		SPACE
SPACE		PFB	21 B 22	PFB		SPACE
SPACE		PFB	23 C 24	PFB		SPACE

NOTES:
CONNECTED LOAD
PHASE A = 10.9 kVA
PHASE B = 9.2 kVA
PHASE C = 7.1 kVA
TOTAL = 27.2 kVA
TOTAL = 75.6 Amperes

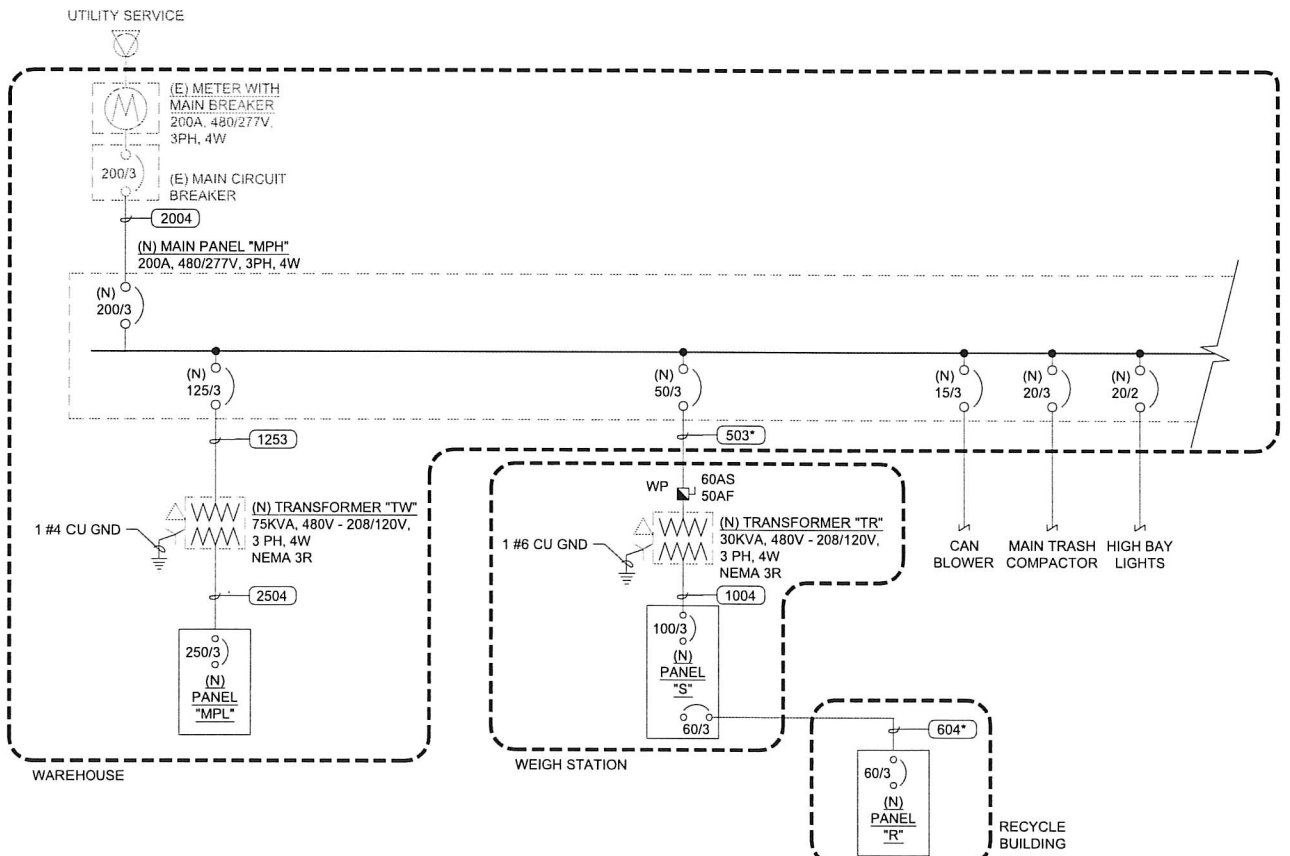

2 PARTIAL ONE-LINE POWER DIAGRAM - REMODEL
E3.0 NO SCALE

NEW PANEL "R" SCHEDULE

POWER SOURCE: PANEL "S" SYSTEM: NORMAL BRANCH		LOCATION: RECYCLE BUILDING				
TYPE	BUS: 100 AMPS	MAIN BKR: 60/3	VOLTAGE: 208Y/120 VOLT, 3 PHASE, 4 WIRES	MOUNTING SURFACE: PANEL TYPE NEMA 3R	REMARKS: COORDINATE AIC RATING WITH EXISTING SERVICE	
LOAD SERVED	kVA	CB	CKT PHASE CKT	CB	kVA	LOAD SERVED
RECEPTACLES	1.1	20/1	1 A 2	20/1	0.8	INTERIOR LIGHTING
RECEPTACLES	1.1	20/1	3 B 4	20/1	0.3	OUTDOOR LIGHTING
RECEPTACLES	0.7	20/1	5 C 6	20/1		SPACE
SPARE		20/1	7 A 8	PFB		SPACE
SPACE		PFB	9 B 10	PFB		SPACE
SPACE		PFB	11 C 12	PFB		SPACE
CAN BLOWER [1]	1.7		13 A 14		2.0	
	1.7	20/3	15 B 16	30/3	2.0	MINI COMPACTOR [1]
	1.7		17 C 18		2.0	

NOTES:
[1] EXISTING EQUIPMENT RECONNECTED TO NEW CIRCUIT.
CONNECTED LOAD
PHASE A = 5.4 kVA
PHASE B = 5.1 kVA
PHASE C = 4.4 kVA
TOTAL = 14.8 kVA
TOTAL = 41.2 Amperes

LOAD CALCULATION (EXISTING 200A MAIN LOAD SERVICE)

Project Name: Redway Transfer Station Date: 27-Mar-25
Project No. 19086.21 By: M. Neils Engineering, Inc.

Existing maximum demand for 200A Main Metered Service (based on 12 months readings below): 12.52 kVA
Source: PG&E Billing 12 month billing history meter # 1029453827

Month	kVA	Month	kVA	Month	kVA
Jun-21	7.5	Oct-21	7.3	Feb-22	8.3
Jul-21	10.4	Nov-21	7.2	Mar-22	7.3
Aug-21	10.1	Dec-21	9.2	Apr-22	7.7
Sep-21	7.7	Jan-22	12.5	May-22	6.0

Existing load factor (25%) = 3.13 kVA

Total EXISTING service load = 15.66 kVA

New Load (BEING ADDED):
General purpose receptacle outlets 4.30 kVA
First 10 kVA or less @ 100% = 4.30 kVA
Remainder over 10 kVA = 0.00 @ 50% = 0.00 kVA

Lighting 0.30 kVA @ 125% = 1.13 kVA

Noncontinuous Loads 7.00 kVA @ 100% = 7.00 kVA


Motors 3.70 kVA
25% of largest motor 0.43 kVA

Total NEW service load = 16.55 kVA

TOTAL SERVICE LOAD (EXISTING + NEW IMPROVEMENTS) = 48.76 kVA
48.76 kVA at 277/480 Volt, 3 phase 58.67 amperes

Existing: 200A / 3 main circuit breaker (Main Switchboard)
Therefore, (E) 200 amperes, 277/480 Volt, 3-phase, 4-wire service has the capacity for the new load. See one-line power diagram

All changes to these plans must be in writing and must be approved by M. Neils Engineering, Inc. UNAUTHORIZED CHANGES & USES: M. Neils Engineering, Inc. preparing these plans will not be responsible for or liable for unauthorized changes to or uses to these plans. Rev. 1.7. 2025 - E3.03-REV



M. NEILS ENGINEERING, INC.
 Electrical Engineers | Lighting Designers
 100 Howe Ave., Suite 235N
 Sacramento, CA 95825-9217
 www.mneilsengineering.com
 Tel: (916) 923-4400 Fax: (916) 923-4410
 PROJECT #: 19086.21

ROAD NAME: CONSERVATION CAMP RD	M. NEILS ENGINEERING
ROAD NO:	MILE POST:
PROJECT NO: 438005	EA NO:
CONTRACT NO:	BRIDGE NO:
DRAWING FILE NAME:	DESIGNED BY: SKL
PLOT DATE: 6/9/25	REVISION DATE:
	DRAWN BY: PI
	REVIEWED BY: SKL/ALB
	APPROVED BY: ALB


COUNTY OF HUMBOLDT
DEPARTMENT OF PUBLIC WORKS

REDWAY TRANSFER STATION

ELECTRICAL DETAILS

SHEET
52
OF
58

E4.0

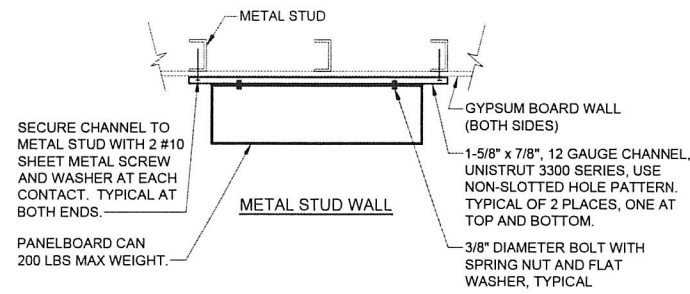


SURFACE PANELBOARD

1 MOUNTING DETAIL

1
E4.0

NO SCALE

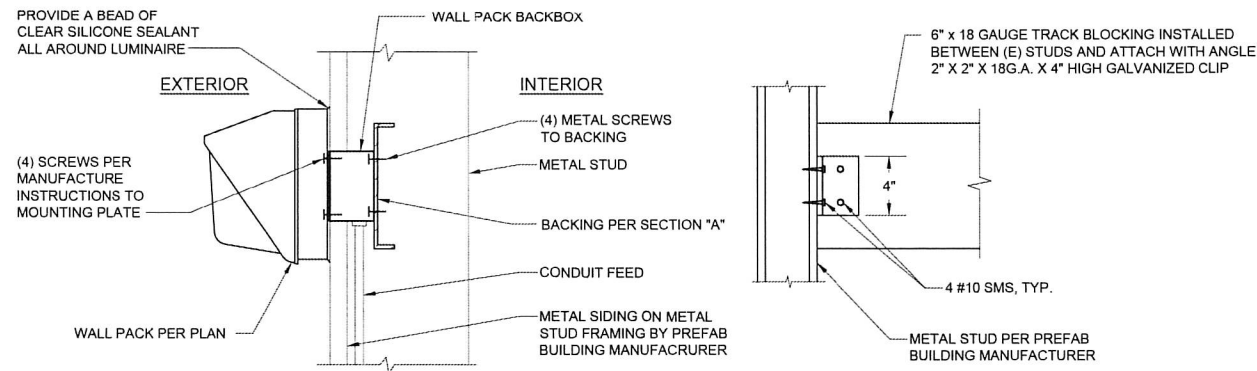


SIDE VIEW

SECTION "A"

4 WALL PACK MOUNTING DETAIL

4
E4.0


NO SCALE

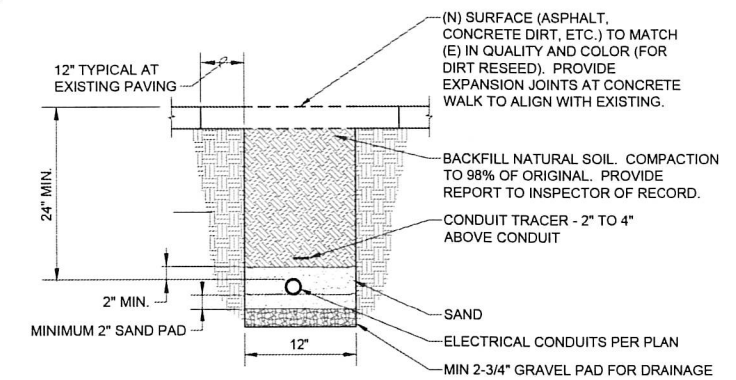

6 CONDUIT TRENCHING DETAIL

6
E4.0


NO SCALE

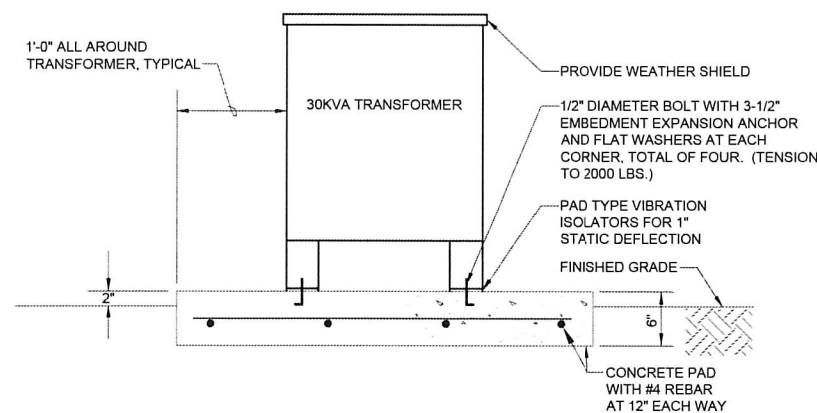

2 EXTERIOR TRANSFORMER PAD MOUNTING DETAIL

2
E4.0

NO SCALE

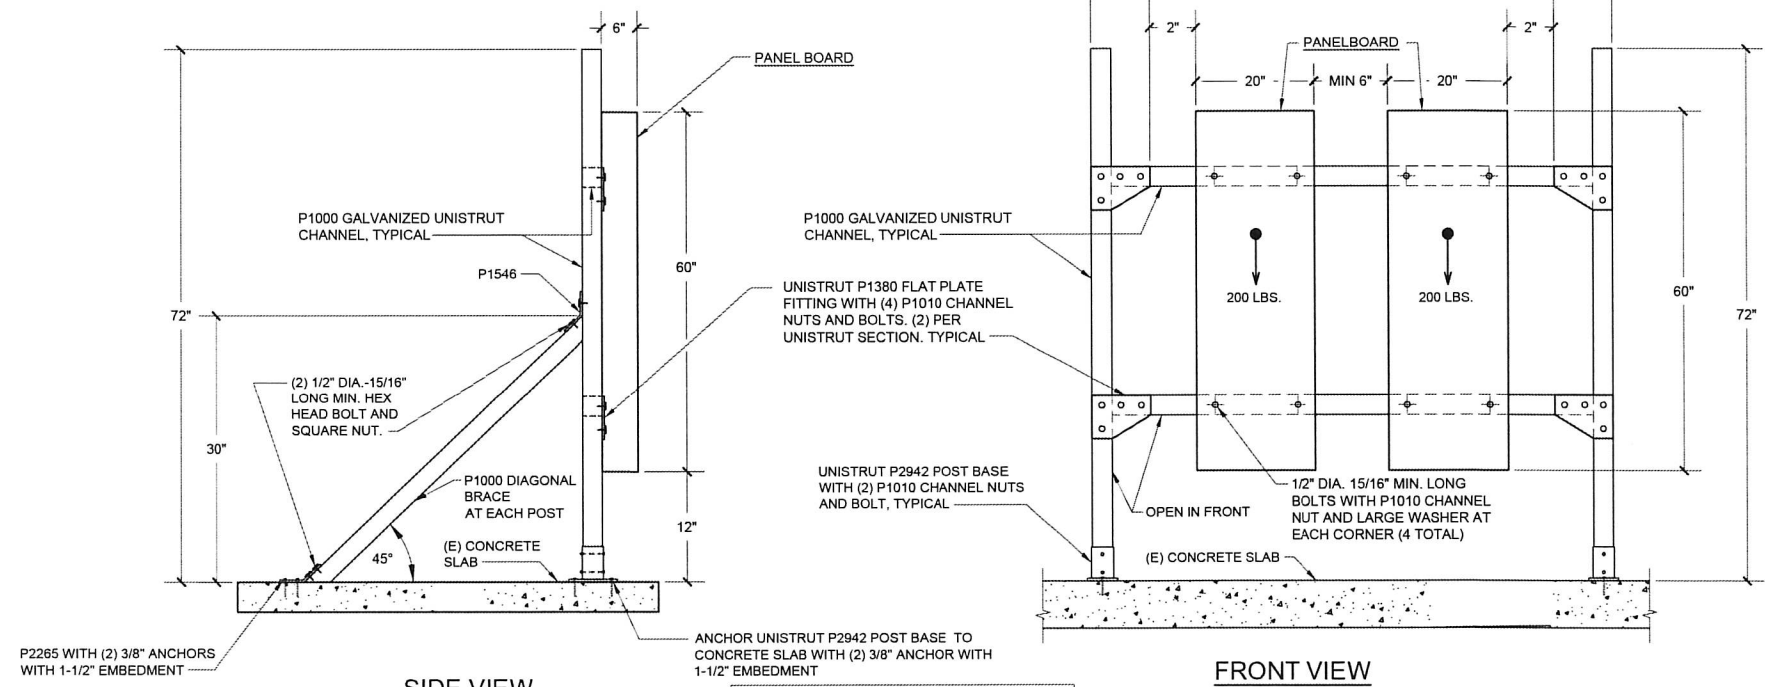

SIDE VIEW


FRONT VIEW

- NOTES:**
1. ALL UNISTRUT TO BE SOLID (NO SLOTTED HOLES ALLOWED).
 2. TORQUE ALL UNISTRUT CONNECTIONS PER MANUFACTURER REQUIREMENTS.

5 FREE STANDING PANEL SUPPORT

5
E4.0

NO SCALE

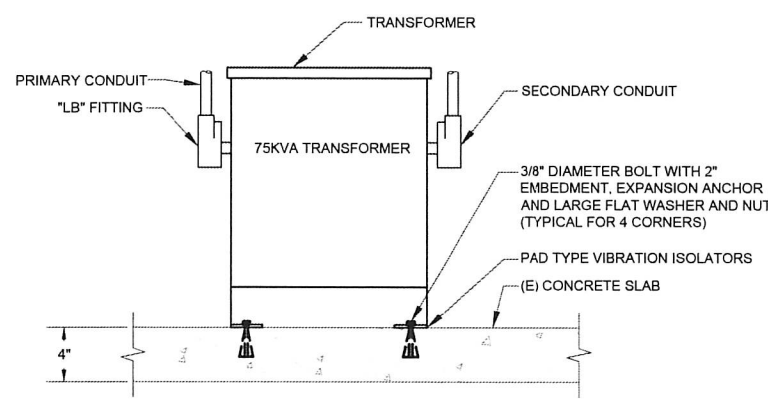

3 TRANSFORMER MOUNTING DETAIL

3
E4.0

NO SCALE

Jun 09, 2025 - 9:01pm
 UNAUTHORIZED CHANGES & USES:
 M. Neils Engineering, Inc. preparing these plans will not be responsible for, or liable for unauthorized changes to or uses to these plans. All changes to these plans must be in writing and must be approved by M. Neils Engineering, Inc.



M. NEILS
ENGINEERING, INC.
 Electrical Engineers | Lighting Designers
 100 Howe Ave., Suite 235N
 Sacramento, CA 95825-8217
 www.mneilsengineering.com
 Tel: (916) 923-4400 Fax: (916) 923-4410
 PROJECT #: 19086.21

June 17, 2025

BAR IS ONE INCH ON ORIGINAL DRAWING
 IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

ROAD NAME: CONSERVATION CAMP RD	M.NEILS ENGINEERING
ROAD NO:	MILE POST:
PROJECT NO.: 438005	EA NO.:
CONTRACT NO.:	BRIDGE NO.:
DRAWING FILE NAME:	DESIGNED BY: SKL
PLOT DATE: 6/17/25	REVIEWED BY: SKL/ALB
REVISION DATE:	APPROVED BY: ALB

COUNTY OF HUMBOLDT
 DEPARTMENT OF PUBLIC WORKS

REDWAY TRANSFER STATION

**TITLE 24 WEIGH STATION -
 INDOOR LIGHTING**

SHEET
 53
 OF
 58

E51

Jun 17, 2025 - 10:39am
 UNAUTHORIZED CHANGES & USES:
 M. Neils Engineering, Inc. preparing these plans will not be responsible for, or liable for unauthorized changes to or uses to these plans. All changes to these plans must be in writing and must be approved by M. Neils Engineering, Inc.

STATE OF CALIFORNIA
Indoor Lighting
 CALIFORNIA ENERGY COMMISSION
 NRCC-LTI-E

CERTIFICATE OF COMPLIANCE
 Project Name: 19086.21 Redway Transfer Station - Weigh Station Report Page: (Page 1 of 7)
 Date Prepared: 2025-06-06T15:04:32-04:00

A. GENERAL INFORMATION

01 Project Location (city)	Redway, CA	04 Total Conditioned Floor Area (ft ²)	220
02 Climate Zone	2	05 Total Unconditioned Floor Area (ft ²)	0
03 Occupancy Types Within Project (select all that apply):		06 # of Stories (Habitable Above Grade)	0

Commercial Industrial

B. PROJECT SCOPE

This table includes any lighting systems that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in 140.6 / 170.2(e) or 141.0(b)2 / 180.2(b)4 for alterations.

Scope of Work	Conditioned Spaces	Unconditioned Spaces
01	02	03
My Project Consists of (check all that apply):	Calculation Method	Area (ft ²)
<input checked="" type="checkbox"/> New Lighting System	Area Category Method	220
<input type="checkbox"/> New Lighting System - Parking Garage	N/A	0
Total Area of Work (ft²)		220

Generated Date/Time: Documentation Software: Energy Code Ace
 CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Compliance ID: 282723-0625-0010
 Schema Version: rev 20220101 Report Generated: 2025-06-06 12:04:38

STATE OF CALIFORNIA
Indoor Lighting
 CALIFORNIA ENERGY COMMISSION
 NRCC-LTI-E

CERTIFICATE OF COMPLIANCE
 Project Name: 19086.21 Redway Transfer Station - Weigh Station Report Page: (Page 2 of 7)
 Date Prepared: 2025-06-06T15:04:32-04:00

C. COMPLIANCE RESULTS

If any cell on this table says "DOES NOT COMPLY" or "COMPLIES with Exceptional Conditions" refer to Table D for guidance.

Lighting in conditioned and unconditioned spaces must not be combined for compliance per 140.6(b)1 / 170.2(e)	Allowed Lighting Power per 140.6(b) / 170.2(e) (Watts)					Adjusted Lighting Power per 140.6(a) / 170.2(e) (Watts)			Compliance Results
	01	02	03	04	05	06	07	08	
	Complete Building 140.6(c)1	Area Category 140.6(c)2 / 170.2(e)4	Area Category Additional 140.6(c)2G / 170.2(e)4Av (+)	Tailored 140.6(c)3 / 170.2(e)4B (+)	Total Allowed (Watts)	Total Designed (Watts)	PAF Lighting Control Credits 140.6(a)2 / 170.2(e)1B (-)	Total Adjusted (Watts) *Includes Adjustments	
	(See Table I)	(See Table I)	(See Table J)	(See Table K)		(See Table F)	(See Table P)		05 must be >= 08 140.6 / 170.2(e)
Conditioned		143			= 143	≥ 133.5		= 133.5	COMPLIES
Unconditioned									COMPLIES
Controls Compliance (See Table H for Details)									COMPLIES
Rated Power Reduction Compliance (See Table Q for Details)									

D. EXCEPTIONAL CONDITIONS
 This table is auto-filled with uneditable comments because of selections made or data entered in tables throughout the form.

E. ADDITIONAL REMARKS
 This table includes remarks made by the permit applicant to the Authority Having Jurisdiction.

Generated Date/Time: Documentation Software: Energy Code Ace
 CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Compliance ID: 282723-0625-0010
 Schema Version: rev 20220101 Report Generated: 2025-06-06 12:04:38

STATE OF CALIFORNIA
Indoor Lighting
 CALIFORNIA ENERGY COMMISSION
 NRCC-LTI-E

CERTIFICATE OF COMPLIANCE
 Project Name: 19086.21 Redway Transfer Station - Weigh Station Report Page: (Page 3 of 7)
 Date Prepared: 2025-06-06T15:04:32-04:00

F. INDOOR LIGHTING FIXTURE SCHEDULE

This table includes all planned permanent and portable lighting other than dwelling unit/hotel/motel room lighting. Multifamily dwelling unit and hotel/motel room lighting is documented in Table T. If using Table T to document lighting in multifamily common use areas providing shared provisions for living, eating, cooking or sanitation, those luminaires are not included here.

Designed Wattage: Conditioned Spaces

01	02	03	04	05	06	07	08	09	10
Name or Item Tag	Complete Luminaire Description	Modular (Track) Fixture	Small Aperture & Color Change ¹	Watts per luminaire ²	How is Wattage determined	Total Number of Luminaires	Excluded per 140.6(a)3 / 170.2(e)2C	Design Watts	Field Inspector Pass Fail
B1	VANDAL RESISTANT LED	No	NA	26.7		5	No	133.5	<input type="checkbox"/> <input type="checkbox"/>
Total Designed Watts: CONDITIONED SPACES								133.5	

¹FOOTNOTE: Design Watts for small aperture and color changing luminaires which qualify per 140.6(a)4B / 170.2(e)2D is adjusted to be 75% / 80% of their rated wattage. Table F automatically makes this adjustment, the permit applicant should enter full rated wattage in column 05.
²Authority Having Jurisdiction may ask for luminaire cut sheets to confirm wattage used for compliance per 130.0(c) / 160.5(b). Wattage used must be the maximum rated for the luminaire, not the lamp.

G. MODULAR LIGHTING SYSTEMS
 This section does not apply to this project.

H. INDOOR LIGHTING CONTROLS (Not including PAFs)

This table includes lighting controls for conditioned and unconditioned spaces.

01	02	03
Mandatory Demand Response 110.12(c)	Shut-off controls 130.1(c) / 160.5(b)4C	Field Inspector Pass Fail
NA < 4,000W subject to multilevel	See Area/Space Level Controls	<input type="checkbox"/> <input type="checkbox"/>

Generated Date/Time: Documentation Software: Energy Code Ace
 CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Compliance ID: 282723-0625-0010
 Schema Version: rev 20220101 Report Generated: 2025-06-06 12:04:38

STATE OF CALIFORNIA
Indoor Lighting
 CALIFORNIA ENERGY COMMISSION
 NRCC-LTI-E

CERTIFICATE OF COMPLIANCE
 Project Name: 19086.21 Redway Transfer Station - Weigh Station Report Page: (Page 4 of 7)
 Date Prepared: 2025-06-06T15:04:32-04:00

H. INDOOR LIGHTING CONTROLS (Not including PAFs)

Area Level Controls

04	05	06	07	08	09	10	11	12
Area Description	Complete Building or Area Category Primary Function Area	Manual Area Controls 130.1(a) / 160.5(b)4A	Multi-Level Controls 130.1(b) / 160.5(b)4B	Shut-Off Controls 130.1(c) / 160.5(b)4C	Primary/Sky lit Daylighting 130.1(d) / 160.5(b)4D	Secondary Daylighting 130.1(d) / 160.5(b)4D	Interlocked Systems 140.6(a)1 / 170.2(e)2A	Field Inspector Pass Fail
Weigh Station	Restroom	Auth. Personnel	NA: Enclosed area <1005F	Occupancy Sensor	NA: Not daylight zone	NA: Not daylight zone	No	<input type="checkbox"/> <input type="checkbox"/>
Restroom	Restroom	Readily Accessible	NA: Enclosed area <1005F	Occupancy Sensor	NA: Not daylight zone	NA: Not daylight zone	No	<input type="checkbox"/> <input type="checkbox"/>
13 Plan Sheet Showing Daylit Zones:								

I. LIGHTING POWER ALLOWANCE: COMPLETE BUILDING OR AREA CATEGORY METHODS

Each area complying using the Complete Building or Area Category Methods per 140.6(b) are included in this table. Column 06 indicates if additional lighting power allowances per 140.6(c) or adjustments per 140.6(a) are being used.

01	02	03	04	05	06
Area Description	Complete Building or Area Category Primary Function Area	Allowed Density (W/ft ²)	Area (ft ²)	Allowed Wattage (Watts)	Additional Allowance / Adjustment Area Category PAF
Restroom	Restroom	0.65	140	91	No No
Restroom	Restroom	0.65	80	52	No No
TOTALS:			220	143	See Tables J, or P for detail

Generated Date/Time: Documentation Software: Energy Code Ace
 CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Compliance ID: 282723-0625-0010
 Schema Version: rev 20220101 Report Generated: 2025-06-06 12:04:38

STATE OF CALIFORNIA
Indoor Lighting
 CALIFORNIA ENERGY COMMISSION
 NRCC-LTI-E

CERTIFICATE OF COMPLIANCE
 Project Name: 19086.21 Redway Transfer Station - Weigh Station Report Page: (Page 5 of 7)
 Date Prepared: 2025-06-06T15:04:32-04:00

J. ADDITIONAL ALLOWANCE: AREA CATEGORY METHOD QUALIFYING LIGHTING SYSTEM
 This section does not apply to this project.

K. TAILORED METHOD GENERAL LIGHTING POWER ALLOWANCE
 This section does not apply to this project.

L. ADDITIONAL LIGHTING ALLOWANCE: TAILORED WALL DISPLAY
 This section does not apply to this project.

M. ADDITIONAL LIGHTING ALLOWANCE: TAILORED FLOOR AND TASK LIGHTING
 This section does not apply to this project.

N. ADDITIONAL LIGHTING ALLOWANCE: TAILORED DECORATIVE /SPECIAL EFFECTS
 This section does not apply to this project.

O. ADDITIONAL LIGHTING ALLOWANCE: TAILORED VERY VALUABLE MERCHANDISE
 This section does not apply to this project.

P. POWER ADJUSTMENT: LIGHTING CONTROL CREDIT (POWER ADJUSTMENT FACTOR (PAF))
 This section does not apply to this project.

Q. RATED POWER REDUCTION COMPLIANCE FOR ONE-FOR-ONE ALTERATIONS
 This section does not apply to this project.

Generated Date/Time: Documentation Software: Energy Code Ace
 CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Compliance ID: 282723-0625-0010
 Schema Version: rev 20220101 Report Generated: 2025-06-06 12:04:38

STATE OF CALIFORNIA
Indoor Lighting
 CALIFORNIA ENERGY COMMISSION
 NRCC-LTI-E

CERTIFICATE OF COMPLIANCE
 Project Name: 19086.21 Redway Transfer Station - Weigh Station Report Page: (Page 6 of 7)
 Date Prepared: 2025-06-06T15:04:32-04:00

R. 80% LIGHTING POWER FOR ALL ALTERATIONS - CONTROLS EXCEPTIONS
 This section does not apply to this project.

S. DAYLIGHT DESIGN POWER ADJUSTMENT FACTOR (PAF)
 This section does not apply to this project.

T. DWELLING UNIT LIGHTING
 This section does not apply to this project.

U. DECLARATION OF REQUIRED CERTIFICATES OF INSTALLATION

Selections have been made based on information provided in this document. If any selections have been changed by permit applicant, an explanation should be included in Table E. Additional Remarks. These documents must be provided to the building inspector during construction and can be found online.

Form/Title

NRCC-LTI-E - Must be submitted for all buildings

V. DECLARATION OF REQUIRED CERTIFICATES OF ACCEPTANCE

Selections have been made based on information provided in this document. If any selections have been changed by the permit applicant, an explanation should be included in Table E. Additional Remarks. These documents must be provided to the building inspector during construction and any with "A" in the form name must be completed through an Acceptance Test Technician Certification Provider (ATTCP). For more information visit: <http://www.energy.ca.gov/title24/attcp/providers.html>

Form/Title	Systems/Spaces To Be Field Verified
NRCA-LTI-02-A - Must be submitted for occupancy sensors and automatic time switch controls.	Weigh Station; Restroom

Generated Date/Time: Documentation Software: Energy Code Ace
 CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Compliance ID: 282723-0625-0010
 Schema Version: rev 20220101 Report Generated: 2025-06-06 12:04:38

Jun 17, 2025 - 10:39am UNAUTHORIZED CHANGES & USES: M. Neils Engineering, Inc. preparing these plans will not be responsible for, or liable for unauthorized changes to or uses to these plans. All changes to these plans must be in writing and must be approved by M. Neils Engineering, Inc.



M. NEILS ENGINEERING, INC.
Electrical Engineers | Lighting Designers
100 Howe Ave., Suite 235N
Sacramento, CA 95825-8217
Tel: (916) 923-4400 Fax: (916) 923-4410
PROJECT #: 19086.21

BAR IS ONE INCH ON ORIGINAL DRAWING
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

ROAD NAME: CONSERVATION CAMP RD	M.NEILS ENGINEERING
ROAD NO:	DESIGNED BY: SKL
PROJECT NO: 438005	MILE POST:
CONTRACT NO.:	EA NO.:
DRAWING FILE NAME:	BRIDGE NO.:
PLOT DATE: 6/17/25	REVISION DATE:
	DRAWN BY: PI
	REVIEWED BY: SKL/JLB
	APPROVED BY: JLB

COUNTY OF HUMBOLDT
DEPARTMENT OF PUBLIC WORKS
REDWAY TRANSFER STATION
TITLE 24 WEIGH STATION - INDOOR & OUTDOOR LIGHTING

SHEET
54
OF
58
E5.2

June 17, 2025

STATE OF CALIFORNIA
Indoor Lighting
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE NRCC-LTO-E
Project Name: 19086.21 Redway Transfer Station - Weigh Station Report Page: (Page 7 of 7)
Project Address: SACRAMENTO, CA 95825 Date Prepared: 2025-06-06T15:04:32-04:00

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT
I certify that this Certificate of Compliance documentation is accurate and complete.

Documentation Author Name: Julia L. Brodovsky Documentation Author Signature: [Signature]
Company: M. Neils Engineering Signature Date: 06/17/2025
Address: 100 HOWE AVE, SUITE 235N CEAV HERS Certification Identification (if applicable):
City/State/Zip: SACRAMENTO, CA 95825 Phone: (916) 923-4400

RESPONSIBLE PERSON'S DECLARATION STATEMENT
I certify the following under penalty of perjury, under the laws of the State of California:
1. The information provided on this Certificate of Compliance is true and correct.
2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer).
3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.
4. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.
5. I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.

Responsible Designer Name: Julia L. Brodovsky Responsible Designer Signature: [Signature]
Company: M. Neils Engineering Date Signed: 06/17/2025
Address: 100 HOWE AVE, SUITE 235N License: E24535
City/State/Zip: SACRAMENTO, CA 95825 Phone: (916) 923-4400

Generated Date/Time: Documentation Software: Energy Code Ace
CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Compliance ID: 282723-0625-0010
Schema Version: rev 20220101 Report Generated: 2025-06-06 12:04:38

Indoor Lighting Mandatory Measures:

110.9 LIGHTING CONTROLS AND COMPONENTS
ALL LIGHTING CONTROL DEVICES AND SYSTEMS, AND ALL LIGHT SOURCES SHALL MEET THE APPLICABLE REQUIREMENTS OF 110.9.
NOTE: THE EXCEPTED SPACES DO NOT COUNT TOWARDS THE 10,000 FT² THRESHOLD.

130.0 GENERAL LUMINAIRE REQUIREMENTS
ALL LUMINAIRES SHALL BE FACTORY-LABELLED PER 130.0(c).
ENERGY MANAGEMENT CONTROL SYSTEMS (EMCS) SHALL MEET REQUIREMENTS OF 130.0(e).

130.1(a) MANUAL AREA CONTROLS
EACH ROOM OR AREA WITH FLOOR-TO-CEILING WALLS IN THIS BUILDING SHALL HAVE LIGHTING CONTROLS THAT ALLOW LIGHTING TO BE MANUALLY TURNED ON AND OFF MANUALLY WITHOUT AFFECTING OTHER LIGHTING OR EQUIPMENT.

1. BE READILY ACCESSIBLE
2. BE LOCATED IN THE SAME ENCLOSED AREA WITH THE LIGHTING IT CONTROLS.
3. PROVIDE SEPARATE CONTROL OF GENERAL, FLOOR, WALL, WINDOW CASE DISPLAY, ORNAMENTAL AND SPECIAL EFFECTS LIGHTING SO EACH TYPE CAN BE TURNED ON AND OFF SEPARATELY WITHOUT AFFECTING OTHER LIGHTING OR EQUIPMENT.

130.1(b) MULTILEVEL LIGHTING CONTROLS
GENERAL LIGHTING IN ALL ROOMS AND AREAS 100 FT² OR GREATER AND WITH MORE THAN 0.5 WATTS PER FT² OF LIGHTING LOAD SHALL HAVE MULTILEVEL CONTROLS THAT ALLOW LIGHT LEVELS TO BE ADJUSTED UP AND DOWN. CONTROLS SHALL PROVIDE NUMBER OF CONTROL STEPS AND UNIFORM ILLUMINANCE LIGHT LEVELS PER TABLE 130.1-A.

130.1(c) SHUTOFF CONTROLS
ALL INSTALLED INDOOR LIGHTING SHALL BE EQUIPPED WITH CONTROLS TO AUTOMATICALLY REDUCE LIGHTING POWER WHEN SPACE IS TYPICALLY UNOCCUPIED.

130.1(c)(1): CONTROL REQUIREMENTS
ALL INSTALLED INDOOR LIGHTING SHALL HAVE ALL OF THE FOLLOWING:
A. CONTROL(S) CAPABLE OF AUTOMATICALLY SHUTTING OFF ALL LIGHTING IN THE SPACE WHEN TYPICALLY UNOCCUPIED (OCCUPANT SENSING CONTROL, AUTOMATIC TIME-SWITCH CONTROL, OR OTHER)
B. SEPARATE CONTROLS FOR LIGHTING ON EACH FLOOR (OTHER THAN STAIRWELLS)

C. SEPARATE CONTROLS FOR A SPACE ENCLOSED BY CEILING HEIGHT PARTITIONS NOT EXCEEDING 5,000 FT²

130.1(c)(6) PARTIAL OR FULL-OFF OCCUPANT SENSORS
PROVIDE PARTIAL OR FULL-OFF OCCUPANT SENSORS, IN ADDITION TO SHUTOFF CONTROLS PER 130.1(c)(1) AND 130.1(c)(2), IN THE FOLLOWING SPACES:

- AISLE WAYS AND OPEN AREAS IN WAREHOUSES
- LIBRARY BOOK STACK AISLES
- CORRIDORS AND STAIRWELLS
- OFFICES GREATER THAN 250 SQ. FT.

Indoor Lighting Mandatory Measures:

130.1(f) CONTROL INTERACTIONS
EACH LIGHTING CONTROL INSTALLED TO MEET 130.1 REQUIREMENTS SHALL INCORPORATE THE FUNCTIONS OF OTHER LIGHTING CONTROLS REQUIRED BY THIS SECTION.

- FOR GENERAL LIGHTING, MANUAL AREA CONTROL SHALL PERMIT THE LEVEL OF LIGHT PROVIDED WHILE LIGHTING IS ON TO BE SET OR ADJUSTED BY CONTROLS SPECIFIED IN 130.1(b), (c), (d) and (e).
- MANUAL AREA CONTROL SHALL PERMIT SHUTOFF CONTROL TO TURN THE LIGHTING DOWN OR OFF.
- MULTILEVEL CONTROL SHALL PERMIT THE AUTOMATIC DAYLIGHTING CONTROL TO ADJUST ELECTRIC LIGHTING IN RESPONSE TO DAYLIGHT.
- MULTILEVEL CONTROL SHALL PERMIT THE DEMAND RESPONSIVE (DR) CONTROL TO ADJUST LIGHTING DURING A DR EVENT THEN RETURN IT TO THE LEVEL SET BY THE CONTROL AFTER THE EVENT.
- SHUTOFF CONTROL SHALL PERMIT THE MANUAL AREA CONTROL TO TURN THE LIGHTING ON.
- AUTOMATIC DAYLIGHTING CONTROL SHALL PERMIT MULTILEVEL LIGHTING CONTROL TO ADJUST THE LIGHTING LEVEL.
- FOR LIGHTING CONTROLLED BY MULTILEVEL LIGHTING CONTROLS AND OCCUPANT SENSING CONTROLS THAT PROVIDE AUTOMATIC-ON FUNCTION, CONTROLS SHALL PROVIDE A PARTIAL-ON FUNCTION THAT IS CAPABLE OF AUTOMATICALLY ACTIVATING BETWEEN 50-70% OF CONTROLLED LIGHTING POWER.
- RESERVED
- FOR SPACE CONDITIONING SYSTEM ZONES SERVING ONLY SPACES THAT ARE REQUIRED TO HAVE OCCUPANT SENSING CONTROLS SHALL BE CONTROLLED BY OCCUPANCY SENSING CONTROLS.

STATE OF CALIFORNIA
Outdoor Lighting
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE NRCC-LTO-E
Project Name: 19086.21 Redway Transfer Station - Weigh Station Report Page: (Page 1 of 7)
Project Address: SACRAMENTO, CA 95825 Date Prepared: 2025-06-05T18:38:51-04:00

A. GENERAL INFORMATION

01 Project Location (city)	Redway, CA	04 Total Illuminated Hardscape Area (ft ²)	500
02 Climate Zone	2		
03 Outdoor Lighting Zone per Title 24 Part 1 10.114 or as designated by Authority Having Jurisdiction (AHJ):			
<input type="checkbox"/> LZ-0: Very Low - Undeveloped Parkland <input checked="" type="checkbox"/> LZ-1: Low - Rural Areas <input type="checkbox"/> LZ-2: Moderately High - Urban Areas <input type="checkbox"/> LZ-3: Moderately High - Urban Areas <input type="checkbox"/> LZ-4: High - Must be reviewed by CA Energy Commission for Approval			
05 Occupancy Types within Project			
• Commercial Industrial			

B. PROJECT SCOPE
This table includes outdoor lighting systems that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in 140.7 / 170.2(e)(6) or 141.0(b)(2) / 180.2(b)(4)Bv for alterations.

My Project Consists of:

01	02
<input checked="" type="checkbox"/> New Lighting System	Must Comply with Allowances from 140.7 / 170.2(e)(6)
<input type="checkbox"/> Altered Lighting System	Is your alteration increasing the connected lighting load (Watts)? <input type="radio"/> Yes <input type="radio"/> No
03	04
% of Existing Luminaires Being Altered ¹	Sum Total of Luminaires Being Added or Altered
<input type="checkbox"/> < 10% <input type="checkbox"/> >= 10% and < 50% <input type="checkbox"/> >= 50%	Calculation Method

Please proceed to Table F, Outdoor Lighting Fixture Schedule to define the project's luminaires.
¹ FOOTNOTES: % of Existing Luminaires Being Altered = (Sum Total of Luminaires Being Added or Altered / Existing Luminaires within the Scope of the Permit Application) x 100.

Generated Date/Time: Documentation Software: Energy Code Ace
CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Compliance ID: 282723-0625-0008
Schema Version: rev 20220101 Report Generated: 2025-06-05 15:38:54

STATE OF CALIFORNIA
Outdoor Lighting
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE NRCC-LTO-E
Project Name: 19086.21 Redway Transfer Station - Weigh Station Report Page: (Page 2 of 7)
Project Address: SACRAMENTO, CA 95825 Date Prepared: 2025-06-05T18:38:51-04:00

C. COMPLIANCE RESULTS
Results in this table are automatically calculated from data input and calculations in Tables F through N. Note: if any cell on this table says "COMPLIES with Exceptional Conditions" refer to Table D. Exceptional Conditions for guidance or see applicable Table referenced below.

Calculations of Total Allowed Lighting Power (Watts) 140.7 / 170.2(e)(6) or 141.0(b)(2) / 180.2(b)(4)Bv						Compliance Results					
01	02	03	04	05	06	07	08	09			
General Hardscape Allowance	Per Application 140.7(d)(2) / 170.2(e)(6) (See Table I)	Sales Frontage 140.7(d)(2) (See Table K)	Ornamental 140.7(d)(2) / 170.2(e)(6) (See Table L)	Per Specific Area 140.7(d)(2) / 170.2(e)(6) (See Table M)	Existing Power Allowance 141.0(b)(2) / 180.2(b)(4)Bv (See Table N)	Total Allowed (Watts)	Total Actual (Watts)	07 must be >= 08			
223	+	---	+	---	OR	---	=	223	>=	68	COMPLIES
Shielding Compliance (See Table G for Details)											N/A
Controls Compliance (See Table H for Details)											COMPLIES

D. EXCEPTIONAL CONDITIONS
This table is auto-filled with uneditable comments because of selections made or data entered in tables throughout the form.

E. ADDITIONAL REMARKS
This table includes remarks made by the permit applicant to the Authority Having Jurisdiction.

Generated Date/Time: Documentation Software: Energy Code Ace
CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Compliance ID: 282723-0625-0008
Schema Version: rev 20220101 Report Generated: 2025-06-05 15:38:54

STATE OF CALIFORNIA
Outdoor Lighting
CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE NRCC-LTO-E
Project Name: 19086.21 Redway Transfer Station - Weigh Station Report Page: (Page 3 of 7)
Project Address: SACRAMENTO, CA 95825 Date Prepared: 2025-06-05T18:38:51-04:00

F. OUTDOOR LIGHTING FIXTURE SCHEDULE
For new or altered lighting systems demonstrating compliance with 140.7 / 170.2(e)(6) all new luminaires being installed and any existing luminaires remaining or being moved within the spaces covered by the permit application are included in the Table below. For altered lighting systems using the Existing Power method per 141.0(b)(2) all new luminaires being installed and replacement luminaires being installed as part of the project scope are included (i.e. existing luminaires remaining or existing luminaires being moved are not included). Outdoor lighting attached to multifamily buildings and controlled from the inside of a dwelling unit are included in Table H, and are not included here. All other multifamily outdoor lighting is included here.

Designed Wattage:

01	02	03	04	05	06	07	08	09	10	
Name or Item Tag	Complete Luminaire Description	Watts per luminaire ^{1,2}	How is Wattage determined	Total Number Luminaires ³	Luminaire Status ⁴	Excluded per 140.7(a) / 170.2(e)(6)A	Design Watts	Cutoff Req. > 6,200 initial lumen output 130.2(b) / 160.5(c)(1) ⁴	Field Inspector	
									Pass	Fail
C1	OUTDOOR WALL LED <input type="checkbox"/> Linear	68	Mfr. Spec	1	New	<input type="checkbox"/>	68	NA: illuminate public right-of-way	<input type="checkbox"/>	<input type="checkbox"/>
Total Design Watts:							68			

* NOTES: Selections with a * require a note in the space below explaining how compliance is achieved.
EX: Luminaire is lighting a statue; EXCEPTION 2 to 130.2(b)
¹ FOOTNOTES: Authority Having Jurisdiction may ask for Luminaire cut sheets to confirm wattage used for compliance per 130.0(c) / 160.5(b)
² For linear luminaires, wattage should be indicated as W/ft instead of Watts/luminaire. Total linear feet should be indicated in column 05 instead of number of luminaires.
³ Select "New" for new luminaires in a new outdoor lighting project, or for added luminaires in an alteration. Select "Altered" for replacement luminaires in an alteration. Select "Existing to Remain" for existing luminaires within the project scope that are not being altered and are remaining. Select "Existing Reinstalled" for existing luminaires which are being removed and reinstalled as part of the project scope.
⁴ Compliance with mandatory shielding requirements is required for luminaires with initial lumen output >= 6,200 unless exempted by 130.2(b) / 160.5(c)

G. SHIELDING REQUIREMENTS (BUG)
This section does not apply to this project.

Generated Date/Time: Documentation Software: Energy Code Ace
CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Compliance ID: 282723-0625-0008
Schema Version: rev 20220101 Report Generated: 2025-06-05 15:38:54



M. NEILS ENGINEERING, INC.
 Electrical Engineers | Lighting Designers
 100 Howe Ave., Suite 235N
 Sacramento, CA 95825-8217
 www.mneilsengineering.com
 Tel: (916) 923-4400 Fax: (916) 923-4410
 PROJECT #: 19086.21

June 17, 2025

BAR IS ONE INCH ON ORIGINAL DRAWING
 IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

ROAD NAME: CONSERVATION CAMP RD	M. NEILS ENGINEERING
ROAD NO:	MILE POST:
PROJECT NO: 438005	EA NO:
CONTRACT NO.:	BRIDGE NO:
DRAWING FILE NAME:	REVIEWED BY: SKL/ALB
PLOT DATE: 6/17/25	APPROVED BY: ALB
REVISION DATE:	

COUNTY OF HUMBOLDT
DEPARTMENT OF PUBLIC WORKS

REDWAY TRANSFER STATION

**TITLE 24 WEIGH STATION -
OUTDOOR LIGHTING**

SHEET
55
OF
58

E5.3

Jun 17, 2025 - 10:39am UNAUTHORIZED CHANGES & USES. M. Neils Engineering, Inc. preparing these plans will not be responsible for, or liable for unauthorized changes to or uses to these plans. All changes to these plans must be in writing and must be approved by M. Neils Engineering, Inc.

STATE OF CALIFORNIA
Outdoor Lighting CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE NRCC-LTO-E
 Project Name: 19086.21 Redway Transfer Station - Weigh Station Report Page: (Page 4 of 7)
 Date Prepared: 2025-06-05 15:38:54

H. OUTDOOR LIGHTING CONTROLS

This table demonstrates compliance with controls requirements for all new or altered luminaires installed as part of the permit application. For alteration projects, luminaires which are existing to remain (ie untouched) and luminaires which are removed and reinstalled (wiring only) do not need to be included in this table even if they are within the spaces covered by the permit application.

Outdoor lighting for nonresidential buildings, parking garages and common service areas in multifamily buildings must be documented separately from outdoor lighting attached to multifamily buildings and controlled from the inside of a dwelling unit.

Mandatory Controls for Nonresidential Occupancies, Parking Garages & Common Areas in Multifamily Buildings

Area Description	01	02	03	04	05	
					Pass	Fail
Front Entrance and Parking Lot: "C1"		Shut-Off 130.2(c)1 / 160.5(c)	Auto-Schedule 130.2(c)2 / 160.5(c)	Motion Sensor 130.2(c)3 / 160.5(c)	Field Inspector	
		Photocontrol	Provided	NA: Industrial Sites Lighting		

¹FOOTNOTE: Text has been abbreviated, please refer to Table 160.5-A to confirm compliance with the specific light source technologies listed.
²Authority having jurisdiction may ask for cutsheets or other documentation to confirm compliance of light source.
³Recessed luminaires marked for use in fire-rated installations, and recessed luminaires installed in non-insulated ceilings are exempted from ii and iii.

Generated Date/Time: Documentation Software: Energy Code Ace
 CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Compliance ID: 282723-0625-0008
 Schema Version: rev 20220101 Report Generated: 2025-06-05 15:38:54

STATE OF CALIFORNIA
Outdoor Lighting CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE NRCC-LTO-E
 Project Name: 19086.21 Redway Transfer Station - Weigh Station Report Page: (Page 5 of 7)
 Date Prepared: 2025-06-05 15:38:54

I. LIGHTING POWER ALLOWANCE (per 140.7 / 170.2(e))

This table includes areas using allowance calculations per 140.7 / 170.2(e). General Hardscape Allowance is per Table 140.7-A/170.2-A while "Use it or lose it" Allowances are per Table 140.7-B/170.2-B. Indicate which allowances are being used to expand sections for user input. Luminaires that qualify for one of the "Use it or lose it" allowances shall not qualify for another "Use it or lose it" allowance. Outdoor lighting attached to multifamily buildings and controlled from the inside of a dwelling unit are included in Table H, and are not included here. All other multifamily outdoor lighting is included here.

Calculated General Hardscape Lighting Power Allowance per Table 140.7-A for Nonresidential & Hotel/Motel

Area Description	02		03		04		05		06		07		08		09	
	Area	Watts	Area	Watts	Area	Watts	Area	Watts	Area	Watts	Area	Watts	Area	Watts	Area	Watts
Front Entrance and Parking Lot	500		0.019		9.5				90		0.15		13.5		23	
Initial Wattage Allowance for Entire Site (Watts):															200	
Instances of Initial Wattage Allowance (LZ 0 only) ¹																
Total General Hardscape Allowance (Watts):															223	

J. LIGHTING ALLOWANCE: PER APPLICATION
 This section does not apply to this project.

K. LIGHTING ALLOWANCE: SALES FRONTAGE
 This section does not apply to this project.

L. LIGHTING ALLOWANCE: ORNAMENTAL
 This section does not apply to this project.

Generated Date/Time: Documentation Software: Energy Code Ace
 CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Compliance ID: 282723-0625-0008
 Schema Version: rev 20220101 Report Generated: 2025-06-05 15:38:54

STATE OF CALIFORNIA
Outdoor Lighting CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE NRCC-LTO-E
 Project Name: 19086.21 Redway Transfer Station - Weigh Station Report Page: (Page 6 of 7)
 Date Prepared: 2025-06-05 15:38:54

M. LIGHTING ALLOWANCE: PER SPECIFIC AREA
 This section does not apply to this project.

N. EXISTING CONDITIONS POWER ALLOWANCE (alterations only)
 This section does not apply to this project.

O. DECLARATION OF REQUIRED CERTIFICATES OF INSTALLATION

Selections have been made based on information provided in this document. If any selection has been changed by permit applicant, an explanation should be included in Table E. Additional Remarks. These documents must be provided to the building inspector during construction and can be found online.

Form/Title
NRCC-LTO-E - Must be submitted for all buildings

P. DECLARATION OF REQUIRED CERTIFICATES OF ACCEPTANCE

Selections have been made based on information provided in this document. If any selection has been changed by permit applicant, an explanation should be included in Table E. Additional Remarks. These documents must be provided to the building inspector during construction and must be completed through an Acceptance Test Technician Certification Provider (ATTCP). For more information visit: <http://www.energy.ca.gov/title24/attcp/providers.html>

Form/Title	Systems/Spaces To Be Field Verified
NRCA-LTO-02-A - Must be submitted for all outdoor lighting controls except for alterations where controls are added to <= 20 luminaires.	Front Entrance and Parking Lot: "C1"

Generated Date/Time: Documentation Software: Energy Code Ace
 CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Compliance ID: 282723-0625-0008
 Schema Version: rev 20220101 Report Generated: 2025-06-05 15:38:54

STATE OF CALIFORNIA
Outdoor Lighting CALIFORNIA ENERGY COMMISSION

CERTIFICATE OF COMPLIANCE NRCC-LTO-E
 Project Name: 19086.21 Redway Transfer Station - Weigh Station Report Page: (Page 7 of 7)
 Project Address: Date Prepared: 2025-06-05 15:38:54

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT

I certify that this Certificate of Compliance documentation is accurate and complete.

Documentation Author Name: Julia L. Brodovsky
 Signature Date: 06/17/2025

Company: M. Neils Engineering
 Address: 100 HOWE AVE, SUITE 235N
 City/State/Zip: SACRAMENTO, CA 95825
 Phone: (916) 923-4400

RESPONSIBLE PERSON'S DECLARATION STATEMENT

I certify the following under penalty of perjury, under the laws of the State of California:

- The information provided on this Certificate of Compliance is true and correct.
- I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer)
- The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.
- The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.
- I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.

Responsible Designer Name: Julia L. Brodovsky
 Signature Date: 06/17/2025

Company: M. Neils Engineering
 Address: 100 HOWE AVE, SUITE 235N
 City/State/Zip: SACRAMENTO, CA 95825
 License: E24535
 Phone: (916) 923-4400

Generated Date/Time: Documentation Software: Energy Code Ace
 CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Compliance ID: 282723-0625-0008
 Schema Version: rev 20220101 Report Generated: 2025-06-05 15:38:54

Outdoor Lighting Mandatory Measures:

110.9 OUTDOOR LIGHTING CONTROLS AND COMPONENTS
 ALL LIGHTING CONTROL DEVICES AND SYSTEMS, AND ALL LIGHT SOURCES SHALL MEET THE APPLICABLE REQUIREMENTS OF 110.9.

130.0 GENERAL LUMINAIRE REQUIREMENTS
 ALL LUMINAIRES SHALL BE FACTORY-LABELLED PER 130.0(c).
 ENERGY MANAGEMENT CONTROL SYSTEMS (EMCS) SHALL MEET REQUIREMENTS OF 130.0(e).

130.2(c) CONTROLS FOR OUTDOOR LIGHTING
 ALL OUTDOOR LIGHTING SHALL BE INDEPENDENTLY CONTROLLED FROM OTHER ELECTRICAL LOADS AND SHALL HAVE THE FOLLOWING FEATURES:

- AUTOMATICALLY TURNS OFF OUTDOOR LIGHTING WHEN DAYLIGHT IS AVAILABLE
- AUTOMATIC SCHEDULING CONTROLS
 - AUTOMATIC SCHEDULING CONTROLS SHALL BE INSTALLED FOR ALL OUTDOOR LIGHTING.
 - CAPABLE OF REDUCING LIGHTING POWER AT LEAST 50% AND NO MORE THAN 90% AND SEPARATELY CAPABLE OF TURNING LIGHTING OFF DURING UNOCCUPIED PERIODS
 - THAT ALLOW SCHEDULING OF AT LEAST TWO NIGHTTIME PERIODS WITH INDEPENDENT LIGHTING LEVELS (MAY INCLUDE OVERRIDE FOR NO MORE THAN 2 HOURS)



M. NEILS
ENGINEERING, INC.
 Electrical Engineers | Lighting Designers
 100 Howe Ave., Suite 235N
 Sacramento, CA 95825-8217
 www.mneilsengineering.com
 Tel: (916) 923-4400 Fax: (916) 923-4410
 PROJECT #: 19086.21

June 17, 2025

BAR IS ONE INCH ON ORIGINAL DRAWING
 IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

ROAD NAME: CONSERVATION CAMP RD	MILE POST:	M.NEILS ENGINEERING
PROJECT NO.: 438005	EA NO.:	DESIGNED BY: SKL
CONTRACT NO.:	BRIDGE NO.:	DRAWN BY: PI
DRAWING FILE NAME:		REVIEWED BY: SKL/JLB
PLOT DATE: 6/17/25	REVISION DATE:	APPROVED BY: JLB

COUNTY OF HUMBOLDT
 DEPARTMENT OF PUBLIC WORKS

REDWAY TRANSFER STATION
TITLE 24 RECYCLE BUILDING - INDOOR LIGHTING

SHEET
 56
 OF
 58

E5.4

STATE OF CALIFORNIA
Indoor Lighting
 CALIFORNIA ENERGY COMMISSION
 CERTIFICATE OF COMPLIANCE NRCC-LTI-E
 This document is used to demonstrate compliance with requirements in 110.9, 110.12(c), 130.0, 130.1, 140.6 and 141.0(b)2 for indoor lighting scopes using the prescriptive path for nonresidential and hotel/motel occupancies. It is also used to document compliance with requirements in 160.5, 170.2(e) and 180.2(b)4 for indoor lighting scopes using the prescriptive path for multifamily occupancies. Multifamily includes dormitory and senior living facilities.
 Project Name: 19086.21 Redway Transfer Station - Recycle Building Report Page: (Page 1 of 7)
 Project Address: Date Prepared: 2025-06-05T18:14:05-04:00

A. GENERAL INFORMATION

01 Project Location (city)	Redway, CA	04 Total Conditioned Floor Area (ft ²)	0
02 Climate Zone	2	05 Total Unconditioned Floor Area (ft ²)	2,400
03 Occupancy Types Within Project (select all that apply):	Warehouse	06 # of Stories (Habitable Above Grade)	0

B. PROJECT SCOPE
 This table includes any lighting systems that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in 140.6 / 170.2(e) or 141.0(b)2 / 180.2(b)4 for alterations.

Scope of Work	Conditioned Spaces		Unconditioned Spaces	
01	02	03	04	05
My Project Consists of (check all that apply):	Calculation Method	Area (ft ²)	Calculation Method	Area (ft ²)
<input checked="" type="checkbox"/> New Lighting System	N/A	0	Complete Building Method	2400
<input type="checkbox"/> New Lighting System - Parking Garage	N/A	0	N/A	0
Total Area of Work (ft²)				2400

Generated Date/Time: Documentation Software: Energy Code Ace
 CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Compliance ID: 281838-0625-0006
 Schema Version: rev 20220101 Report Generated: 2025-06-05 15:14:09

STATE OF CALIFORNIA
Indoor Lighting
 CALIFORNIA ENERGY COMMISSION
 CERTIFICATE OF COMPLIANCE NRCC-LTI-E
 Project Name: 19086.21 Redway Transfer Station - Recycle Building Report Page: (Page 2 of 7)
 Date Prepared: 2025-06-05T18:14:05-04:00

C. COMPLIANCE RESULTS
 If any cell on this table says "DOES NOT COMPLY" or "COMPLIES with Exceptional Conditions" refer to Table D. for guidance.

Lighting in conditioned and unconditioned spaces must not be combined for compliance per 140.6(b)1 / 170.2(e)	Allowed Lighting Power per 140.6(b) / 170.2(e) (Watts)					Adjusted Lighting Power per 140.6(a) / 170.2(e) (Watts)			Compliance Results
	01	02	03	04	05	06	07	08	
	Complete Building 140.6(c)1	Area Category 140.6(c)2 / 170.2(e)4	Area Category Additional 140.6(c)25 / 170.2(e)4Av (+)	Tailored 140.6(c)3 / 170.2(e)4B (+)	Total Allowed (Watts)	Total Designed (Watts)	PAF Lighting Control Credits 140.6(a)2 / 170.2(e)1B (+)	Total Adjusted (Watts) *Includes Adjustments	
(See Table I)	(See Table I)	(See Table J)	(See Table K)		(See Table F)	(See Table P)		05 must be >= 08 140.6 / 170.2(e)	
Conditioned				=	≥		=		
Unconditioned	1,440				=	581.52	=	581.52	COMPLIES
Controls Compliance (See Table H for Details)									COMPLIES
Rated Power Reduction Compliance (See Table Q for Details)									

D. EXCEPTIONAL CONDITIONS
 This table is auto-filled with uneditable comments because of selections made or data entered in tables throughout the form.

E. ADDITIONAL REMARKS
 This table includes remarks made by the permit applicant to the Authority Having Jurisdiction.

Generated Date/Time: Documentation Software: Energy Code Ace
 CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Compliance ID: 281838-0625-0006
 Schema Version: rev 20220101 Report Generated: 2025-06-05 15:14:09

STATE OF CALIFORNIA
Indoor Lighting
 CALIFORNIA ENERGY COMMISSION
 CERTIFICATE OF COMPLIANCE NRCC-LTI-E
 Project Name: 19086.21 Redway Transfer Station - Recycle Building Report Page: (Page 3 of 7)
 Date Prepared: 2025-06-05T18:14:05-04:00

F. INDOOR LIGHTING FIXTURE SCHEDULE
 This table includes all planned permanent and portable lighting other than dwelling unit/ hotel/ motel room lighting. Multifamily dwelling unit and hotel/motel room lighting is documented in Table T. If using Table T to document lighting in multifamily common use areas providing shared provisions for living, eating, cooking or sanitation, those luminaires are not included here.

Designed Wattage: Unconditioned Spaces									
01	02	03	04	05	06	07	08	09	10
Name or Item Tag	Complete Luminaire Description	Modular (Track) Fixture	Small Aperture & Color Change ¹	Watts per luminaire ²	How is Wattage determined	Total Number of Luminaires	Excluded per 140.6(a)3 / 170.2(e)2C	Design Watts	Field Inspector
A1	4FT WET LOCATION LED	No	NA	48.46	Mfr. Spec	12	No	581.52	Pass Fail
Total Designed Watts: UNCONDITIONED SPACES									581.52

¹FOOTNOTE: Design Watts for small aperture and color changing luminaires which qualify per 140.6(a)4B / 170.2(e)2D is adjusted to be 75% / 80% of their rated wattage. Table F automatically makes this adjustment, the permit applicant should enter full rated wattage in column 05.
²Authority Having Jurisdiction may ask for luminaire cut sheets to confirm wattage used for compliance per 130.0(c) / 160.5(b). Wattage used must be the maximum rated for the luminaire, not the lamp.

G. MODULAR LIGHTING SYSTEMS
 This section does not apply to this project.

H. INDOOR LIGHTING CONTROLS (Not including PAFs)
 This table includes lighting controls for conditioned and unconditioned spaces.

Building Level Controls		
01	02	03
Mandatory Demand Response 110.12(c)	Shut-off controls 130.1(c) / 160.5(b)4C	Field Inspector
NA < 4,000W subject to multilevel	See Area/Space Level Controls	Pass Fail

Generated Date/Time: Documentation Software: Energy Code Ace
 CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Compliance ID: 281838-0625-0006
 Schema Version: rev 20220101 Report Generated: 2025-06-05 15:14:09

STATE OF CALIFORNIA
Indoor Lighting
 CALIFORNIA ENERGY COMMISSION
 CERTIFICATE OF COMPLIANCE NRCC-LTI-E
 Project Name: 19086.21 Redway Transfer Station - Recycle Building Report Page: (Page 4 of 7)
 Date Prepared: 2025-06-05T18:14:05-04:00

I. INDOOR LIGHTING CONTROLS (Not including PAFs)
 Area Level Controls

04	05	06	07	08	09	10	11	12
Area Description	Complete Building or Area Category Primary Function Area	Manual Area Controls 130.1(a) / 160.5(b)4A	Multi-Level Controls 130.1(b) / 160.5(b)4B	Shut-Off Controls 130.1(c) // 160.5(b)4C	Primary/Sky lit Daylighting 130.1(d) / 160.5(b)4D	Secondary Daylighting 130.1(d) / 160.5(b)4D	Interlocked Systems 140.6(a)1 / 170.2(e)2A	Field Inspector
Warehouse	Industrial/Manufacturing Facility	Readily Accessible	Dimmer	Auto. Time Switch	NA: Not daylight zone	NA: Not daylight zone	No	Pass Fail
Plan Sheet Showing Daylit Zones:								

I. LIGHTING POWER ALLOWANCE: COMPLETE BUILDING OR AREA CATEGORY METHODS
 Each area complying using the Complete Building or Area Category Methods per 140.6(b) are included in this table. Column 06 indicates if additional lighting power allowances per 140.6(c) or adjustments per 140.6(a) are being used.

Unconditioned Spaces					
01	02	03	04	05	06
Area Description	Complete Building or Area Category Primary Function Area	Allowed Density (W/ft ²)	Area (ft ²)	Allowed Wattage (Watts)	Additional Allowance / Adjustment Area Category PAF
Warehouse	Industrial/Manufacturing Facility	0.6	2,400	1,440	No No
TOTALS:			2,400	1,440	See Tables J, or P for detail

J. ADDITIONAL ALLOWANCE: AREA CATEGORY METHOD QUALIFYING LIGHTING SYSTEM
 This section does not apply to this project.

Generated Date/Time: Documentation Software: Energy Code Ace
 CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Compliance ID: 281838-0625-0006
 Schema Version: rev 20220101 Report Generated: 2025-06-05 15:14:09

STATE OF CALIFORNIA
Indoor Lighting
 CALIFORNIA ENERGY COMMISSION
 CERTIFICATE OF COMPLIANCE NRCC-LTI-E
 Project Name: 19086.21 Redway Transfer Station - Recycle Building Report Page: (Page 5 of 7)
 Date Prepared: 2025-06-05T18:14:05-04:00

K. TAILORED METHOD GENERAL LIGHTING POWER ALLOWANCE
 This section does not apply to this project.

L. ADDITIONAL LIGHTING ALLOWANCE: TAILORED WALL DISPLAY
 This section does not apply to this project.

M. ADDITIONAL LIGHTING ALLOWANCE: TAILORED FLOOR AND TASK LIGHTING
 This section does not apply to this project.

N. ADDITIONAL LIGHTING ALLOWANCE: TAILORED DECORATIVE /SPECIAL EFFECTS
 This section does not apply to this project.

O. ADDITIONAL LIGHTING ALLOWANCE: TAILORED VERY VALUABLE MERCHANDISE
 This section does not apply to this project.

P. POWER ADJUSTMENT: LIGHTING CONTROL CREDIT (POWER ADJUSTMENT FACTOR (PAF))
 This section does not apply to this project.

Q. RATED POWER REDUCTION COMPLIANCE FOR ONE-FOR-ONE ALTERATIONS
 This section does not apply to this project.

R. 80% LIGHTING POWER FOR ALL ALTERATIONS - CONTROLS EXCEPTIONS
 This section does not apply to this project.

Generated Date/Time: Documentation Software: Energy Code Ace
 CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Compliance ID: 281838-0625-0006
 Schema Version: rev 20220101 Report Generated: 2025-06-05 15:14:09

STATE OF CALIFORNIA
Indoor Lighting
 CALIFORNIA ENERGY COMMISSION
 CERTIFICATE OF COMPLIANCE NRCC-LTI-E
 Project Name: 19086.21 Redway Transfer Station - Recycle Building Report Page: (Page 6 of 7)
 Date Prepared: 2025-06-05T18:14:05-04:00

S. DAYLIGHT DESIGN POWER ADJUSTMENT FACTOR (PAF)
 This section does not apply to this project.

T. DWELLING UNIT LIGHTING
 This section does not apply to this project.

U. DECLARATION OF REQUIRED CERTIFICATES OF INSTALLATION
 Selections have been made based on information provided in this document. If any selections have been changed by permit applicant, an explanation should be included in Table E. Additional Remarks. These documents must be provided to the building inspector during construction and can be found online
 Form/Title

V. DECLARATION OF REQUIRED CERTIFICATES OF ACCEPTANCE
 Selections have been made based on information provided in this document. If any selections have been changed by the permit applicant, an explanation should be included in Table E. Additional Remarks. These documents must be provided to the building inspector during construction and any with "A" in the form name must be completed through an Acceptance Test Technician Certification Provider (ATTCP). For more information visit: <http://www.energy.ca.gov/title24/attcp/providers.html>
 Form/Title Systems/Spaces To Be Field Verified
 NRCA-LTI-02-A - Must be submitted for occupancy sensors and automatic time switch controls. Warehouse

Generated Date/Time: Documentation Software: Energy Code Ace
 CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Compliance ID: 281838-0625-0006
 Schema Version: rev 20220101 Report Generated: 2025-06-05 15:14:09

Jun 17, 2025 - 10:39am UNAUTHORIZED CHANGES & USES: M. Neils Engineering, Inc. preparing these plans will not be responsible for, or liable for unauthorized changes to or uses to these plans. All changes to these plans must be approved by M. Neils Engineering, Inc.



M. NEILS ENGINEERING, INC.
 Electrical Engineers | Lighting Designers
 100 Howe Ave., Suite 235N
 Sacramento, CA 95825-8217
 Tel: (916) 923-4400 Fax: (916) 923-4410
 PROJECT #: 19086.21

BAR IS ONE INCH ON ORIGINAL DRAWING
 IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

ROAD NAME: CONSERVATION CAMP RD	MILE POST:	M. NEILS ENGINEERING
PROJECT NO.: 438005	EA NO.:	DESIGNED BY: SKL
CONTRACT NO.:	BRIDGE NO.:	DRAWN BY: PI
DRAWING FILE NAME:		REVIEWED BY: SKL/JLB
PLOT DATE: 6/17/25	REVISION DATE:	APPROVED BY: JLB

COUNTY OF HUMBOLDT
 DEPARTMENT OF PUBLIC WORKS
 REDWAY TRANSFER STATION
TITLE 24 RECYCLE BUILDING - INDOOR & OUTDOOR LIGHTING

June 17, 2025

JUN 17, 2025 - 10:39am UNAUTHORIZED CHANGES & USES: M. Neils Engineering, Inc. preparing these plans will not be responsible for, or liable for, unauthorized changes to or uses to these plans. All changes to these plans must be in writing and must be approved by M. Neils Engineering, Inc.

STATE OF CALIFORNIA
Indoor Lighting
 CERTIFICATE OF COMPLIANCE
 Project Name: 19086.21 Redway Transfer Station - Recycle Building
 Project Address: 100 HOWE AVE, SUITE 235N SACRAMENTO, CA 95825

CALIFORNIA ENERGY COMMISSION
 NRCC-LTI-E
 Report Page: (Page 7 of 7)
 Date Prepared: 2025-06-05T18:14:05-04:00

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT
 I certify that this Certificate of Compliance documentation is accurate and complete.

Documentation Author Name: Julia L. Brodovsky
 Company: M. Neils Engineering
 Address: 100 HOWE AVE, SUITE 235N
 City/State/Zip: SACRAMENTO, CA 95825

Documentation Author Signature: [Signature]
 Signature Date: 06/17/2025
 CEJ/HERS Certification Identification (if applicable):
 Phone: (916) 923-4400

RESPONSIBLE PERSON'S DECLARATION STATEMENT
 I certify the following under penalty of perjury, under the laws of the State of California:

- The information provided on this Certificate of Compliance is true and correct.
- I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer).
- The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.
- The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.
- I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.

Responsible Designer Name: Julia L. Brodovsky
 Company: M. Neils Engineering
 Address: 100 HOWE AVE, SUITE 235N
 City/State/Zip: SACRAMENTO, CA 95825

Responsible Designer Signature: [Signature]
 Date Signed: 06/17/2025
 License: E24535
 Phone: (916) 923-4400

Generated Date/Time: [Blank] Documentation Software: Energy Code Ace
 CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance
 Report Version: 2022.0.000 Compliance ID: 281838-0625-0006
 Schema Version: rev 20220101 Report Generated: 2025-06-05 15:14:09

Indoor Lighting Mandatory Measures:

110.9 LIGHTING CONTROLS AND COMPONENTS
 ALL LIGHTING CONTROL DEVICES AND SYSTEMS, AND ALL LIGHT SOURCES SHALL MEET THE APPLICABLE REQUIREMENTS OF 110.9.
 NOTE: THE EXCEPTED SPACES DO NOT COUNT TOWARDS THE 10,000 FT² THRESHOLD.

130.0 GENERAL LUMINAIRE REQUIREMENTS
 ALL LUMINAIRES SHALL BE FACTORY-LABELLED PER 130.0(c).
 ENERGY MANAGEMENT CONTROL SYSTEMS (EMCS) SHALL MEET REQUIREMENTS OF 130.0(e).

130.1(a) MANUAL AREA CONTROLS
 EACH ROOM OR AREA WITH FLOOR-TO-CEILING WALLS IN THIS BUILDING SHALL HAVE LIGHTING CONTROLS THAT ALLOW LIGHTING TO BE MANUALLY TURNED ON AND OFF MANUALLY WITHOUT AFFECTING OTHER LIGHTING OR EQUIPMENT.

- BE READILY ACCESSIBLE
- BE LOCATED IN THE SAME ENCLOSED AREA WITH THE LIGHTING IT CONTROLS.
- PROVIDE SEPARATE CONTROL OF GENERAL, FLOOR, WALL, WINDOW CASE DISPLAY, ORNAMENTAL AND SPECIAL EFFECTS LIGHTING SO EACH TYPE CAN BE TURNED ON AND OFF SEPARATELY WITHOUT AFFECTING OTHER LIGHTING OR EQUIPMENT.

130.1(b) MULTILEVEL LIGHTING CONTROLS
 GENERAL LIGHTING IN ALL ROOMS AND AREAS 100 FT² OR GREATER AND WITH MORE THAN 0.5 WATTS PER FT² OF LIGHTING LOAD SHALL HAVE MULTILEVEL CONTROLS THAT ALLOW LIGHT LEVELS TO BE ADJUSTED UP AND DOWN. CONTROLS SHALL PROVIDE NUMBER OF CONTROL STEPS AND UNIFORM ILLUMINANCE LIGHT LEVELS PER TABLE 130.1-A.

130.1(c) SHUTOFF CONTROLS
 ALL INSTALLED INDOOR LIGHTING SHALL BE EQUIPPED WITH CONTROLS TO AUTOMATICALLY REDUCE LIGHTING POWER WHEN SPACE IS TYPICALLY UNOCCUPIED.

130.1(c)1: CONTROL REQUIREMENTS
 ALL INSTALLED INDOOR LIGHTING SHALL HAVE ALL OF THE FOLLOWING:
 A. CONTROL(S) CAPABLE OF AUTOMATICALLY SHUTTING OFF ALL LIGHTING IN THE SPACE WHEN TYPICALLY UNOCCUPIED (OCCUPANT SENSING CONTROL, AUTOMATIC TIME-SWITCH CONTROL, OR OTHER)
 B. SEPARATE CONTROLS FOR LIGHTING ON EACH FLOOR (OTHER THAN STAIRWELLS)

C. SEPARATE CONTROLS FOR A SPACE ENCLOSED BY CEILING HEIGHT PARTITIONS NOT EXCEEDING 5,000 FT²

130.1(c)3,4 OVERRIDE FOR BUILDING LIGHTING SHUT-OFF
 AREAS SERVED BY SHUT-OFF CONTROLS (OTHER THAN OCCUPANT SENSORS) SHALL:
 130.1(c)3. INCLUDE MANUAL OVERRIDE CONTROL THAT COMPLIES WITH 130.1(a) AND ALLOWS LIGHTING TO REMAIN ON FOR UP TO 2 HOURS; AND
 130.1(c)4. PROVIDE AUTOMATIC HOLIDAY "SHUTOFF".

130.1(c)6 PARTIAL OR FULL-OFF OCCUPANT SENSORS
 PROVIDE PARTIAL OR FULL-OFF OCCUPANT SENSORS, IN ADDITION TO SHUTOFF CONTROLS PER 130.1(c)1 AND 130.1(c)2, IN THE FOLLOWING SPACES:

- aisle ways and open areas in warehouses
- library book stack aisles
- corridors and stairwells
- offices greater than 250 sq. ft.

Generated Date/Time: [Blank] Documentation Software: Energy Code Ace
 CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance
 Report Version: 2022.0.000 Compliance ID: 281838-0625-0006
 Schema Version: rev 20220101 Report Generated: 2025-06-05 15:14:09

Indoor Lighting Mandatory Measures:

130.1(f) CONTROL INTERACTIONS
 EACH LIGHTING CONTROL INSTALLED TO MEET 130.1 REQUIREMENTS SHALL INCORPORATE THE FUNCTIONS OF OTHER LIGHTING CONTROLS REQUIRED BY THIS SECTION.

- FOR GENERAL LIGHTING, MANUAL AREA CONTROL SHALL PERMIT THE LEVEL OF LIGHT PROVIDED WHILE LIGHTING IS ON TO BE SET OR ADJUSTED BY CONTROLS SPECIFIED IN 130.1(b), (c), (d) and (e).
- MANUAL AREA CONTROL SHALL PERMIT SHUTOFF CONTROL TO TURN THE LIGHTING DOWN OR OFF.
- MULTILEVEL CONTROL SHALL PERMIT THE AUTOMATIC DAYLIGHTING CONTROL TO ADJUST ELECTRIC LIGHTING IN RESPONSE TO DAYLIGHT.
- MULTILEVEL CONTROL SHALL PERMIT THE DEMAND RESPONSIVE (DR) CONTROL TO ADJUST LIGHTING DURING A DR EVENT THEN RETURN IT TO THE LEVEL SET BY THE CONTROL AFTER THE EVENT.
- SHUTOFF CONTROL SHALL PERMIT THE MANUAL AREA CONTROL TO TURN THE LIGHTING ON.
- AUTOMATIC DAYLIGHTING CONTROL SHALL PERMIT MULTILEVEL LIGHTING CONTROL TO ADJUST THE LIGHTING LEVEL.
- FOR LIGHTING CONTROLLED BY MULTILEVEL LIGHTING CONTROLS AND OCCUPANT SENSING CONTROLS THAT PROVIDE AUTOMATIC-ON FUNCTION, CONTROLS SHALL PROVIDE A PARTIAL-ON FUNCTION THAT IS CAPABLE OF AUTOMATICALLY ACTIVATING BETWEEN 50-70% OF CONTROLLED LIGHTING POWER.
- RESERVED
- FOR SPACE CONDITIONING SYSTEM ZONES SERVING ONLY SPACES THAT ARE REQUIRED TO HAVE OCCUPANT SENSING CONTROLS SHALL BE CONTROLLED BY OCCUPANCY SENSING CONTROLS.

Generated Date/Time: [Blank] Documentation Software: Energy Code Ace
 CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance
 Report Version: 2022.0.000 Compliance ID: 281838-0625-0006
 Schema Version: rev 20220101 Report Generated: 2025-06-05 15:14:09

STATE OF CALIFORNIA
Outdoor Lighting
 CERTIFICATE OF COMPLIANCE
 Project Name: 19086.21 Redway Transfer Station - Recycle Building
 Project Address: 100 HOWE AVE, SUITE 235N SACRAMENTO, CA 95825

CALIFORNIA ENERGY COMMISSION
 NRCC-LTO-E
 Report Page: (Page 1 of 8)
 Date Prepared: 2025-06-05T18:15:33-04:00

A. GENERAL INFORMATION

01 Project Location (city)	Redway, CA	04 Total Illuminated Hardscape Area (ft ²)	5400
02 Climate Zone	2		
03 Outdoor Lighting Zone per Title 24 Part 1.10.114 or as designated by Authority Having Jurisdiction (AHJ):	<input type="checkbox"/> LZ-0: Very Low - Undeveloped Parkland <input checked="" type="checkbox"/> LZ-1: Low - Rural Areas <input type="checkbox"/> LZ-2: Moderate - Urban Clusters <input type="checkbox"/> LZ-3: Moderately High - Urban Areas <input type="checkbox"/> LZ-4: High - Must be reviewed by CA Energy Commission for Approval		
05 Occupancy Types within Project	<input checked="" type="checkbox"/> Warehouse		

B. PROJECT SCOPE
 This table includes outdoor lighting systems that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in 140.7 / 170.2(e)6 or 141.0(b)2L / 180.2(b)4Bv for alterations.

My Project Consists of:

01	02
<input checked="" type="checkbox"/> New Lighting System	Must Comply with Allowances from 140.7 / 170.2(e)6
<input type="checkbox"/> Altered Lighting System	Is your alteration increasing the connected lighting load (Watts)?
	<input type="radio"/> Yes <input type="radio"/> No
03 % of Existing Luminaires Being Altered ¹	04 Sum Total of Luminaires Being Added or Altered
<input type="checkbox"/> < 10% <input type="checkbox"/> >= 10% and < 50% <input type="checkbox"/> >= 50%	05 Calculation Method

Please proceed to Table F, Outdoor Lighting Fixture Schedule to define the project's luminaires.
¹ FOOTNOTES: % of Existing Luminaires Being Altered = (Sum Total of Luminaires Being Added or Altered / Existing Luminaires within the Scope of the Permit Application) x 100.

Generated Date/Time: [Blank] Documentation Software: Energy Code Ace
 CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance
 Report Version: 2022.0.000 Compliance ID: 281838-0625-0008
 Schema Version: rev 20220101 Report Generated: 2025-06-05 15:15:36

STATE OF CALIFORNIA
Outdoor Lighting
 CERTIFICATE OF COMPLIANCE
 Project Name: 19086.21 Redway Transfer Station - Recycle Building
 Project Address: 100 HOWE AVE, SUITE 235N SACRAMENTO, CA 95825

CALIFORNIA ENERGY COMMISSION
 NRCC-LTO-E
 Report Page: (Page 2 of 8)
 Date Prepared: 2025-06-05T18:15:33-04:00

C. COMPLIANCE RESULTS
 Results in this table are automatically calculated from data input and calculations in Tables F through N. Note: If any cell on this table says "COMPLIES with Exceptional Conditions" refer to Table D. Exceptional Conditions for guidance or see applicable Table referenced below.

Calculations of Total Allowed Lighting Power (Watts) 140.7 / 170.2(e)6 or 141.0(b)2L / 180.2(b)4Bv						Compliance Results		
01	02	03	04	05	06	07	08	09
General Hardscape Allowance	Per Application 140.7(d)2 / 170.2(e)6 (See Table I)	Sales Frontage 140.7(d)2 (See Table K)	Ornamental 140.7(d)2 / 170.2(e)6 (See Table L)	Per Specific Area 140.7(d)2 / 170.2(e)6 (See Table M)	Existing Power Allowance 141.0(b)2L / 180.2(b)4Bv (See Table N)	Total Allowed (Watts)	Total Actual (Watts)	07 must be >= 08
332.6	45	---	---	---	---	377.6	270	COMPLIES
Shielding Compliance (See Table G for Details)						N/A		
Controls Compliance (See Table H for Details)						COMPLIES		

D. EXCEPTIONAL CONDITIONS
 This table is auto-filled with uneditable comments because of selections made or data entered in tables throughout the form.

E. ADDITIONAL REMARKS
 This table includes remarks made by the permit applicant to the Authority Having Jurisdiction.

Generated Date/Time: [Blank] Documentation Software: Energy Code Ace
 CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance
 Report Version: 2022.0.000 Compliance ID: 281838-0625-0008
 Schema Version: rev 20220101 Report Generated: 2025-06-05 15:15:36

STATE OF CALIFORNIA
Outdoor Lighting
 CERTIFICATE OF COMPLIANCE
 Project Name: 19086.21 Redway Transfer Station - Recycle Building
 Project Address: 100 HOWE AVE, SUITE 235N SACRAMENTO, CA 95825

CALIFORNIA ENERGY COMMISSION
 NRCC-LTO-E
 Report Page: (Page 3 of 8)
 Date Prepared: 2025-06-05T18:15:33-04:00

F. OUTDOOR LIGHTING FIXTURE SCHEDULE
 For new or altered lighting systems demonstrating compliance with 140.7 / 170.2(e)6 all new luminaires being installed and any existing luminaires remaining or being moved within the spaces covered by the permit application are included in the Table below. For altered lighting systems using the Existing Power method per 141.0(b)2L only new luminaires being installed and replacement luminaires being installed as part of the project scope are included (i.e. existing luminaires remaining or existing luminaires being moved are not included). Outdoor lighting attached to multifamily buildings and controlled from the inside of a dwelling unit are included in Table H, and are not included here. All other multifamily outdoor lighting is included here.

Designed Wattage:

01	02	03	04	05	06	07	08	09	10
Name or Item Tag	Complete Luminaire Description	Watts per luminaire ^{1,2}	How is Wattage determined	Total Number Luminaires ³	Luminaire Status ³	Excluded per 140.7(a) / 170.2(e)6A	Design Watts	Cutoff Req. > 6,200 initial lumen output 130.2(b) / 160.5(c)1 ⁴	Field Inspector
C2	OUTDOOR WALL LED <input type="checkbox"/> Linear	90	Mfr. Spec.	3	New	<input type="checkbox"/>	270	NA: Exception in Section 140.7(a)	<input type="checkbox"/> Pass <input type="checkbox"/> Fail
Total Design Watts:							270		

* NOTES: Selections with a * require a note in the space below explaining how compliance is achieved.
 EX: Luminaire is lighting a statue; EXCEPTION 2 to 130.2(b)
¹ FOOTNOTES: Authority Having Jurisdiction may ask for Luminaire cut sheets to confirm wattage used for compliance per 130.0(c) / 160.5(b)
² For linear luminaires, wattage should be indicated as W/ft instead of Watts/luminaire. Total linear feet should be indicated in column 05 instead of number of luminaires.
³ Select "New" for new luminaires in a new outdoor lighting project, or for added luminaires in an alteration. Select "Altered" for replacement luminaires in an alteration. Select "Existing to Remain" for existing luminaires within the project scope that are not being altered and are remaining. Select "Existing Reinstalled" for existing luminaires which are being removed and reinstalled as part of the project scope.
⁴ Compliance with mandatory shielding requirements is required for luminaires with initial lumen output >= 6,200 unless exempted by 130.2(b) / 160.5(c)

G. SHIELDING REQUIREMENTS (BUG)
 This section does not apply to this project.

Generated Date/Time: [Blank] Documentation Software: Energy Code Ace
 CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance
 Report Version: 2022.0.000 Compliance ID: 281838-0625-0008
 Schema Version: rev 20220101 Report Generated: 2025-06-05 15:15:36

Jun 17, 2025 - 10:39am UNAUTHORIZED CHANGES & USES: M. Neils Engineering, Inc. preparing these plans will not be responsible for, or liable for unauthorized changes to or uses to these plans. All changes to these plans must be in writing and must be approved by M. Neils Engineering, Inc.



M. NEILS ENGINEERING, INC.
Electrical Engineers | Lighting Designers
100 Howe Ave., Suite 235N
Sacramento, CA 95825-9217
www.mneilsengineering.com
Tel: (916) 923-4400 Fax: (916) 923-4410
PROJECT #: 19086.21

June 17, 2025

BAR IS ONE INCH ON ORIGINAL DRAWING
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALES ACCORDINGLY

ROAD NAME: CONSERVATION CAMP RD	M.NEILS ENGINEERING
ROAD NO:	MILE POST:
PROJECT NO.: 438005	EA NO.:
CONTRACT NO.:	BRIDGE NO.:
DRAWING FILE NAME:	DESIGNED BY: SKL
PLOT DATE: 6/17/25	REVISION DATE:
	DRAWN BY: PI
	REVIEWED BY: SKL/JLB
	APPROVED BY: JLB

COUNTY OF HUMBOLDT
DEPARTMENT OF PUBLIC WORKS
**TITLE 24 RECYCLE BUILDING -
OUTDOOR LIGHTING**

SHEET 58 OF 58
E5.6

STATE OF CALIFORNIA
Outdoor Lighting CALIFORNIA ENERGY COMMISSION
CERTIFICATE OF COMPLIANCE NRCC-LTO-E
Project Name: 19086.21 Redway Transfer Station - Recycle Building Report Page: (Page 4 of 8)
Date Prepared: 2025-06-05T18:15:33-04:00

H. OUTDOOR LIGHTING CONTROLS
This table demonstrates compliance with controls requirements for all new or altered luminaires installed as part of the permit application. For alteration projects, luminaires which are existing to remain (ie untouched) and luminaires which are removed and reinstalled (wiring only) do not need to be included in this table even if they are within the spaces covered by the permit application.
Outdoor lighting for nonresidential buildings, parking garages and common service areas in multifamily buildings must be documented separately from outdoor lighting attached to multifamily buildings and controlled from the inside of a dwelling unit
Mandatory Controls for Nonresidential Occupancies, Parking Garages & Common Areas in Multifamily Buildings

01	02	03	04	05
Area Description	Shut-Off 130.2(c)1 / 160.5(c)	Auto-Schedule 130.2(c)2 / 160.5(c)	Motion Sensor 130.2(c)3 / 160.5(c)	Field Inspector
				Pass
				Fail
Warehouse Entrances: "C2"	Other Control	Provided	NA: Industrial Sites Lighting	<input type="checkbox"/>

¹FOOTNOTE: Text has been abbreviated, please refer to Table 160.5-A to confirm compliance with the specific light source technologies listed.
²Authority having jurisdiction may ask for cutsheets or other documentation to confirm compliance of light source.
³Recessed luminaires marked for use in fire-rated installations, and recessed luminaires installed in non-insulated ceilings are excepted from ii and iii.

Generated Date/Time: Documentation Software: Energy Code Ace
CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Compliance ID: 281838-0625-0008
Schema Version: rev 20220101 Report Generated: 2025-06-05 15:15:36

STATE OF CALIFORNIA
Outdoor Lighting CALIFORNIA ENERGY COMMISSION
CERTIFICATE OF COMPLIANCE NRCC-LTO-E
Project Name: 19086.21 Redway Transfer Station - Recycle Building Report Page: (Page 5 of 8)
Date Prepared: 2025-06-05T18:15:33-04:00

I. LIGHTING POWER ALLOWANCE (per 140.7 / 170.2(e))
This table includes areas using allowance calculations per 140.7 / 170.2(e). General Hardscape Allowance is per Table 140.7-A/ Table 170.2-R while "Use it or lose it" Allowances are per Table 140.7-B / Table 170.2-S. Indicate which allowances are being used to expand sections for user input. Luminaires that qualify for one of the "Use it or lose it" allowances shall not qualify for another "Use it or lose it" allowance.
Outdoor lighting attached to multifamily buildings and controlled from the inside of a dwelling unit are included in Table H, and are not included here. All other multifamily outdoor lighting is included here.
Calculated General Hardscape Lighting Power Allowance per Table 140.7-A for Nonresidential & Hotel/Motel

Area Description	01 "Use it or lose it" Allowance (select all that apply) (select all that apply)						Total General AWA + LWA (Watts)	
	General Hardscape Allowance Table I (below)	Per Application Table J	Sales Frontage Table K	Ornamental Table L	Per Specific Area Table M	Per Specific Area Table M		
Area Description	02	03	04	05	06	07	08	09
	Area Wattage Allowance (AWA)	Area Wattage Allowance (AWA)	Area Allowance (Watts)	Perimeter Length (ft)	Allowed Density (W/ft)	Linear Allowance (Watts)	Linear Allowance (Watts)	Total General AWA + LWA (Watts)
Around Recycle Warehouse	5400	0.019	102.6	200	0.15	30	30	132.6
Initial Wattage Allowance for Entire Site (Watts):								200
Instances of Initial Wattage Allowance (L2 0 only):								200
Total General Hardscape Allowance (Watts):								332.6

Generated Date/Time: Documentation Software: Energy Code Ace
CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Compliance ID: 281838-0625-0008
Schema Version: rev 20220101 Report Generated: 2025-06-05 15:15:36

STATE OF CALIFORNIA
Outdoor Lighting CALIFORNIA ENERGY COMMISSION
CERTIFICATE OF COMPLIANCE NRCC-LTO-E
Project Name: 19086.21 Redway Transfer Station - Recycle Building Report Page: (Page 6 of 8)
Date Prepared: 2025-06-05T18:15:33-04:00

J. LIGHTING ALLOWANCE: PER APPLICATION
This table includes areas using the wattage allowance per application from Table 140.7-B / Table 170.2-S.

Area Description	Application per Table 140.7-B ¹	CALCULATED ALLOWANCE (Watts)			DESIGN WATTS			Additional Allowance (Watts)	
		# of Locations	Allowance per Location ²	Extra Allowance (Watts)	Luminaire Name or Item Tag	Watts per Luminaire	# of Luminaires		Design Watts
Warehouse Entrances	Building Entrance/Exit	3	15	45	C2	90	3	270	45
Total Design Watts for this Area:								270	
Total Allowance (Watts) All Areas:								45	

¹ FOOTNOTES: Primary entrance applications are only available for senior care facilities, healthcare facilities, police stations, hospitals, fire stations, and emergency vehicle facilities.
² The Allowance per Location for ATMs is 100W for the first ATM and 35W for each additional per Table 140.7-B / Table 170.2-S.
³ For luminaires indicated in Table F as linear, wattage in column 07 is W/ft instead of Watts/luminaire. Total linear feet should be indicated in column 08 instead of number of luminaires.

K. LIGHTING ALLOWANCE: SALES FRONTAGE
This section does not apply to this project.

L. LIGHTING ALLOWANCE: ORNAMENTAL
This section does not apply to this project.

M. LIGHTING ALLOWANCE: PER SPECIFIC AREA
This section does not apply to this project.

N. EXISTING CONDITIONS POWER ALLOWANCE (alterations only)
This section does not apply to this project.

Generated Date/Time: Documentation Software: Energy Code Ace
CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Compliance ID: 281838-0625-0008
Schema Version: rev 20220101 Report Generated: 2025-06-05 15:15:36

STATE OF CALIFORNIA
Outdoor Lighting CALIFORNIA ENERGY COMMISSION
CERTIFICATE OF COMPLIANCE NRCC-LTO-E
Project Name: 19086.21 Redway Transfer Station - Recycle Building Report Page: (Page 7 of 8)
Date Prepared: 2025-06-05T18:15:33-04:00

O. DECLARATION OF REQUIRED CERTIFICATES OF INSTALLATION
Selections have been made based on information provided in this document. If any selection has been changed by permit applicant, an explanation should be included in Table E.
Additional Remarks: These documents must be provided to the building inspector during construction and can be found online
Form/Title
NRCC-LTO-E - Must be submitted for all buildings

P. DECLARATION OF REQUIRED CERTIFICATES OF ACCEPTANCE
Selections have been made based on information provided in this document. If any selection has been changed by permit applicant, an explanation should be included in Table E.
Additional Remarks: These documents must be provided to the building inspector during construction and must be completed through an Acceptance Test Technician Certification Provider (ATTCP). For more information visit: <http://www.energy.ca.gov/title24/attcp/providers.html>
Form/Title
NRCA-LTO-02-A - Must be submitted for all outdoor lighting controls except for alterations where controls are added to <= 20 luminaires.
Systems/Spaces To Be Field Verified
Warehouse Entrances: "C2"

Generated Date/Time: Documentation Software: Energy Code Ace
CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Compliance ID: 281838-0625-0008
Schema Version: rev 20220101 Report Generated: 2025-06-05 15:15:36

STATE OF CALIFORNIA
Outdoor Lighting CALIFORNIA ENERGY COMMISSION
CERTIFICATE OF COMPLIANCE NRCC-LTO-E
Project Name: 19086.21 Redway Transfer Station - Recycle Building Report Page: (Page 8 of 8)
Date Prepared: 2025-06-05T18:15:33-04:00

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT
I certify that this Certificate of Compliance documentation is accurate and complete.
Documentation Author Name: Julia L. Brodovskiy
Company: M. Neils Engineering
Address: 100 HOWE AVE, SUITE 235N
City/State/Zip: SACRAMENTO, CA 95825
Phone: (916) 923-4400
Signature Date: 06/17/2025
CEA/HERS Certification Identification (if applicable):
Phone: (916) 923-4400

RESPONSIBLE PERSON'S DECLARATION STATEMENT
I certify the following under penalty of perjury, under the laws of the State of California:
1. The information provided on this Certificate of Compliance is true and correct.
2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer).
3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 9 of the California Code of Regulations.
4. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.
5. I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.

Responsible Designer Name: Julia L. Brodovskiy
Company: M. Neils Engineering
Address: 100 HOWE AVE, SUITE 235N
City/State/Zip: SACRAMENTO, CA 95825
Signature Date: 06/17/2025
License: E24535
Phone: (916) 923-4400

Generated Date/Time: Documentation Software: Energy Code Ace
CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance Report Version: 2022.0.000 Compliance ID: 281838-0625-0008
Schema Version: rev 20220101 Report Generated: 2025-06-05 15:15:36

Outdoor Lighting Mandatory Measures:
110.9 OUTDOOR LIGHTING CONTROLS AND COMPONENTS
ALL LIGHTING CONTROL DEVICES AND SYSTEMS, AND ALL LIGHT SOURCES SHALL MEET THE APPLICABLE REQUIREMENTS OF 110.9.
130.0 GENERAL LUMINAIRE REQUIREMENTS
ALL LUMINAIRES SHALL BE FACTORY-LABELLED PER 130.0(c).
ENERGY MANAGEMENT CONTROL SYSTEMS (EMCS) SHALL MEET REQUIREMENTS OF 130.0(e).
130.2(c) CONTROLS FOR OUTDOOR LIGHTING
ALL OUTDOOR LIGHTING SHALL BE INDEPENDENTLY CONTROLLED FROM OTHER ELECTRICAL LOADS AND SHALL HAVE THE FOLLOWING FEATURES:
2. AUTOMATIC SCHEDULING CONTROLS
A. AUTOMATIC SCHEDULING CONTROLS SHALL BE INSTALLED FOR ALL OUTDOOR LIGHTING.
B. CAPABLE OF REDUCING LIGHTING POWER AT LEAST 50% AND NO MORE THAN 90% AND SEPARATELY CAPABLE OF TURNING LIGHTING OFF DURING UNOCCUPIED PERIODS
C. THAT ALLOW SCHEDULING OF AT LEAST TWO NIGHTTIME PERIODS WITH INDEPENDENT LIGHTING LEVELS (MAY INCLUDE OVERRIDE FOR NO MORE THAN 2 HOURS)